

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920239

Luminaire Tested: DFN2DIP-SQ3F0-110D050US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920239
REPORT IS A COMBINATION OF REPORTS P901414 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D050US935-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12312.3 lumens
Efficiency: N/A
Efficacy: 82.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 148.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLLONL

Luminous Intensity Polar Plot

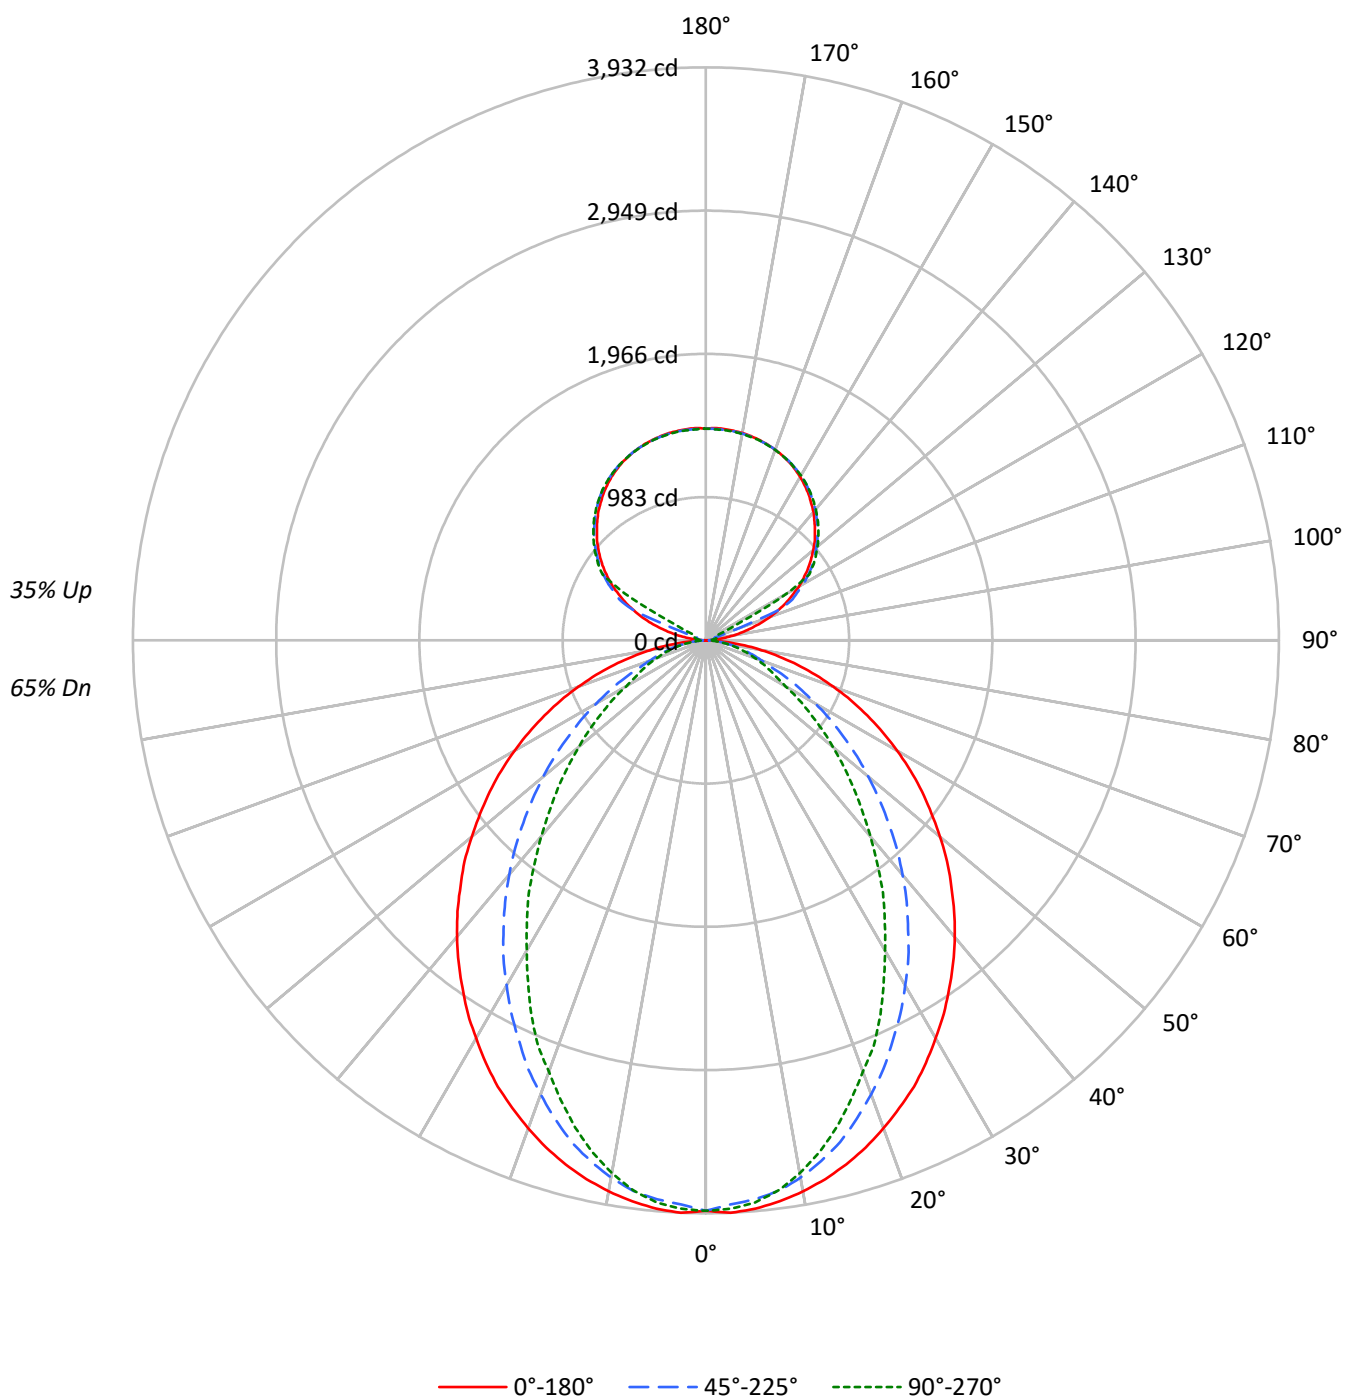

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	70	70	70
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	56	54	52
3	86	76	69	63	80	72	66	61	64	59	55	57	53	50	50	48	45
4	79	68	60	54	74	64	57	52	58	52	48	51	47	43	46	42	39
5	72	61	53	47	68	58	51	45	52	46	42	46	42	38	41	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	37	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	36	32	39	34	29	36	31	27	32	28	25
9	54	42	34	29	51	40	33	28	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4485	4485	4485
5°	4489	4411	4441
10°	4442	4321	4295
15°	4378	4176	4070
20°	4294	3976	3795
25°	4209	3753	3529
30°	4094	3524	3192
35°	3982	3279	2897
40°	3868	3025	2558
45°	3736	2744	2251
50°	3598	2460	1951
55°	3455	2158	1664
60°	3288	1841	1368
65°	3097	1521	1229
70°	2865	1221	1111
75°	2572	1070	1007
80°	2149	889	869
85°	1457	578	643

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3736 cd/sqm

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	3.0
10°-20°	1007.1	8.2
20°-30°	1413.9	11.5
30°-40°	1541.3	12.5
40°-50°	1416.6	11.5
50°-60°	1112.5	9.0
60°-70°	724.2	5.9
70°-80°	372.8	3.0
80°-90°	97.7	0.8
90°-100°	47.9	0.4
100°-110°	178.6	1.5
110°-120°	473.7	3.8
120°-130°	785.6	6.4
130°-140°	834.5	6.8
140°-150°	775.6	6.3
150°-160°	623.5	5.1
160°-170°	401.8	3.3
170°-180°	138.3	1.1
0°-30°	2787.9	22.6
0°-40°	4329.1	35.2
0°-60°	6858.3	55.7
0°-90°	8052.9	65.4
90°-120°	700.2	5.7
90°-150°	3095.8	25.1
90°-180°	4259.0	34.6
0°-180°	12312.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3914	3914	3914	3914	3914	
5°	3914	3897	3850	3882	3872	371
15°	3723	3684	3564	3496	3461	1049
25°	3380	3266	3032	2887	2834	1554
35°	2912	2731	2420	2196	2118	1823
45°	2381	2143	1771	1520	1435	1838
55°	1810	1534	1151	939	872	1617
65°	1222	935	616	496	485	1212
75°	652	404	283	259	255	689
85°	152	78	67	67	67	175
90°	1	13	21	26	28	12
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	622
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3914.4	3914.4	3914.4	3914.4	3914.4
2.5°	3932.0	3914.4	3875.3	3911.0	3903.9
5°	3914.4	3896.7	3850.5	3882.4	3871.9
7.5°	3882.4	3861.3	3811.7	3825.7	3807.9
10°	3840.0	3815.1	3744.5	3733.5	3712.5
12.5°	3786.9	3755.0	3659.2	3638.1	3599.0
15°	3723.0	3684.0	3563.7	3496.4	3461.0
17.5°	3648.7	3591.9	3443.0	3365.2	3308.5
20°	3563.7	3492.6	3315.6	3227.3	3149.1
22.5°	3471.6	3390.0	3184.5	3064.2	3011.2
25°	3379.5	3266.0	3032.3	2887.2	2833.8
27.5°	3269.8	3149.1	2890.5	2724.0	2642.5
30°	3152.9	3018.0	2734.6	2554.2	2458.3
32.5°	3039.4	2876.2	2586.1	2373.4	2284.7
35°	2912.0	2731.2	2419.7	2196.4	2118.2
37.5°	2788.0	2592.9	2263.6	2019.0	1930.7
40°	2656.8	2444.5	2100.6	1849.1	1757.0
42.5°	2522.2	2295.6	1937.8	1675.5	1587.2
45°	2380.6	2143.0	1771.3	1519.5	1434.6
47.5°	2246.0	1994.6	1612.0	1360.1	1282.4
50°	2097.1	1845.7	1456.0	1211.3	1137.3
52.5°	1951.7	1686.0	1307.2	1073.4	1006.1
55°	1810.0	1533.8	1151.2	938.8	871.6
57.5°	1665.0	1381.6	1013.2	814.8	758.0
60°	1516.1	1232.8	867.8	687.4	630.7
62.5°	1371.1	1087.7	743.8	573.9	545.7
65°	1222.2	935.0	616.4	496.1	485.2
67.5°	1080.6	793.4	496.1	435.6	425.1
70°	931.7	655.5	410.8	375.5	361.2
72.5°	790.0	527.7	343.5	315.3	308.2
75°	651.7	403.6	283.4	258.6	255.2
77.5°	513.8	286.8	223.3	209.0	201.8
80°	386.0	205.6	169.9	156.0	156.0
82.5°	269.1	138.3	116.9	109.8	109.8
85°	152.2	77.8	67.2	67.2	67.2
87.5°	56.7	28.2	28.2	24.8	24.8
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.2	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.7	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.6	1074.5	1083.8	1094.5	1092.3
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.4	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.3	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1372.9	1364.6	1374.1	1381.5	1372.9
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.0	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.6	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.7
180°	1452.8	1452.8	1452.8	1452.8	1452.8

TEST NUMBER: P920239

CATALOG NUMBER: DFN2DIP-SQ3F0-110D050US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.66	14.63	14.48	15.47	16.50	9.62	10.59	10.44	11.43	12.46
	3H	15.34	16.21	16.17	17.06	18.12	10.81	11.68	11.64	12.53	13.59
	4H	15.95	16.77	16.80	17.63	18.70	11.26	12.08	12.11	12.94	14.01
	6H	16.38	17.13	17.24	18.00	19.08	11.59	12.34	12.45	13.20	14.29
	8H	16.51	17.23	17.38	18.11	19.19	11.68	12.40	12.55	13.28	14.36
	12H	16.57	17.26	17.45	18.13	19.24	11.72	12.41	12.60	13.28	14.39
4H	2H	13.69	14.51	14.55	15.37	16.44	10.23	11.05	11.08	11.90	12.98
	3H	15.53	16.21	16.39	17.10	18.19	11.58	12.27	12.45	13.15	14.24
	4H	16.22	16.84	17.10	17.73	18.84	12.13	12.75	13.01	13.64	14.75
	6H	16.74	17.27	17.63	18.18	19.30	12.55	13.09	13.45	13.99	15.12
	8H	16.92	17.41	17.81	18.32	19.45	12.68	13.18	13.58	14.08	15.21
	12H	17.01	17.46	17.93	18.38	19.52	12.75	13.20	13.66	14.12	15.26
8H	4H	16.20	16.70	17.09	17.60	18.73	12.42	12.92	13.32	13.82	14.95
	6H	16.76	17.18	17.69	18.12	19.25	12.93	13.35	13.86	14.29	15.42
	8H	16.98	17.34	17.91	18.28	19.43	13.12	13.49	14.05	14.42	15.57
	12H	17.12	17.44	18.05	18.37	19.57	13.24	13.56	14.18	14.49	15.69
12H	4H	16.16	16.61	17.07	17.53	18.66	12.43	12.88	13.35	13.80	14.94
	6H	16.74	17.11	17.67	18.04	19.19	12.98	13.35	13.92	14.29	15.44
	8H	16.96	17.28	17.90	18.21	19.41	13.19	13.52	14.13	14.44	15.65

END OF REPORT