

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920254

Luminaire Tested: DFN2DIP-SQ3F0-110D090US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920254
REPORT IS A COMBINATION OF REPORTS P899966 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D090US935-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14908.1 lumens
Efficiency: N/A
Efficacy: 82.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 180.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLLFLL

Luminous Intensity Polar Plot

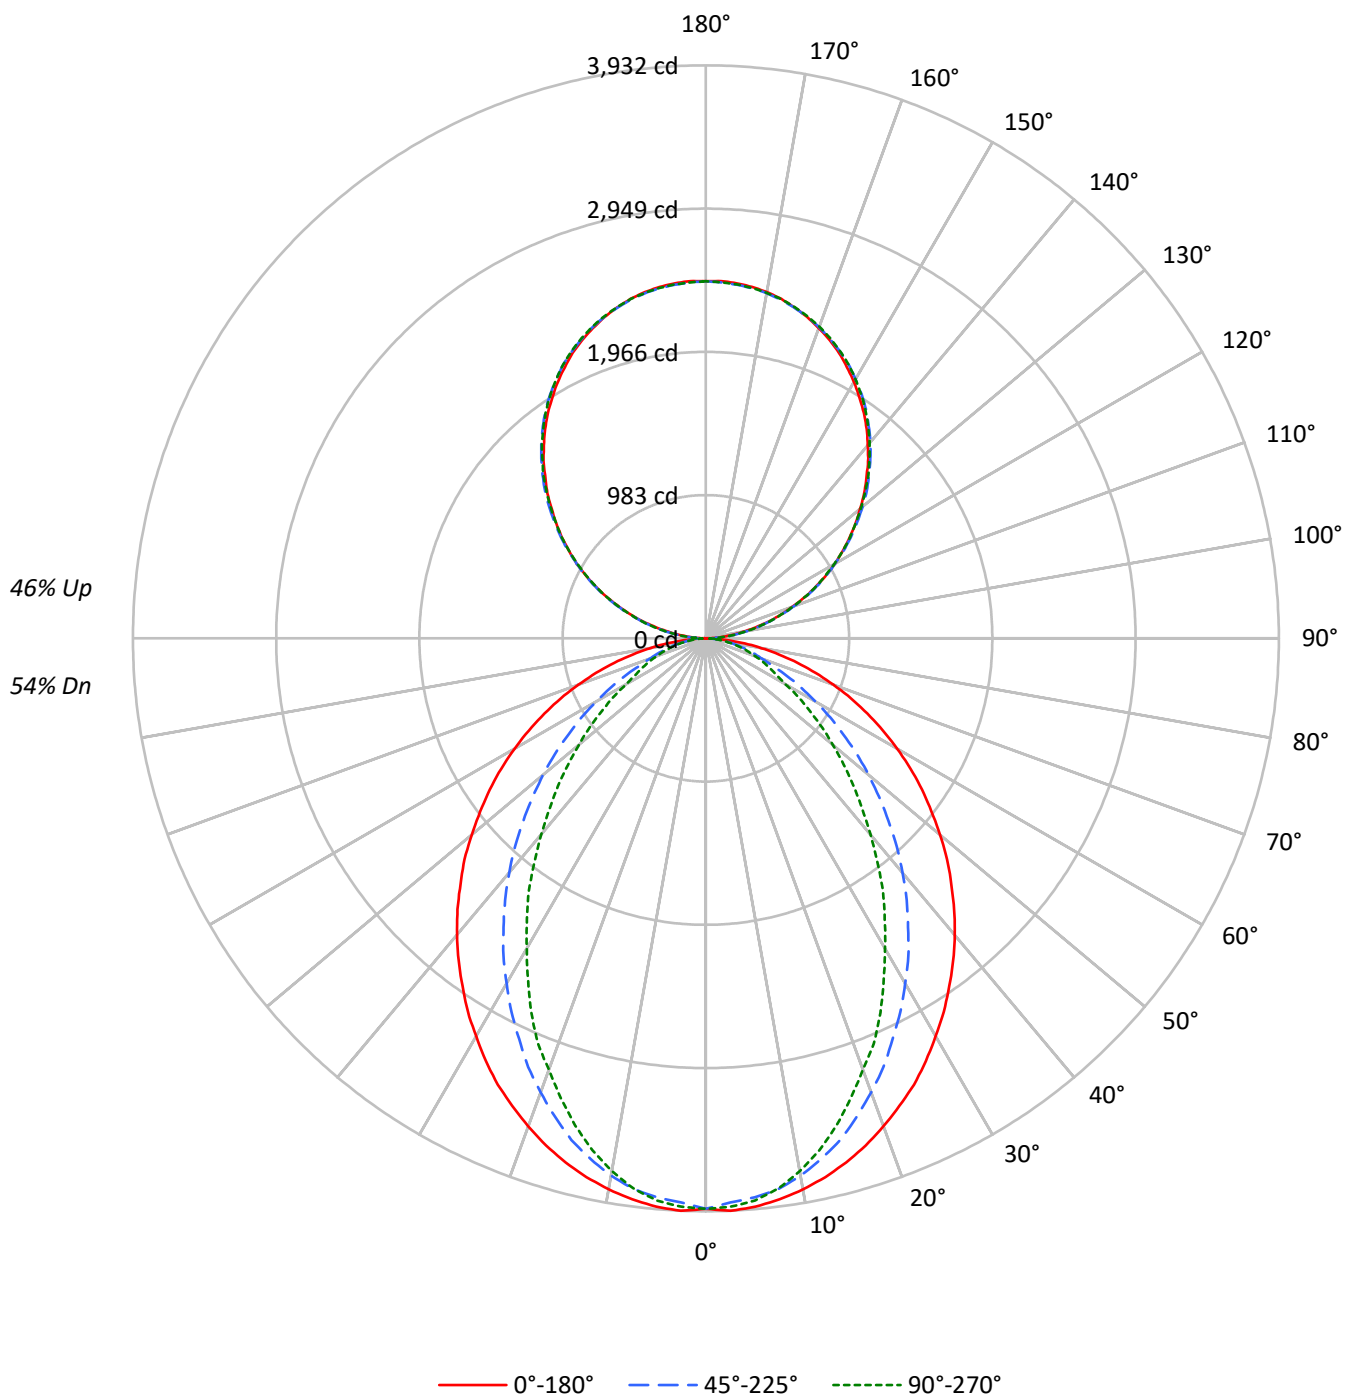

TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	72	72	72	60	60	60
1	99	95	91	88	92	88	85	82	76	73	71	64	63	61	54	53	52
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	60	55	51	51	47	45	43	40	38
4	76	66	58	52	71	62	55	49	53	48	44	46	42	39	39	36	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	38	43	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	34	30	27	29	26	23
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	26	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4485	4485	4485
5°	4489	4411	4441
10°	4442	4321	4295
15°	4378	4176	4070
20°	4294	3976	3795
25°	4209	3753	3529
30°	4094	3524	3192
35°	3982	3279	2897
40°	3868	3025	2558
45°	3736	2744	2251
50°	3598	2460	1951
55°	3455	2158	1664
60°	3288	1841	1368
65°	3097	1521	1229
70°	2865	1221	1111
75°	2572	1070	1007
80°	2149	889	869
85°	1457	578	643

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3736 cd/sqm

TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	2.5
10°-20°	1007.1	6.8
20°-30°	1413.9	9.5
30°-40°	1541.3	10.3
40°-50°	1416.6	9.5
50°-60°	1112.5	7.5
60°-70°	724.2	4.9
70°-80°	372.8	2.5
80°-90°	102.1	0.7
90°-100°	151.6	1.0
100°-110°	481.8	3.2
110°-120°	824.6	5.5
120°-130°	1084.4	7.3
130°-140°	1217.2	8.2
140°-150°	1193.6	8.0
150°-160°	1001.3	6.7
160°-170°	664.0	4.5
170°-180°	232.1	1.6
0°-30°	2787.9	18.7
0°-40°	4329.1	29.0
0°-60°	6858.3	46.0
0°-90°	8057.3	54.0
90°-120°	1458.0	9.8
90°-150°	4953.4	33.2
90°-180°	6851.0	46.0
0°-180°	14908.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3914	3914	3914	3914	3914	
5°	3914	3897	3850	3882	3872	371
15°	3723	3684	3564	3496	3461	1049
25°	3380	3266	3032	2887	2834	1554
35°	2912	2731	2420	2196	2118	1823
45°	2381	2143	1771	1520	1435	1838
55°	1810	1534	1151	939	872	1617
65°	1222	935	616	496	485	1212
75°	652	404	283	259	255	689
85°	152	78	67	67	67	175
90°	2	27	72	68	70	15
95°	108	128	132	132	128	120
105°	445	451	455	459	459	469
115°	828	839	836	833	828	818
125°	1204	1222	1216	1209	1207	1076
135°	1557	1580	1584	1582	1576	1203
145°	1890	1905	1916	1919	1911	1181
155°	2161	2167	2174	2184	2177	995
165°	2351	2349	2349	2364	2353	663
175°	2446	2440	2436	2451	2438	232
180°	2451	2451	2451	2451	2451	



TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3914.4	3914.4	3914.4	3914.4	3914.4
2.5°	3932.0	3914.4	3875.3	3911.0	3903.9
5°	3914.4	3896.7	3850.5	3882.4	3871.9
7.5°	3882.4	3861.3	3811.7	3825.7	3807.9
10°	3840.0	3815.1	3744.5	3733.5	3712.5
12.5°	3786.9	3755.0	3659.2	3638.1	3599.0
15°	3723.0	3684.0	3563.7	3496.4	3461.0
17.5°	3648.7	3591.9	3443.0	3365.2	3308.5
20°	3563.7	3492.6	3315.6	3227.3	3149.1
22.5°	3471.6	3390.0	3184.5	3064.2	3011.2
25°	3379.5	3266.0	3032.3	2887.2	2833.8
27.5°	3269.8	3149.1	2890.5	2724.0	2642.5
30°	3152.9	3018.0	2734.6	2554.2	2458.3
32.5°	3039.4	2876.2	2586.1	2373.4	2284.7
35°	2912.0	2731.2	2419.7	2196.4	2118.2
37.5°	2788.0	2592.9	2263.6	2019.0	1930.7
40°	2656.8	2444.5	2100.6	1849.1	1757.0
42.5°	2522.2	2295.6	1937.8	1675.5	1587.2
45°	2380.6	2143.0	1771.3	1519.5	1434.6
47.5°	2246.0	1994.6	1612.0	1360.1	1282.4
50°	2097.1	1845.7	1456.0	1211.3	1137.3
52.5°	1951.7	1686.0	1307.2	1073.4	1006.1
55°	1810.0	1533.8	1151.2	938.8	871.6
57.5°	1665.0	1381.6	1013.2	814.8	758.0
60°	1516.1	1232.8	867.8	687.4	630.7
62.5°	1371.1	1087.7	743.8	573.9	545.7
65°	1222.2	935.0	616.4	496.1	485.2
67.5°	1080.6	793.4	496.1	435.6	425.1
70°	931.7	655.5	410.8	375.5	361.2
72.5°	790.0	527.7	343.5	315.3	308.2
75°	651.7	403.6	283.4	258.6	255.2
77.5°	513.8	286.8	223.3	209.0	201.8
80°	386.0	205.6	169.9	156.0	156.0
82.5°	269.1	138.3	116.9	109.8	109.8
85°	152.2	77.8	67.2	67.2	67.2
87.5°	56.7	28.2	28.2	24.8	24.8
90°	2.2	26.6	72.4	67.9	70.2
92.5°	45.8	62.1	64.3	66.5	66.5
95°	107.9	128.5	132.2	132.2	128.5
97.5°	179.5	198.7	206.9	206.9	206.9
100°	262.3	279.3	285.2	285.2	283.0
102.5°	349.5	362.0	370.1	372.4	370.1
105°	444.8	450.6	455.1	458.8	458.8
107.5°	539.3	548.2	548.2	549.7	539.3
110°	630.9	642.8	642.8	642.8	636.9

TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	730.0	742.5	740.3	734.4	730.0
115°	827.5	839.3	835.6	833.4	827.5
117.5°	924.3	940.6	930.2	924.3	918.3
120°	1021.8	1038.0	1021.8	1021.8	1015.1
122.5°	1110.4	1131.2	1120.8	1114.9	1110.4
125°	1203.6	1222.0	1216.2	1209.4	1207.3
127.5°	1294.4	1317.3	1309.2	1300.4	1294.4
130°	1379.4	1406.0	1402.3	1397.8	1389.7
132.5°	1474.7	1495.4	1496.8	1486.5	1480.7
135°	1556.7	1579.6	1584.1	1581.8	1576.0
137.5°	1648.3	1666.8	1670.5	1669.0	1660.2
140°	1728.9	1747.3	1757.6	1757.6	1749.5
142.5°	1811.6	1830.1	1836.0	1838.2	1830.1
145°	1890.0	1904.7	1916.5	1918.7	1910.6
147.5°	1960.1	1978.6	1987.4	1991.1	1983.1
150°	2032.6	2045.1	2053.2	2059.9	2053.2
152.5°	2096.8	2109.4	2119.7	2127.9	2119.7
155°	2161.1	2167.0	2173.7	2184.0	2177.4
157.5°	2216.5	2220.9	2224.6	2239.4	2229.0
160°	2266.0	2270.5	2272.7	2285.2	2276.3
162.5°	2311.8	2311.8	2314.0	2328.1	2317.7
165°	2351.0	2348.7	2348.7	2363.5	2353.2
167.5°	2386.4	2379.8	2379.8	2394.5	2384.2
170°	2413.0	2407.1	2404.9	2419.7	2407.1
172.5°	2431.5	2425.6	2423.4	2438.2	2425.6
175°	2446.3	2440.3	2435.9	2450.7	2438.2
177.5°	2454.4	2448.5	2444.0	2456.6	2444.0
180°	2450.7	2450.7	2450.7	2450.7	2450.7

TEST NUMBER: P920254

CATALOG NUMBER: DFN2DIP-SQ3F0-110D090US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.70	13.56	13.62	14.50	15.72	8.66	9.52	9.59	10.46	11.68
	3H	14.37	15.14	15.31	16.10	17.33	9.84	10.61	10.78	11.57	12.80
	4H	14.98	15.71	15.93	16.66	17.91	10.29	11.02	11.24	11.97	13.22
	6H	15.40	16.07	16.36	17.03	18.29	10.61	11.28	11.57	12.24	13.50
	8H	15.52	16.16	16.50	17.14	18.40	10.69	11.33	11.67	12.31	13.57
	12H	15.59	16.19	16.56	17.16	18.45	10.74	11.34	11.71	12.32	13.60
4H	2H	12.72	13.45	13.68	14.40	15.65	9.25	9.98	10.21	10.94	12.19
	3H	14.54	15.15	15.51	16.14	17.40	10.60	11.21	11.57	12.19	13.45
	4H	15.23	15.79	16.21	16.77	18.05	11.14	11.70	12.12	12.68	13.96
	6H	15.75	16.22	16.74	17.22	18.51	11.56	12.03	12.55	13.04	14.32
	8H	15.92	16.36	16.91	17.36	18.66	11.68	12.13	12.68	13.12	14.42
	12H	16.01	16.41	17.02	17.43	18.73	11.75	12.15	12.76	13.16	14.46
8H	4H	15.20	15.65	16.19	16.64	17.94	11.42	11.87	12.42	12.86	14.16
	6H	15.76	16.13	16.78	17.17	18.47	11.94	12.30	12.95	13.34	14.64
	8H	15.98	16.30	17.00	17.33	18.64	12.12	12.44	13.15	13.47	14.79
	12H	16.11	16.40	17.14	17.42	18.78	12.24	12.52	13.26	13.54	14.90
12H	4H	15.16	15.56	16.17	16.57	17.87	11.43	11.83	12.44	12.84	14.15
	6H	15.74	16.06	16.76	17.09	18.40	11.98	12.31	13.01	13.33	14.65
	8H	15.96	16.24	16.99	17.26	18.62	12.19	12.47	13.22	13.49	14.85

END OF REPORT