

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920276

Luminaire Tested: DFN2DIP-SQ3F0-120D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920276
REPORT IS A COMBINATION OF REPORTS P899913 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D060US935-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14800.6 lumens
Efficiency: N/A
Efficacy: 86.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 170.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFLL

Luminous Intensity Polar Plot

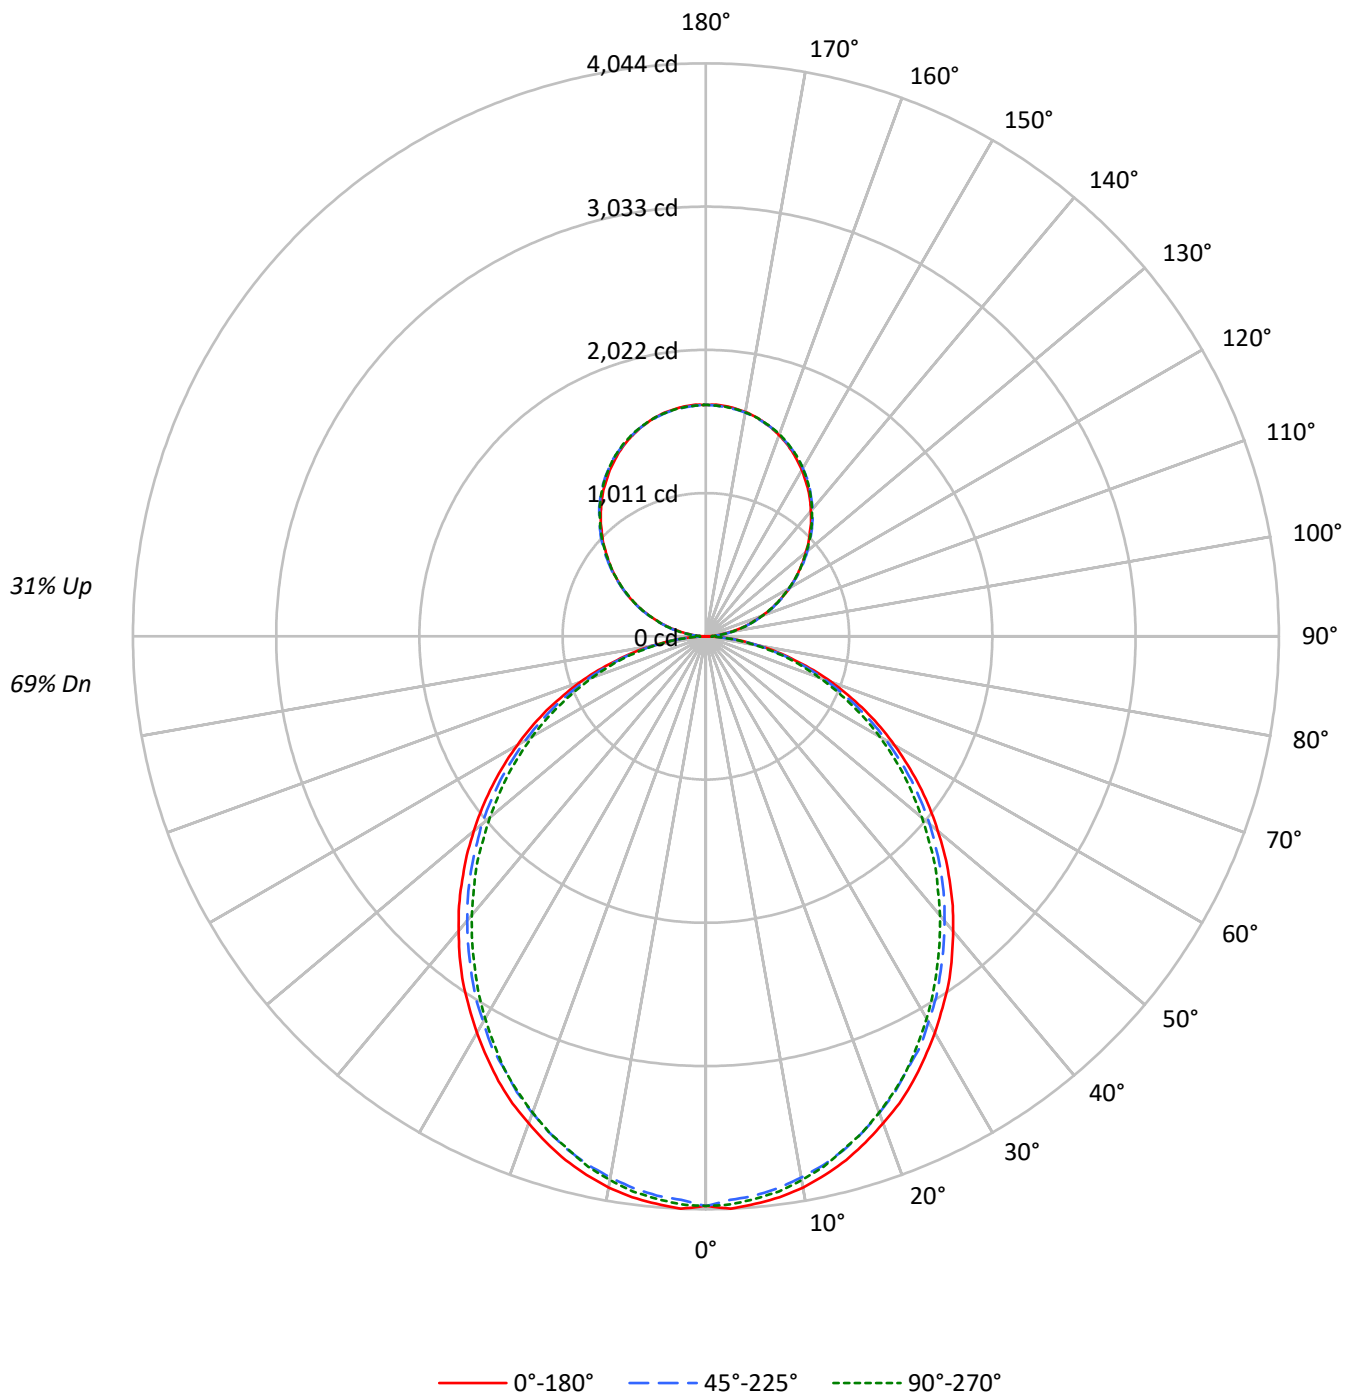

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4606	4606	4606
5°	4611	4539	4571
10°	4570	4475	4508
15°	4500	4398	4410
20°	4407	4293	4309
25°	4313	4167	4193
30°	4197	4050	4046
35°	4087	3913	3891
40°	3951	3774	3743
45°	3816	3634	3591
50°	3668	3488	3416
55°	3513	3318	3254
60°	3337	3117	3069
65°	3145	2909	2851
70°	2900	2655	2615
75°	2562	2350	2396
80°	2154	1961	1980
85°	1516	1299	1296

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3816 cd/sqm

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	378.4	2.6
10°-20°	1064.6	7.2
20°-30°	1564.6	10.6
30°-40°	1817.2	12.3
40°-50°	1814.9	12.3
50°-60°	1582.5	10.7
60°-70°	1169.9	7.9
70°-80°	661.9	4.5
80°-90°	179.3	1.2
90°-100°	101.1	0.7
100°-110°	321.2	2.2
110°-120°	549.7	3.7
120°-130°	723.0	4.9
130°-140°	811.5	5.5
140°-150°	795.8	5.4
150°-160°	667.5	4.5
160°-170°	442.7	3.0
170°-180°	154.7	1.0
0°-30°	3007.6	20.3
0°-40°	4824.8	32.6
0°-60°	8222.2	55.6
0°-90°	10233.3	69.1
90°-120°	972.0	6.6
90°-150°	3302.3	22.3
90°-180°	4567.0	30.9
0°-180°	14800.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4020	4020	4020	4020	4020	
5°	4020	4005	3962	3993	3986	382
15°	3827	3804	3754	3769	3750	1078
25°	3464	3433	3367	3375	3367	1594
35°	2988	2950	2888	2864	2845	1866
45°	2432	2405	2346	2304	2289	1877
55°	1840	1817	1771	1724	1705	1645
65°	1241	1218	1179	1144	1125	1227
75°	649	642	622	599	607	693
85°	158	155	151	139	135	177
90°	2	18	48	45	47	14
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4020.3	4020.3	4020.3	4020.3	4020.3
2.5°	4043.6	4024.3	3981.7	4020.3	4012.9
5°	4020.3	4005.0	3962.4	3993.1	3985.7
7.5°	3993.1	3970.1	3927.5	3958.7	3950.9
10°	3950.9	3923.8	3877.5	3908.2	3896.8
12.5°	3892.7	3869.7	3823.3	3842.6	3834.8
15°	3827.0	3804.1	3753.6	3769.2	3749.9
17.5°	3745.9	3722.9	3672.4	3691.7	3672.4
20°	3656.8	3633.8	3579.8	3591.2	3576.1
22.5°	3568.2	3533.4	3482.9	3482.9	3475.2
25°	3463.6	3432.9	3367.3	3374.7	3367.3
27.5°	3347.6	3320.5	3270.5	3259.0	3239.8
30°	3231.9	3200.8	3142.9	3131.4	3115.9
32.5°	3108.0	3085.1	3023.1	2999.8	2984.2
35°	2988.3	2949.8	2887.8	2864.5	2845.2
37.5°	2852.9	2818.1	2756.1	2729.1	2709.8
40°	2714.0	2682.8	2620.8	2586.4	2570.8
42.5°	2578.6	2547.4	2485.9	2447.0	2424.0
45°	2431.7	2404.7	2346.4	2304.2	2288.6
47.5°	2288.6	2261.5	2199.6	2157.0	2134.0
50°	2137.7	2118.4	2064.2	2010.1	1990.8
52.5°	1990.8	1963.8	1913.7	1871.0	1844.0
55°	1840.3	1817.0	1770.6	1724.2	1704.9
57.5°	1689.4	1670.1	1619.6	1573.3	1557.7
60°	1538.4	1523.3	1469.1	1426.5	1415.0
62.5°	1391.6	1364.5	1326.0	1287.5	1271.9
65°	1241.1	1217.7	1179.1	1144.3	1125.1
67.5°	1086.5	1066.8	1032.3	1005.3	989.7
70°	943.3	927.7	892.9	865.8	850.7
72.5°	796.5	780.9	761.6	734.6	723.1
75°	649.3	641.9	622.2	599.3	607.0
77.5°	518.0	502.4	494.6	483.1	471.7
80°	386.8	382.6	374.9	363.4	355.6
82.5°	262.9	262.9	259.2	243.7	243.7
85°	158.3	154.6	150.9	139.1	135.3
87.5°	69.7	61.9	54.2	42.6	38.6
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P920276

CATALOG NUMBER: DFN2DIP-SQ3F0-120D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.15	15.21	14.92	16.01	16.98	13.70	14.77	14.48	15.56	16.53
	3H	15.82	16.77	16.60	17.58	18.58	15.33	16.28	16.11	17.09	18.09
	4H	16.41	17.31	17.22	18.13	19.14	15.92	16.82	16.72	17.63	18.64
	6H	16.82	17.65	17.64	18.47	19.50	16.32	17.15	17.14	17.97	19.00
	8H	16.93	17.72	17.75	18.56	19.59	16.43	17.22	17.25	18.06	19.09
	12H	16.98	17.74	17.81	18.57	19.62	16.47	17.23	17.30	18.06	19.11
4H	2H	14.63	15.53	15.44	16.35	17.36	14.27	15.18	15.08	15.99	17.00
	3H	16.51	17.26	17.33	18.11	19.14	16.10	16.85	16.92	17.70	18.73
	4H	17.23	17.91	18.06	18.76	19.81	16.80	17.49	17.64	18.33	19.39
	6H	17.75	18.34	18.60	19.21	20.27	17.32	17.91	18.17	18.78	19.84
	8H	17.90	18.46	18.75	19.32	20.39	17.46	18.02	18.32	18.88	19.96
	12H	17.98	18.48	18.85	19.37	20.44	17.53	18.03	18.41	18.92	19.99
8H	4H	17.43	17.99	18.29	18.86	19.93	17.06	17.61	17.91	18.48	19.55
	6H	18.07	18.53	18.95	19.44	20.51	17.68	18.14	18.57	19.05	20.12
	8H	18.29	18.70	19.18	19.60	20.69	17.89	18.30	18.79	19.20	20.29
	12H	18.43	18.79	19.32	19.68	20.82	18.01	18.37	18.91	19.27	20.41
12H	4H	17.43	17.93	18.30	18.82	19.89	17.06	17.56	17.93	18.45	19.52
	6H	18.10	18.51	18.99	19.41	20.50	17.73	18.13	18.62	19.04	20.12
	8H	18.35	18.71	19.24	19.60	20.74	17.97	18.33	18.86	19.22	20.36

END OF REPORT