

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922719

Luminaire Tested: DFN2DIP-SQ3F0-040D060US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922719
REPORT IS A COMBINATION OF REPORTS P901418 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-040D060US940-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8328.5 lumens
Efficiency: N/A
Efficacy: 107.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 77.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLLONL

Luminous Intensity Polar Plot

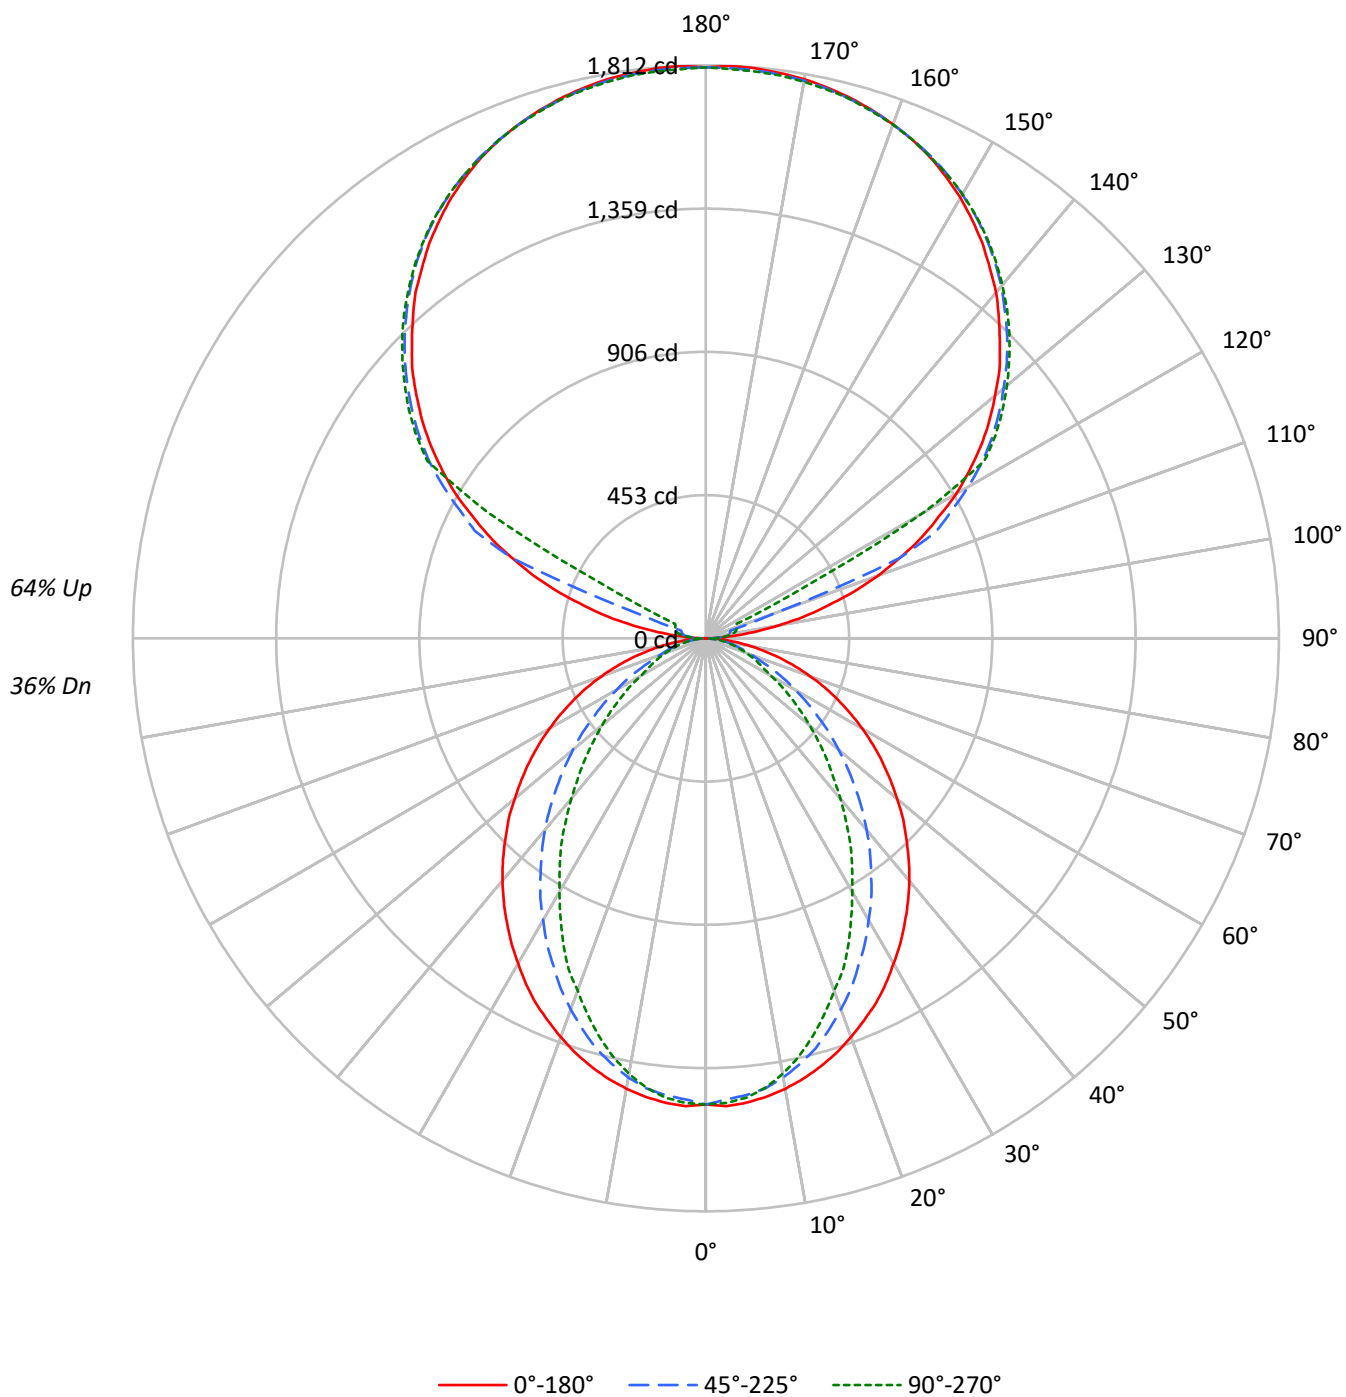

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1689	1689	1689
5°	1691	1661	1672
10°	1673	1627	1617
15°	1649	1573	1533
20°	1617	1497	1429
25°	1585	1413	1329
30°	1542	1327	1202
35°	1500	1235	1091
40°	1457	1139	963
45°	1407	1033	848
50°	1355	926	735
55°	1301	812	626
60°	1239	693	515
65°	1166	573	463
70°	1079	460	418
75°	968	403	379
80°	809	334	327
85°	549	218	242

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1407 cd/sqm

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.2	1.7
10°-20°	379.3	4.6
20°-30°	532.5	6.4
30°-40°	580.5	7.0
40°-50°	533.5	6.4
50°-60°	419.0	5.0
60°-70°	272.7	3.3
70°-80°	140.4	1.7
80°-90°	39.0	0.5
90°-100°	59.5	0.7
100°-110°	222.0	2.7
110°-120°	588.7	7.1
120°-130°	976.3	11.7
130°-140°	1037.1	12.5
140°-150°	963.9	11.6
150°-160°	774.9	9.3
160°-170°	499.3	6.0
170°-180°	171.9	2.1
0°-30°	1049.9	12.6
0°-40°	1630.4	19.6
0°-60°	2582.9	31.0
0°-90°	3035.0	36.4
90°-120°	870.2	10.4
90°-150°	3847.4	46.2
90°-180°	5294.0	63.6
0°-180°	8328.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1474	1474	1474	1474	1474	
5°	1474	1468	1450	1462	1458	140
15°	1402	1387	1342	1317	1304	395
25°	1273	1230	1142	1087	1067	585
35°	1097	1029	911	827	798	686
45°	896	807	667	572	540	692
55°	682	578	434	354	328	609
65°	460	352	232	187	183	456
75°	245	152	107	97	96	260
85°	57	29	25	25	25	66
90°	1	16	26	33	35	8
95°	85	42	51	58	56	101
105°	397	436	80	94	99	424
115°	751	774	806	201	107	740
125°	1062	1079	1104	1113	1117	947
135°	1314	1335	1347	1360	1358	1015
145°	1525	1523	1546	1555	1548	954
155°	1679	1667	1683	1691	1680	774
165°	1769	1761	1765	1774	1765	500
175°	1810	1800	1803	1812	1799	172
180°	1806	1806	1806	1806	1806	

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1474.2	1474.2	1474.2	1474.2	1474.2
2.5°	1480.9	1474.2	1459.5	1472.9	1470.2
5°	1474.2	1467.5	1450.1	1462.1	1458.2
7.5°	1462.1	1454.2	1435.6	1440.7	1434.1
10°	1446.2	1436.8	1410.2	1406.0	1398.2
12.5°	1426.2	1414.2	1378.0	1370.1	1355.4
15°	1402.1	1387.4	1342.1	1316.8	1303.5
17.5°	1374.1	1352.7	1296.6	1267.4	1246.0
20°	1342.1	1315.4	1248.7	1215.4	1186.0
22.5°	1307.4	1276.8	1199.3	1154.0	1134.1
25°	1272.7	1230.0	1141.9	1087.4	1067.2
27.5°	1231.5	1186.0	1088.6	1025.9	995.1
30°	1187.4	1136.6	1029.8	961.9	925.9
32.5°	1144.7	1083.2	973.9	893.9	860.4
35°	1096.7	1028.6	911.2	827.2	797.7
37.5°	1050.0	976.5	852.5	760.4	727.1
40°	1000.6	920.6	791.1	696.4	661.7
42.5°	949.8	864.5	729.8	631.0	597.7
45°	896.5	807.1	667.1	572.3	540.3
47.5°	845.9	751.2	607.1	512.3	483.0
50°	789.8	695.1	548.3	456.2	428.3
52.5°	735.0	635.0	492.3	404.2	378.9
55°	681.7	577.6	433.5	353.6	328.2
57.5°	627.1	520.3	381.6	306.8	285.5
60°	571.0	464.2	326.8	258.9	237.6
62.5°	516.4	409.7	280.1	216.2	205.5
65°	460.3	352.1	232.1	186.8	182.7
67.5°	407.0	298.8	186.8	164.1	160.1
70°	350.9	246.8	154.7	141.4	136.0
72.5°	297.6	198.8	129.4	118.8	116.1
75°	245.4	152.0	106.7	97.4	96.1
77.5°	193.5	108.0	84.1	78.7	76.0
80°	145.3	77.4	63.9	58.8	58.8
82.5°	101.4	52.1	44.1	41.3	41.3
85°	57.3	29.3	25.3	25.3	25.3
87.5°	21.4	10.6	10.6	9.4	9.4
90°	1.2	15.7	26.0	32.7	35.2
92.5°	32.7	27.5	31.3	34.0	35.2
95°	84.9	41.7	50.9	57.6	56.2
97.5°	152.8	45.7	66.5	70.6	71.9
100°	231.3	52.3	74.5	84.9	87.5
102.5°	317.4	315.0	77.1	91.4	95.4
105°	397.2	436.4	79.7	94.0	99.3
107.5°	490.0	522.5	82.4	96.7	101.9
110°	578.9	606.2	228.7	98.1	103.2

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	662.5	685.9	663.7	100.5	104.6
115°	751.3	773.5	806.2	201.3	107.2
117.5°	828.3	854.4	876.7	689.8	347.5
120°	914.6	934.2	957.8	973.4	797.0
122.5°	987.7	1008.6	1034.8	1042.6	1044.0
125°	1062.2	1079.2	1104.0	1113.2	1117.0
127.5°	1130.2	1148.4	1168.1	1181.2	1182.4
130°	1194.2	1215.1	1229.4	1243.8	1242.6
132.5°	1259.5	1276.6	1290.8	1302.6	1301.4
135°	1314.5	1335.4	1347.0	1360.2	1357.5
137.5°	1371.8	1387.5	1400.7	1413.7	1409.9
140°	1428.0	1438.6	1452.9	1464.6	1458.1
142.5°	1475.2	1484.3	1501.3	1511.6	1505.1
145°	1524.8	1523.4	1545.6	1554.8	1548.3
147.5°	1567.8	1563.9	1586.1	1592.6	1587.5
150°	1609.7	1600.5	1621.5	1629.2	1622.7
152.5°	1644.9	1634.5	1654.0	1662.0	1652.8
155°	1678.9	1667.2	1682.9	1690.7	1680.2
157.5°	1706.4	1695.9	1707.7	1716.9	1706.4
160°	1729.9	1722.0	1729.9	1737.7	1728.6
162.5°	1750.7	1742.9	1749.4	1758.6	1746.9
165°	1769.1	1761.3	1765.1	1774.3	1765.1
167.5°	1783.4	1775.6	1779.6	1788.8	1776.9
170°	1795.3	1787.3	1790.0	1799.1	1787.3
172.5°	1803.0	1795.3	1797.9	1807.1	1795.3
175°	1809.5	1800.4	1803.0	1812.1	1799.1
177.5°	1812.1	1803.0	1804.4	1813.6	1801.8
180°	1805.6	1805.6	1805.6	1805.6	1805.6

TEST NUMBER: P922719

CATALOG NUMBER: DFN2DIP-SQ3F0-040D060US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.52	8.25	8.59	9.32	10.77	3.48	4.21	4.55	5.28	6.73
	3H	9.18	9.84	10.27	10.92	12.39	4.65	5.31	5.73	6.38	7.86
	4H	9.79	10.40	10.88	11.48	12.96	5.10	5.71	6.19	6.79	8.27
	6H	10.20	10.77	11.30	11.85	13.34	5.41	5.98	6.51	7.06	8.55
	8H	10.32	10.86	11.42	11.96	13.44	5.49	6.03	6.59	7.13	8.61
	12H	10.38	10.89	11.48	11.98	13.49	5.53	6.04	6.64	7.13	8.64
4H	2H	7.52	8.14	8.62	9.22	10.70	4.06	4.68	5.16	5.76	7.24
	3H	9.34	9.85	10.44	10.96	12.45	5.39	5.91	6.50	7.02	8.51
	4H	10.02	10.50	11.13	11.59	13.10	5.93	6.41	7.04	7.50	9.01
	6H	10.53	10.93	11.64	12.05	13.56	6.34	6.74	7.46	7.86	9.37
	8H	10.70	11.08	11.81	12.19	13.71	6.46	6.84	7.58	7.95	9.47
	12H	10.79	11.13	11.92	12.25	13.78	6.52	6.86	7.65	7.98	9.51
8H	4H	9.98	10.36	11.10	11.47	12.99	6.20	6.58	7.32	7.69	9.21
	6H	10.54	10.85	11.68	12.00	13.52	6.71	7.02	7.85	8.17	9.69
	8H	10.75	11.02	11.90	12.16	13.70	6.90	7.17	8.04	8.30	9.84
	12H	10.88	11.12	12.03	12.25	13.83	7.00	7.24	8.15	8.37	9.95
12H	4H	9.93	10.27	11.06	11.39	12.92	6.20	6.54	7.34	7.67	9.19
	6H	10.51	10.79	11.66	11.92	13.46	6.76	7.03	7.90	8.16	9.70
	8H	10.73	10.97	11.87	12.10	13.67	6.96	7.20	8.10	8.33	9.90

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8