

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922754

Luminaire Tested: DFN2DIP-SQ3F0-050D060US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922754
REPORT IS A COMBINATION OF REPORTS P899900 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D060US940-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8524.8 lumens
Efficiency: N/A
Efficacy: 97.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 87.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLLFLL

Luminous Intensity Polar Plot

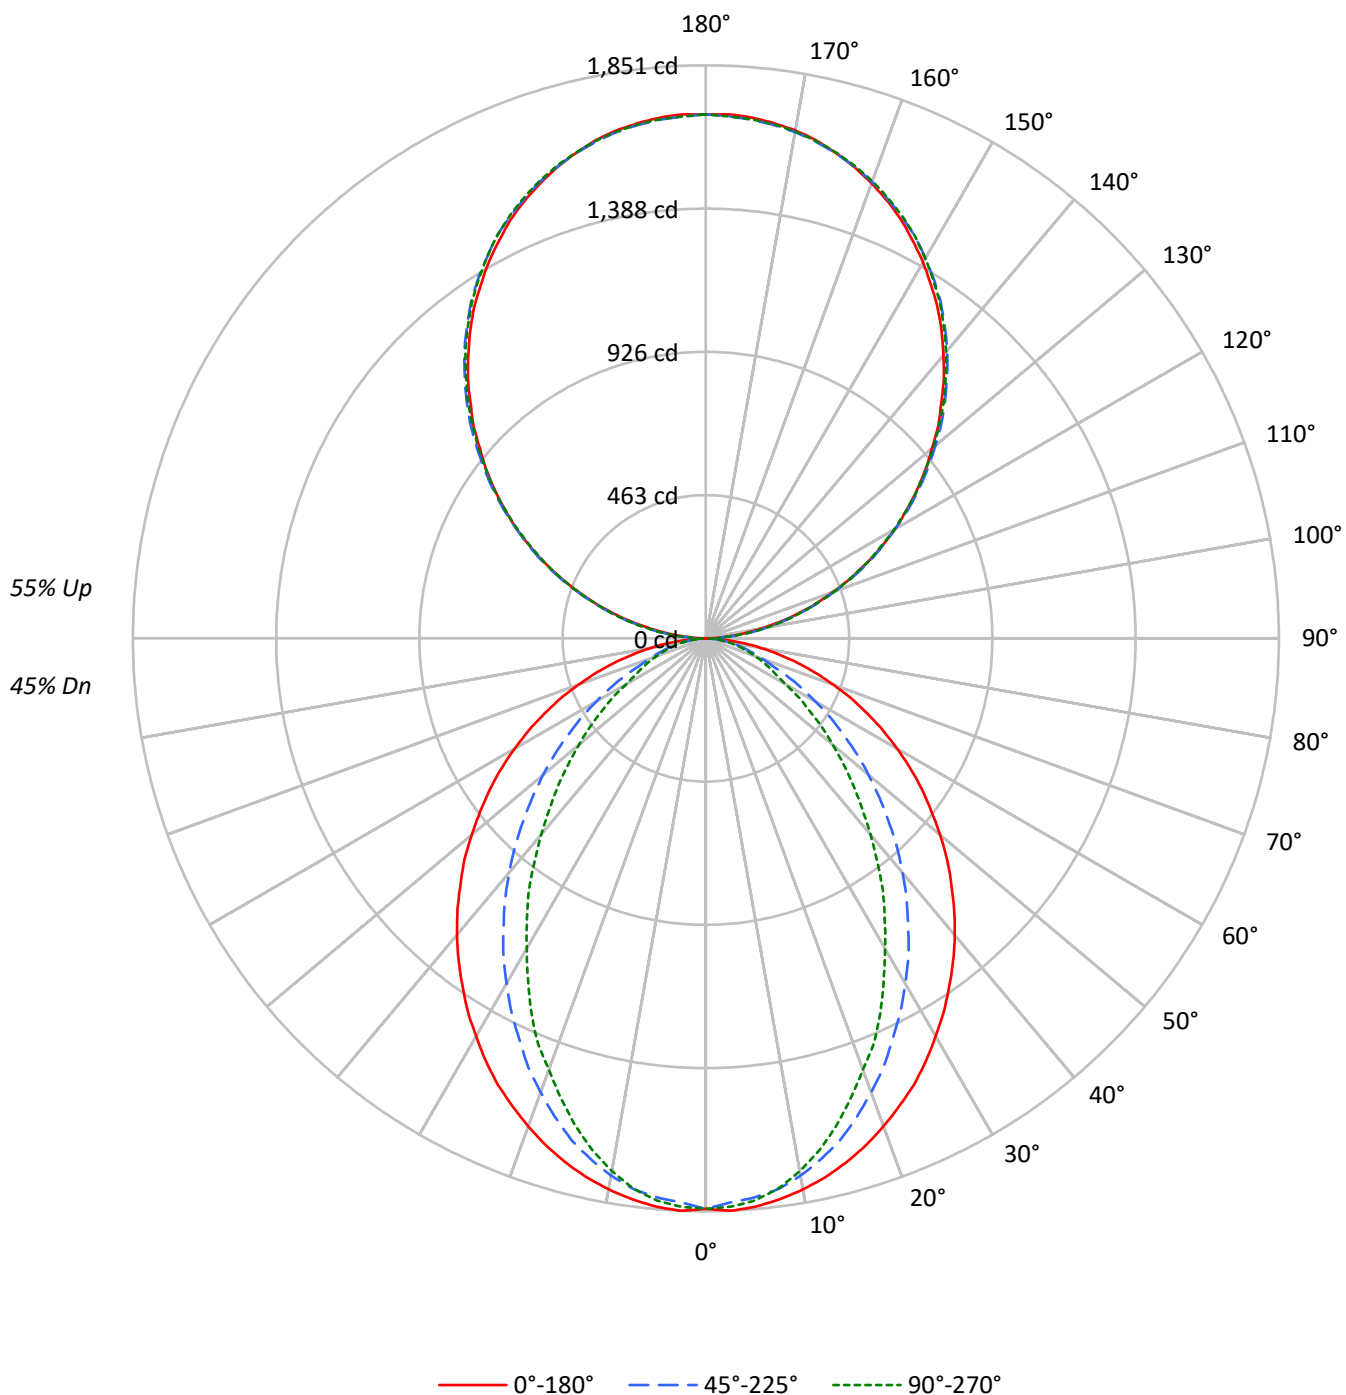

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51			45
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44			38
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38			33
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33			28
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28			25
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25			22
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22			19
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20			17
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18			16
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16			14
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2111	2111	2111
5°	2113	2077	2090
10°	2091	2034	2022
15°	2061	1966	1916
20°	2022	1872	1786
25°	1981	1767	1661
30°	1928	1659	1503
35°	1875	1543	1364
40°	1821	1424	1204
45°	1759	1292	1060
50°	1694	1158	919
55°	1626	1016	783
60°	1548	867	644
65°	1458	716	579
70°	1348	575	523
75°	1211	504	474
80°	1012	418	409
85°	687	273	304

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1759 cd/sqm

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	2.0
10°-20°	474.1	5.6
20°-30°	665.6	7.8
30°-40°	725.6	8.5
40°-50°	666.9	7.8
50°-60°	523.7	6.1
60°-70°	340.9	4.0
70°-80°	175.5	2.1
80°-90°	49.6	0.6
90°-100°	104.7	1.2
100°-110°	332.7	3.9
110°-120°	569.3	6.7
120°-130°	748.8	8.8
130°-140°	840.5	9.9
140°-150°	824.2	9.7
150°-160°	691.4	8.1
160°-170°	458.5	5.4
170°-180°	160.3	1.9
0°-30°	1312.4	15.4
0°-40°	2038.0	23.9
0°-60°	3228.6	37.9
0°-90°	3794.6	44.5
90°-120°	1006.7	11.8
90°-150°	3420.1	40.1
90°-180°	4730.0	55.5
0°-180°	8524.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	2	18	50	47	48	8
95°	74	89	91	91	89	83
105°	307	311	314	317	317	324
115°	571	580	577	575	571	565
125°	831	844	840	835	834	743
135°	1075	1091	1094	1092	1088	831
145°	1305	1315	1323	1325	1319	815
155°	1492	1496	1501	1508	1503	687
165°	1623	1622	1622	1632	1625	458
175°	1689	1685	1682	1692	1683	160
180°	1692	1692	1692	1692	1692	

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	1.5	18.4	50.0	46.9	48.4
92.5°	31.7	42.9	44.4	45.9	45.9
95°	74.5	88.7	91.3	91.3	88.7
97.5°	123.9	137.2	142.9	142.9	142.9
100°	181.1	192.8	196.9	196.9	195.4
102.5°	241.3	249.9	255.6	257.1	255.6
105°	307.1	311.2	314.2	316.8	316.8
107.5°	372.4	378.5	378.5	379.5	372.4
110°	435.7	443.8	443.8	443.8	439.7

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.0	512.6	511.1	507.0	504.0
115°	571.3	579.5	576.9	575.4	571.3
117.5°	638.2	649.4	642.2	638.2	634.1
120°	705.5	716.8	705.5	705.5	700.9
122.5°	766.7	781.0	773.8	769.8	766.7
125°	831.0	843.7	839.6	835.1	833.6
127.5°	893.8	909.5	903.9	897.9	893.8
130°	952.4	970.8	968.2	965.2	959.6
132.5°	1018.2	1032.5	1033.5	1026.4	1022.3
135°	1074.9	1090.7	1093.7	1092.2	1088.1
137.5°	1138.1	1150.8	1153.4	1152.4	1146.3
140°	1193.7	1206.5	1213.6	1213.6	1208.0
142.5°	1250.8	1263.6	1267.7	1269.2	1263.6
145°	1304.9	1315.1	1323.3	1324.8	1319.2
147.5°	1353.3	1366.1	1372.3	1374.7	1369.1
150°	1403.4	1412.0	1417.6	1422.2	1417.6
152.5°	1447.7	1456.4	1463.6	1469.2	1463.6
155°	1492.1	1496.2	1500.7	1508.0	1503.3
157.5°	1530.4	1533.5	1536.0	1546.2	1539.1
160°	1564.6	1567.6	1569.1	1577.8	1571.7
162.5°	1596.2	1596.2	1597.7	1607.4	1600.3
165°	1623.2	1621.7	1621.7	1631.9	1624.8
167.5°	1647.7	1643.2	1643.2	1653.3	1646.2
170°	1666.1	1662.0	1660.5	1670.6	1662.0
172.5°	1678.8	1674.7	1673.2	1683.4	1674.7
175°	1689.0	1685.0	1681.9	1692.1	1683.4
177.5°	1694.6	1690.6	1687.5	1696.1	1687.5
180°	1692.1	1692.1	1692.1	1692.1	1692.1

TEST NUMBER: P922754

CATALOG NUMBER: DFN2DIP-SQ3F0-050D060US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.17	9.96	10.18	10.97	12.32	5.13	5.92	6.14	6.94	8.29
	3H	10.84	11.55	11.86	12.57	13.94	6.31	7.02	7.33	8.04	9.41
	4H	11.45	12.11	12.48	13.14	14.52	6.76	7.42	7.79	8.45	9.83
	6H	11.86	12.47	12.90	13.51	14.90	7.07	7.68	8.11	8.71	10.10
	8H	11.98	12.57	13.03	13.61	15.00	7.16	7.74	8.20	8.78	10.17
	12H	12.04	12.60	13.09	13.64	15.05	7.19	7.75	8.25	8.79	10.20
4H	2H	9.18	9.85	10.22	10.88	12.25	5.72	6.39	6.76	7.41	8.79
	3H	11.00	11.56	12.05	12.61	14.00	7.06	7.61	8.11	8.67	10.06
	4H	11.69	12.20	12.74	13.24	14.66	7.60	8.11	8.65	9.15	10.57
	6H	12.20	12.63	13.26	13.70	15.11	8.01	8.45	9.07	9.52	10.92
	8H	12.37	12.78	13.43	13.84	15.26	8.13	8.54	9.20	9.60	11.03
	12H	12.46	12.83	13.54	13.90	15.33	8.19	8.56	9.27	9.64	11.07
8H	4H	11.65	12.06	12.72	13.12	14.55	7.88	8.28	8.94	9.34	10.77
	6H	12.21	12.55	13.30	13.65	15.07	8.38	8.72	9.47	9.82	11.24
	8H	12.43	12.72	13.52	13.81	15.25	8.57	8.86	9.66	9.95	11.39
	12H	12.56	12.82	13.65	13.90	15.38	8.68	8.94	9.78	10.02	11.50
12H	4H	11.60	11.97	12.68	13.05	14.47	7.88	8.24	8.96	9.32	10.75
	6H	12.19	12.48	13.28	13.57	15.01	8.43	8.73	9.52	9.81	11.25
	8H	12.40	12.66	13.50	13.74	15.22	8.63	8.89	9.73	9.97	11.46

END OF REPORT