

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922765

Luminaire Tested: DFN2DIP-SQ3F0-050D090US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922765
REPORT IS A COMBINATION OF REPORTS P901473 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D090US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12359.1 lumens
Efficiency: N/A
Efficacy: 111.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 110.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLLONL

Luminous Intensity Polar Plot

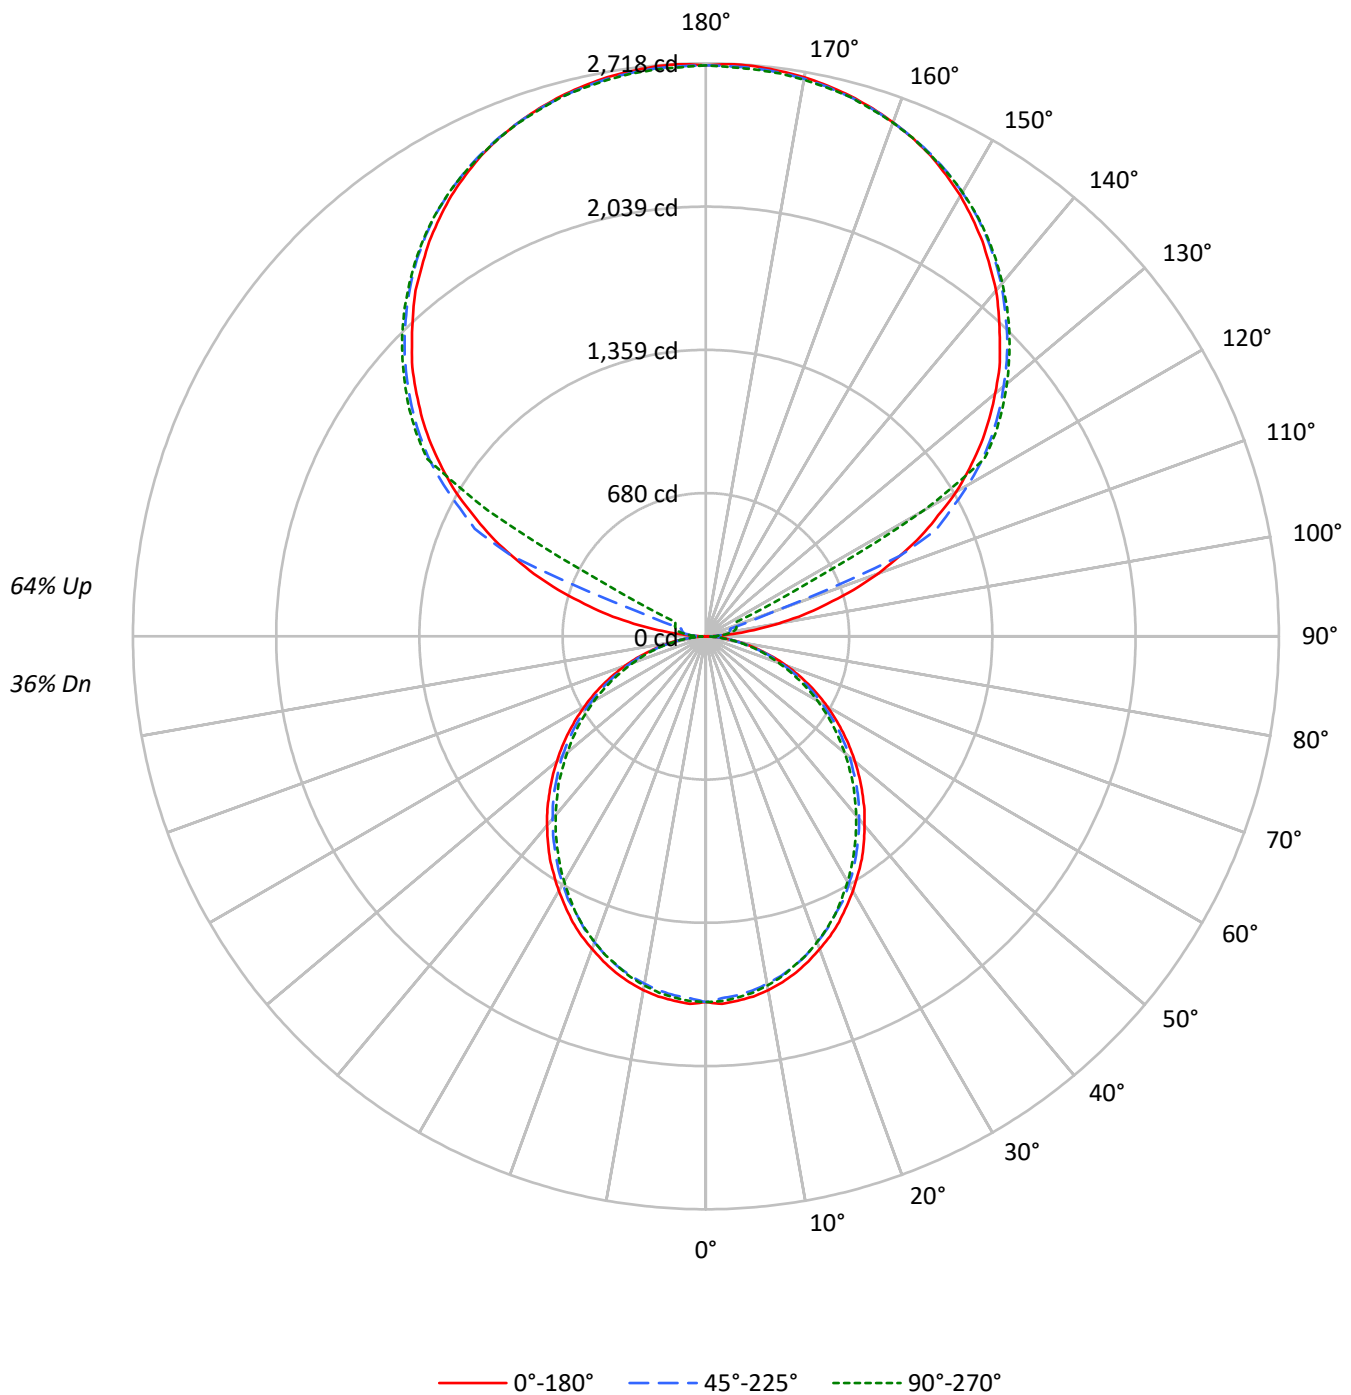

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	51	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	33	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	26	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	21	19
6	61	49	41	35	55	44	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1988	1988	1988
5°	1990	1959	1973
10°	1972	1931	1945
15°	1942	1898	1903
20°	1902	1853	1860
25°	1861	1798	1809
30°	1811	1748	1746
35°	1763	1689	1679
40°	1705	1629	1615
45°	1647	1568	1550
50°	1583	1505	1474
55°	1516	1432	1404
60°	1440	1345	1324
65°	1357	1255	1230
70°	1252	1146	1129
75°	1106	1014	1034
80°	929	846	855
85°	654	560	559

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1854 cd/sqm

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	1.3
10°-20°	459.4	3.7
20°-30°	675.2	5.5
30°-40°	784.2	6.3
40°-50°	783.2	6.3
50°-60°	682.9	5.5
60°-70°	504.8	4.1
70°-80°	285.6	2.3
80°-90°	80.1	0.6
90°-100°	89.3	0.7
100°-110°	332.9	2.7
110°-120°	883.0	7.1
120°-130°	1464.5	11.8
130°-140°	1555.6	12.6
140°-150°	1445.8	11.7
150°-160°	1162.4	9.4
160°-170°	749.0	6.1
170°-180°	257.8	2.1
0°-30°	1297.9	10.5
0°-40°	2082.0	16.8
0°-60°	3548.1	28.7
0°-90°	4418.8	35.8
90°-120°	1305.2	10.6
90°-150°	5771.2	46.7
90°-180°	7940.0	64.2
0°-180°	12359.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	2	24	39	49	53	11
95°	127	63	76	86	84	151
105°	596	655	120	141	149	637
115°	1127	1160	1209	302	161	1109
125°	1593	1619	1656	1670	1676	1421
135°	1972	2003	2020	2040	2036	1523
145°	2287	2285	2318	2332	2322	1431
155°	2518	2501	2524	2536	2520	1161
165°	2654	2642	2648	2662	2648	750
175°	2714	2700	2705	2718	2699	258
180°	2708	2708	2708	2708	2708	

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.9	23.5	39.1	49.1	52.8
92.5°	49.1	41.2	47.0	51.0	52.8
95°	127.3	62.6	76.3	86.3	84.3
97.5°	229.3	68.7	99.9	105.8	107.7
100°	347.0	78.5	111.7	127.3	131.3
102.5°	476.2	472.4	115.7	137.1	143.1
105°	595.8	654.7	119.6	141.1	148.9
107.5°	734.9	783.8	123.6	145.0	152.9
110°	868.3	909.3	343.0	147.0	154.8

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	993.7	1028.9	995.6	150.8	156.9
115°	1126.9	1160.1	1209.2	301.8	160.8
117.5°	1242.5	1281.7	1315.1	1034.7	521.3
120°	1371.9	1401.2	1436.6	1460.1	1195.5
122.5°	1481.6	1513.0	1552.3	1563.9	1566.0
125°	1593.2	1618.8	1656.1	1669.8	1675.6
127.5°	1695.1	1722.6	1752.2	1771.7	1773.6
130°	1791.3	1822.7	1844.1	1865.7	1863.9
132.5°	1889.3	1914.9	1936.3	1954.0	1952.1
135°	1971.7	2003.0	2020.5	2040.3	2036.4
137.5°	2057.8	2081.3	2101.0	2120.6	2114.8
140°	2142.0	2157.8	2179.3	2196.9	2187.2
142.5°	2212.8	2226.5	2251.8	2267.4	2257.7
145°	2287.2	2285.1	2318.4	2332.2	2322.4
147.5°	2351.7	2345.9	2379.2	2389.0	2381.2
150°	2414.6	2400.8	2432.2	2443.8	2434.1
152.5°	2467.4	2451.8	2481.1	2493.0	2479.2
155°	2518.4	2500.9	2524.3	2536.0	2520.4
157.5°	2559.6	2544.0	2561.6	2575.3	2559.6
160°	2594.9	2583.0	2594.9	2606.6	2592.8
162.5°	2626.1	2614.4	2624.2	2637.9	2620.3
165°	2653.6	2641.9	2647.8	2661.5	2647.8
167.5°	2675.2	2663.4	2669.3	2683.1	2665.4
170°	2692.9	2681.0	2684.9	2698.7	2681.0
172.5°	2704.6	2692.9	2696.8	2710.5	2692.9
175°	2714.3	2700.5	2704.6	2718.2	2698.7
177.5°	2718.2	2704.6	2706.6	2720.3	2702.7
180°	2708.5	2708.5	2708.5	2708.5	2708.5

TEST NUMBER: P922765

CATALOG NUMBER: DFN2DIP-SQ3F0-050D090US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.14	8.89	9.21	9.96	11.42	7.70	8.44	8.77	9.52	10.98
	3H	9.79	10.46	10.87	11.54	13.02	9.30	9.97	10.38	11.05	12.53
	4H	10.37	11.00	11.46	12.09	13.57	9.87	10.51	10.96	11.59	13.08
	6H	10.76	11.34	11.86	12.43	13.93	10.26	10.84	11.36	11.93	13.43
	8H	10.86	11.41	11.96	12.52	14.01	10.36	10.91	11.46	12.01	13.50
	12H	10.90	11.43	12.01	12.52	14.04	10.39	10.92	11.50	12.01	13.53
4H	2H	8.58	9.22	9.68	10.30	11.79	8.23	8.86	9.33	9.95	11.43
	3H	10.44	10.96	11.54	12.07	13.57	10.03	10.56	11.13	11.67	13.16
	4H	11.14	11.63	12.25	12.73	14.24	10.72	11.20	11.83	12.30	13.82
	6H	11.64	12.06	12.76	13.18	14.70	11.21	11.63	12.33	12.75	14.26
	8H	11.79	12.18	12.91	13.29	14.82	11.35	11.74	12.47	12.86	14.38
	12H	11.85	12.21	12.99	13.33	14.87	11.41	11.76	12.54	12.88	14.42
8H	4H	11.32	11.71	12.44	12.83	14.35	10.95	11.34	12.06	12.45	13.98
	6H	11.94	12.27	13.08	13.42	14.95	11.56	11.88	12.70	13.04	14.56
	8H	12.16	12.44	13.30	13.58	15.12	11.77	12.05	12.91	13.19	14.73
	12H	12.28	12.53	13.43	13.66	15.24	11.87	12.12	13.02	13.25	14.83
12H	4H	11.30	11.66	12.44	12.78	14.31	10.93	11.29	12.07	12.41	13.95
	6H	11.97	12.25	13.12	13.39	14.93	11.60	11.88	12.74	13.02	14.56
	8H	12.20	12.45	13.35	13.58	15.16	11.82	12.07	12.97	13.20	14.78