

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922794

Luminaire Tested: DFN2DIP-SQ3F0-060D070US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922794
REPORT IS A COMBINATION OF REPORTS P899920 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D070US940-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10071.9 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLLFLL

Luminous Intensity Polar Plot

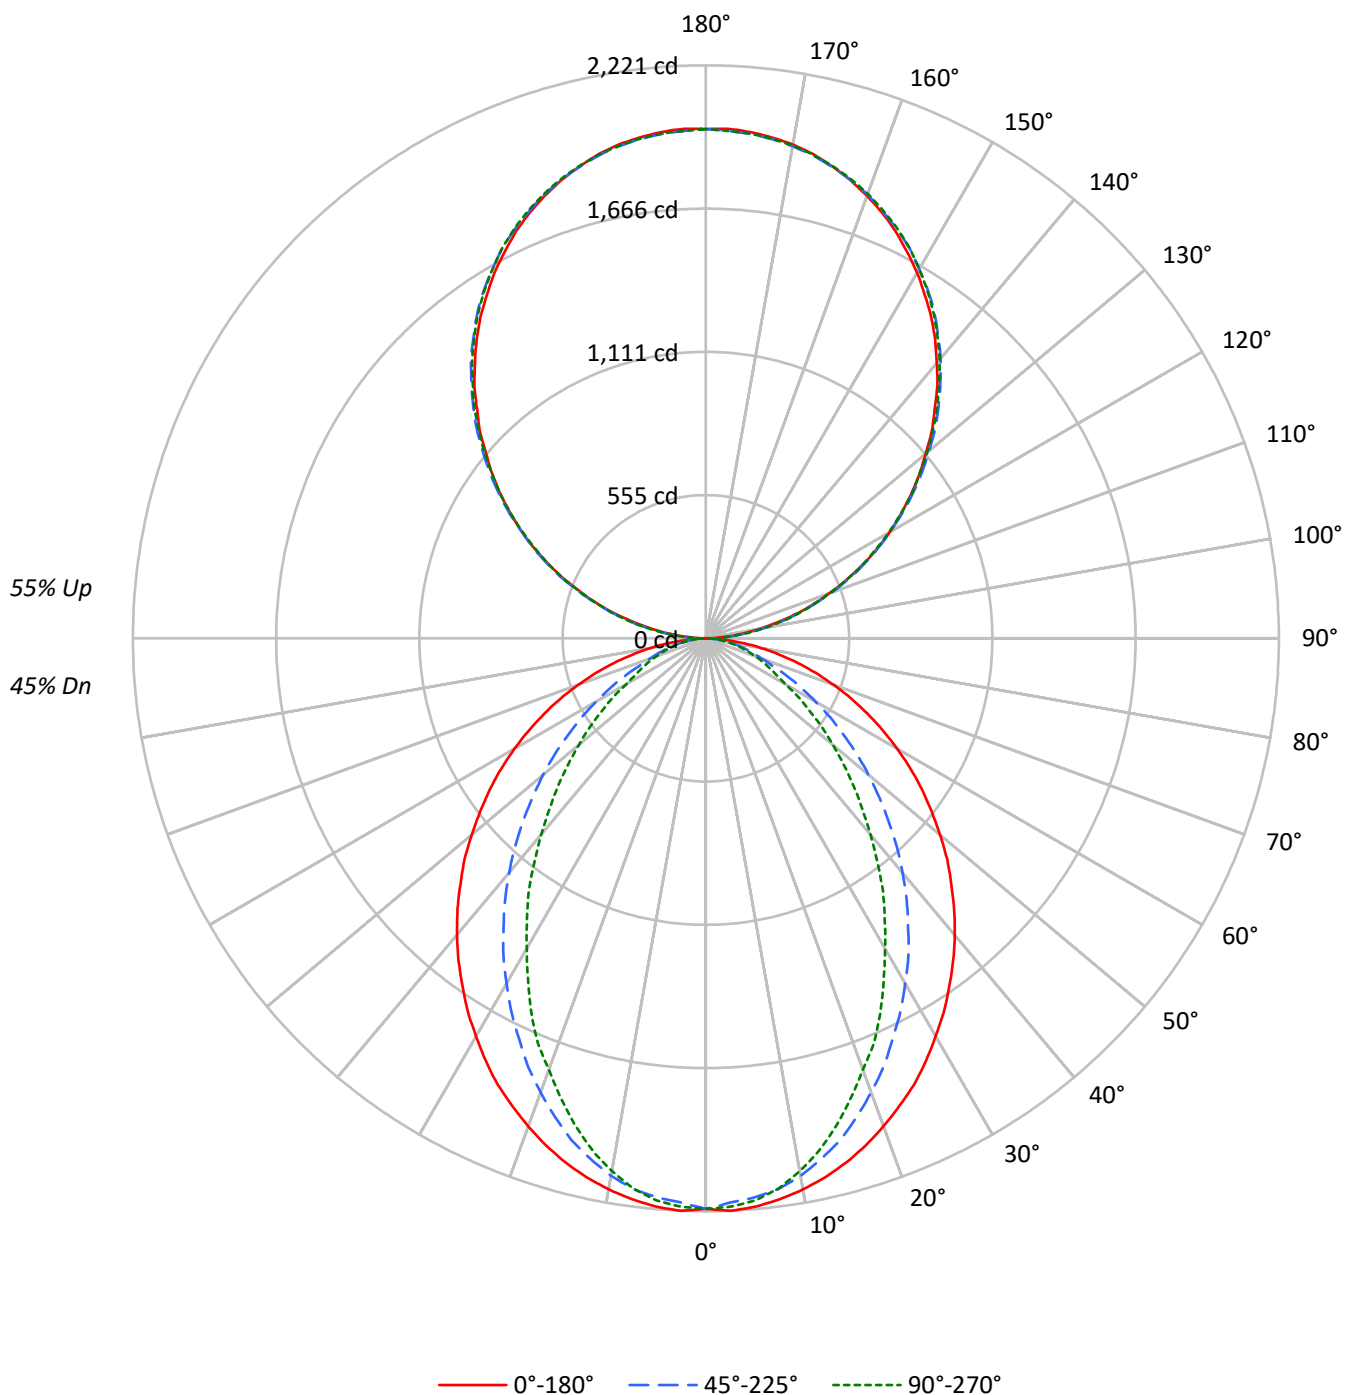

TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	85	82	79	71	69	67	58	57	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	52	49	47	41	40	38
3	81	72	65	60	74	67	60	56	56	51	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	47	50	45	41	41	38	35	33	31	29
5	69	57	50	44	63	53	46	41	45	40	36	37	33	30	30	28	25
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	36	32	37	32	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	19	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2534	2534	2534
5°	2536	2492	2509
10°	2509	2441	2426
15°	2473	2359	2299
20°	2426	2246	2144
25°	2378	2120	1994
30°	2313	1991	1803
35°	2250	1852	1636
40°	2185	1709	1445
45°	2110	1550	1272
50°	2033	1390	1102
55°	1952	1219	940
60°	1858	1040	773
65°	1750	859	695
70°	1618	690	627
75°	1453	605	569
80°	1214	502	491
85°	824	327	364

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2110 cd/sqm

TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.1
10°-20°	568.9	5.6
20°-30°	798.7	7.9
30°-40°	870.7	8.6
40°-50°	800.3	7.9
50°-60°	628.5	6.2
60°-70°	409.1	4.1
70°-80°	210.6	2.1
80°-90°	59.4	0.6
90°-100°	122.2	1.2
100°-110°	388.1	3.9
110°-120°	664.2	6.6
120°-130°	873.6	8.7
130°-140°	980.5	9.7
140°-150°	961.5	9.5
150°-160°	806.6	8.0
160°-170°	534.9	5.3
170°-180°	187.0	1.9
0°-30°	1574.9	15.6
0°-40°	2445.6	24.3
0°-60°	3874.3	38.5
0°-90°	4553.3	45.2
90°-120°	1174.5	11.7
90°-150°	3990.1	39.6
90°-180°	5519.0	54.8
0°-180°	10071.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	2	21	58	55	56	10
95°	87	104	107	107	104	97
105°	358	363	367	370	370	378
115°	667	676	673	671	667	659
125°	970	984	980	974	972	866
135°	1254	1272	1276	1274	1269	969
145°	1522	1534	1544	1546	1539	951
155°	1741	1746	1751	1759	1754	801
165°	1894	1892	1892	1904	1896	534
175°	1970	1966	1962	1974	1964	187
180°	1974	1974	1974	1974	1974	



TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.8	21.4	58.3	54.8	56.5
92.5°	36.9	50.0	51.8	53.6	53.6
95°	86.9	103.5	106.6	106.6	103.5
97.5°	144.6	160.1	166.7	166.7	166.7
100°	211.2	225.0	229.7	229.7	227.9
102.5°	281.5	291.6	298.2	300.0	298.2
105°	358.3	363.0	366.6	369.6	369.6
107.5°	434.4	441.6	441.6	442.8	434.4
110°	508.3	517.8	517.8	517.8	513.0

TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.0	598.2	596.4	591.6	588.0
115°	666.6	676.1	673.2	671.4	666.6
117.5°	744.5	757.6	749.3	744.5	739.8
120°	823.0	836.2	823.0	823.0	817.7
122.5°	894.5	911.1	902.9	898.0	894.5
125°	969.5	984.4	979.6	974.3	972.5
127.5°	1042.7	1061.1	1054.6	1047.5	1042.7
130°	1111.2	1132.6	1129.6	1126.1	1119.5
132.5°	1187.9	1204.6	1205.8	1197.5	1192.7
135°	1254.0	1272.4	1276.0	1274.2	1269.4
137.5°	1327.8	1342.6	1345.6	1344.4	1337.3
140°	1392.7	1407.6	1415.9	1415.9	1409.3
142.5°	1459.3	1474.2	1478.9	1480.7	1474.2
145°	1522.4	1534.3	1543.8	1545.6	1539.1
147.5°	1579.0	1593.8	1601.0	1603.9	1597.4
150°	1637.3	1647.3	1653.9	1659.3	1653.9
152.5°	1689.0	1699.2	1707.4	1714.0	1707.4
155°	1740.8	1745.5	1751.0	1759.3	1753.9
157.5°	1785.5	1789.0	1792.0	1803.9	1795.5
160°	1825.3	1828.9	1830.7	1840.8	1833.6
162.5°	1862.2	1862.2	1864.0	1875.3	1867.0
165°	1893.7	1891.9	1891.9	1903.9	1895.5
167.5°	1922.3	1917.0	1917.0	1928.9	1920.6
170°	1943.8	1939.0	1937.2	1949.1	1939.0
172.5°	1958.6	1953.8	1952.0	1964.0	1953.8
175°	1970.5	1965.8	1962.2	1974.1	1964.0
177.5°	1977.1	1972.3	1968.7	1978.9	1968.7
180°	1974.1	1974.1	1974.1	1974.1	1974.1

TEST NUMBER: P922794

CATALOG NUMBER: DFN2DIP-SQ3F0-060D070US940-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.88	10.67	10.88	11.68	13.02	5.84	6.63	6.84	7.64	8.98
	3H	11.55	12.25	12.56	13.27	14.64	7.02	7.72	8.03	8.74	10.11
	4H	12.15	12.82	13.18	13.84	15.21	7.46	8.13	8.49	9.15	10.52
	6H	12.57	13.18	13.60	14.21	15.59	7.77	8.39	8.81	9.42	10.80
	8H	12.69	13.28	13.73	14.32	15.70	7.86	8.45	8.90	9.49	10.87
	12H	12.75	13.31	13.79	14.34	15.74	7.90	8.46	8.95	9.49	10.89
4H	2H	9.89	10.56	10.92	11.58	12.95	6.43	7.10	7.46	8.12	9.49
	3H	11.71	12.27	12.75	13.32	14.70	7.76	8.32	8.81	9.37	10.75
	4H	12.40	12.91	13.44	13.95	15.35	8.31	8.82	9.35	9.86	11.26
	6H	12.90	13.34	13.96	14.41	15.81	8.72	9.15	9.77	10.22	11.62
	8H	13.08	13.48	14.13	14.54	15.96	8.84	9.25	9.90	10.31	11.72
	12H	13.17	13.54	14.24	14.61	16.03	8.90	9.27	9.98	10.34	11.76
8H	4H	12.36	12.77	13.42	13.82	15.24	8.58	8.99	9.64	10.05	11.46
	6H	12.92	13.26	14.00	14.35	15.77	9.09	9.43	10.17	10.53	11.94
	8H	13.13	13.43	14.22	14.51	15.94	9.27	9.57	10.36	10.65	12.09
	12H	13.26	13.53	14.36	14.60	16.08	9.39	9.65	10.48	10.73	12.20
12H	4H	12.31	12.68	13.38	13.75	15.17	8.58	8.95	9.66	10.02	11.44
	6H	12.89	13.19	13.98	14.27	15.70	9.14	9.43	10.22	10.52	11.95
	8H	13.11	13.37	14.20	14.45	15.92	9.34	9.60	10.43	10.68	12.15

END OF REPORT