

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922804

Luminaire Tested: DFN2DIP-SQ3F0-060D100US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922804
REPORT IS A COMBINATION OF REPORTS P899973 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D100US940-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13188.4 lumens
Efficiency: N/A
Efficacy: 100.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFLL

Luminous Intensity Polar Plot

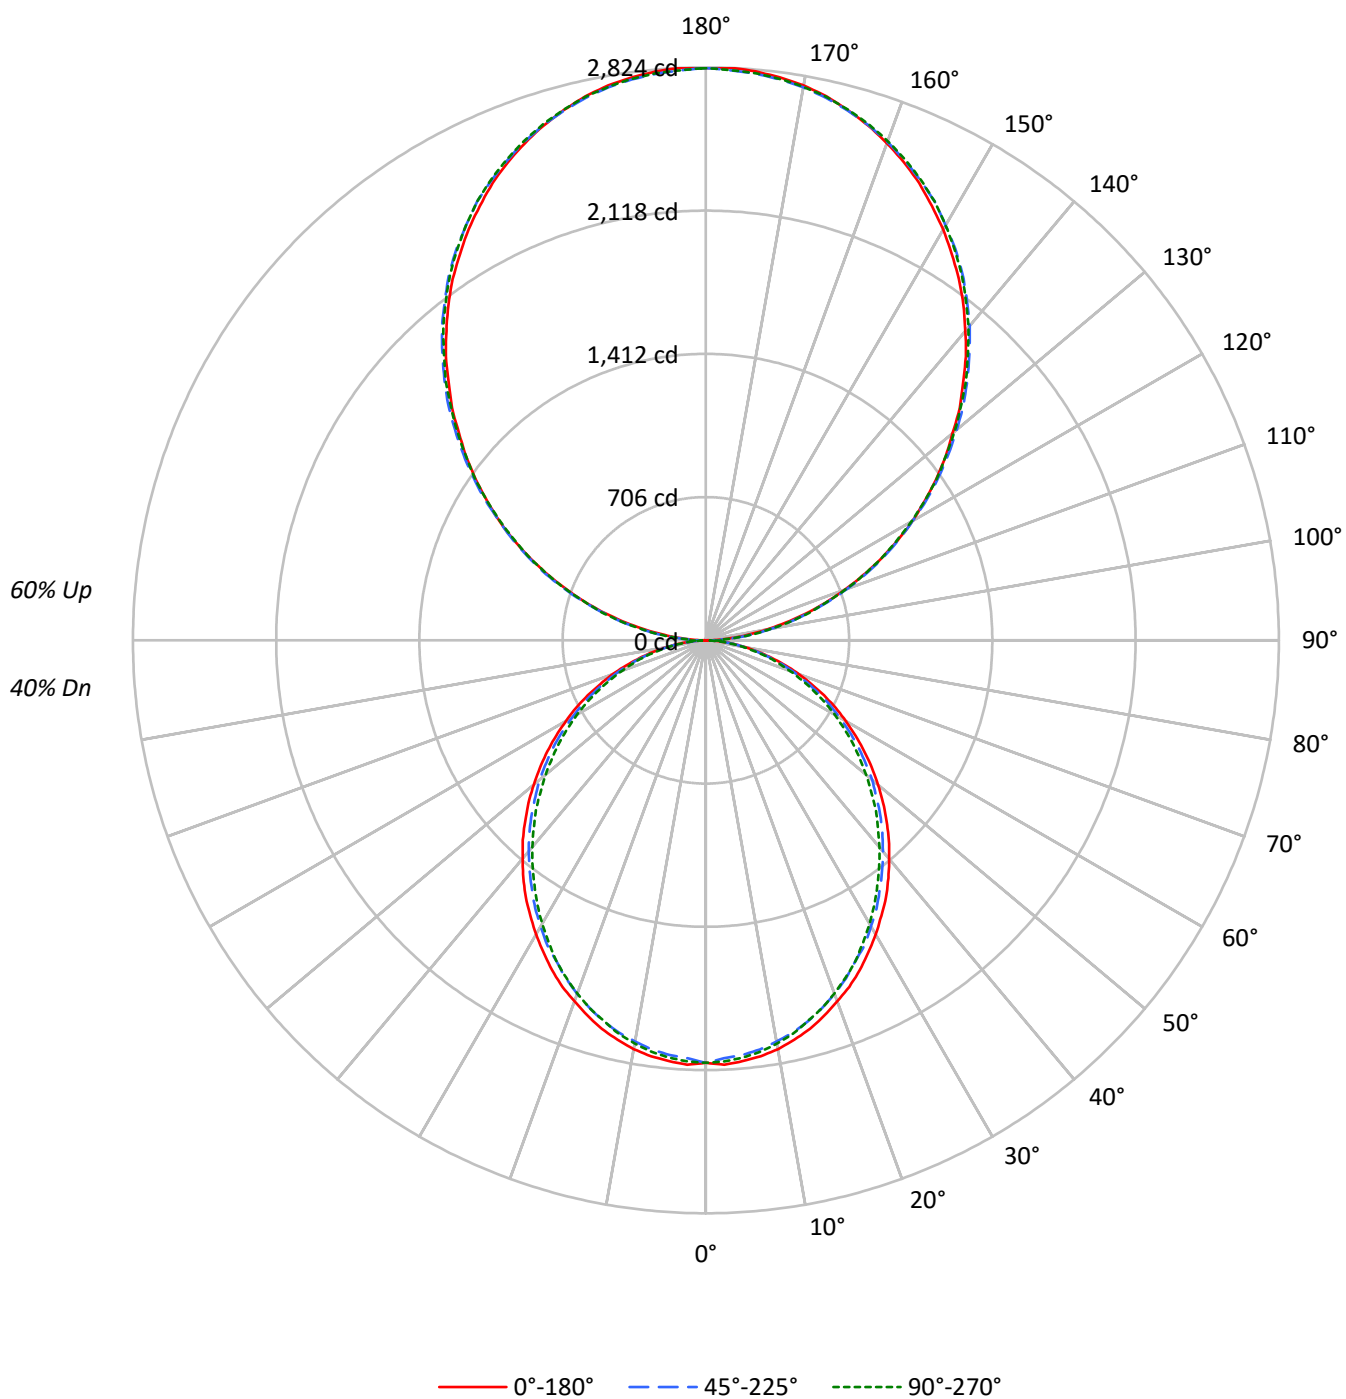

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	42	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	29	27	25
5	67	55	47	41	60	51	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	27	24	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	28	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	16	14
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2385	2385	2385
5°	2388	2350	2367
10°	2367	2317	2334
15°	2330	2278	2284
20°	2282	2223	2231
25°	2234	2158	2171
30°	2173	2097	2095
35°	2116	2026	2015
40°	2046	1954	1938
45°	1976	1882	1860
50°	1899	1806	1769
55°	1819	1718	1685
60°	1728	1614	1589
65°	1629	1506	1476
70°	1502	1375	1354
75°	1327	1217	1240
80°	1115	1015	1025
85°	784	672	671

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2838 cd/sqm

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.5
10°-20°	551.3	4.2
20°-30°	810.2	6.1
30°-40°	941.0	7.1
40°-50°	939.8	7.1
50°-60°	819.5	6.2
60°-70°	605.8	4.6
70°-80°	342.7	2.6
80°-90°	98.5	0.7
90°-100°	174.5	1.3
100°-110°	554.5	4.2
110°-120°	948.9	7.2
120°-130°	1247.9	9.5
130°-140°	1400.8	10.6
140°-150°	1373.6	10.4
150°-160°	1152.3	8.7
160°-170°	764.1	5.8
170°-180°	267.1	2.0
0°-30°	1557.4	11.8
0°-40°	2498.4	18.9
0°-60°	4257.8	32.3
0°-90°	5304.8	40.2
90°-120°	1677.9	12.7
90°-150°	5700.1	43.2
90°-180°	7884.0	59.8
0°-180°	13188.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	3	31	83	78	81	13
95°	124	148	152	152	148	138
105°	512	519	524	528	528	540
115°	952	966	962	959	952	942
125°	1385	1406	1400	1392	1389	1238
135°	1791	1818	1823	1820	1814	1385
145°	2175	2192	2206	2208	2199	1359
155°	2487	2494	2501	2513	2506	1145
165°	2705	2703	2703	2720	2708	763
175°	2815	2808	2803	2820	2806	267
180°	2820	2820	2820	2820	2820	

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	2.6	30.6	83.3	78.2	80.8
92.5°	52.7	71.4	74.0	76.5	76.5
95°	124.1	147.9	152.2	152.2	147.9
97.5°	206.6	228.7	238.1	238.1	238.1
100°	301.8	321.4	328.1	328.1	325.7
102.5°	402.2	416.6	426.0	428.5	426.0
105°	511.8	518.6	523.7	528.0	528.0
107.5°	620.6	630.9	630.9	632.6	620.6
110°	726.1	739.7	739.7	739.7	732.9

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	840.0	854.4	851.9	845.1	840.0
115°	952.3	965.8	961.6	959.0	952.3
117.5°	1063.6	1082.4	1070.4	1063.6	1056.8
120°	1175.8	1194.5	1175.8	1175.8	1168.2
122.5°	1277.8	1301.6	1289.8	1283.0	1277.8
125°	1385.0	1406.2	1399.5	1391.8	1389.3
127.5°	1489.6	1515.9	1506.5	1496.4	1489.6
130°	1587.3	1617.9	1613.7	1608.6	1599.3
132.5°	1697.0	1720.8	1722.5	1710.7	1703.8
135°	1791.4	1817.8	1822.8	1820.3	1813.5
137.5°	1896.8	1918.1	1922.3	1920.7	1910.4
140°	1989.5	2010.7	2022.7	2022.7	2013.3
142.5°	2084.7	2106.0	2112.7	2115.3	2106.0
145°	2174.8	2191.8	2205.5	2208.0	2198.6
147.5°	2255.6	2276.9	2287.1	2291.3	2282.0
150°	2339.0	2353.4	2362.8	2370.3	2362.8
152.5°	2412.9	2427.3	2439.3	2448.6	2439.3
155°	2486.9	2493.7	2501.3	2513.2	2505.5
157.5°	2550.6	2555.7	2560.0	2577.0	2565.1
160°	2607.6	2612.7	2615.2	2629.7	2619.5
162.5°	2660.3	2660.3	2662.8	2679.0	2667.1
165°	2705.4	2702.8	2702.8	2719.8	2707.9
167.5°	2746.2	2738.5	2738.5	2755.6	2743.6
170°	2776.8	2770.0	2767.4	2784.5	2770.0
172.5°	2798.0	2791.2	2788.6	2805.7	2791.2
175°	2815.0	2808.3	2803.2	2820.1	2805.7
177.5°	2824.4	2817.6	2812.5	2826.9	2812.5
180°	2820.1	2820.1	2820.1	2820.1	2820.1

TEST NUMBER: P922804

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.28	10.06	10.32	11.10	12.51	8.84	9.62	9.87	10.66	12.06
	3H	10.93	11.63	11.98	12.68	14.10	10.44	11.14	11.49	12.19	13.61
	4H	11.51	12.17	12.57	13.23	14.66	11.02	11.68	12.07	12.73	14.16
	6H	11.90	12.51	12.97	13.57	15.01	11.40	12.01	12.47	13.07	14.51
	8H	12.00	12.58	13.08	13.66	15.09	11.50	12.08	12.57	13.16	14.59
	12H	12.05	12.60	13.12	13.67	15.13	11.54	12.09	12.61	13.16	14.62
4H	2H	9.73	10.39	10.79	11.44	12.87	9.37	10.03	10.44	11.09	12.52
	3H	11.58	12.13	12.65	13.21	14.66	11.17	11.72	12.24	12.81	14.25
	4H	12.29	12.79	13.37	13.87	15.33	11.86	12.37	12.94	13.44	14.91
	6H	12.79	13.23	13.88	14.32	15.78	12.36	12.80	13.45	13.89	15.35
	8H	12.94	13.35	14.03	14.43	15.91	12.50	12.91	13.59	14.00	15.47
	12H	13.00	13.37	14.11	14.47	15.95	12.56	12.92	13.66	14.03	15.51
8H	4H	12.47	12.88	13.56	13.97	15.44	12.10	12.50	13.18	13.59	15.06
	6H	13.09	13.43	14.20	14.56	16.03	12.71	13.05	13.82	14.18	15.65
	8H	13.31	13.61	14.43	14.72	16.21	12.92	13.21	14.03	14.32	15.82
	12H	13.44	13.69	14.56	14.80	16.33	13.02	13.28	14.14	14.39	15.92
12H	4H	12.45	12.82	13.56	13.92	15.40	12.08	12.45	13.19	13.55	15.03
	6H	13.12	13.42	14.24	14.53	16.02	12.75	13.04	13.87	14.16	15.65
	8H	13.36	13.61	14.48	14.72	16.25	12.97	13.23	14.10	14.34	15.87