

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922805

Luminaire Tested: DFN2DIP-SQ3F0-060D100US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922805
REPORT IS A COMBINATION OF REPORTS P901493 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D100US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14124.8 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLONL

Luminous Intensity Polar Plot

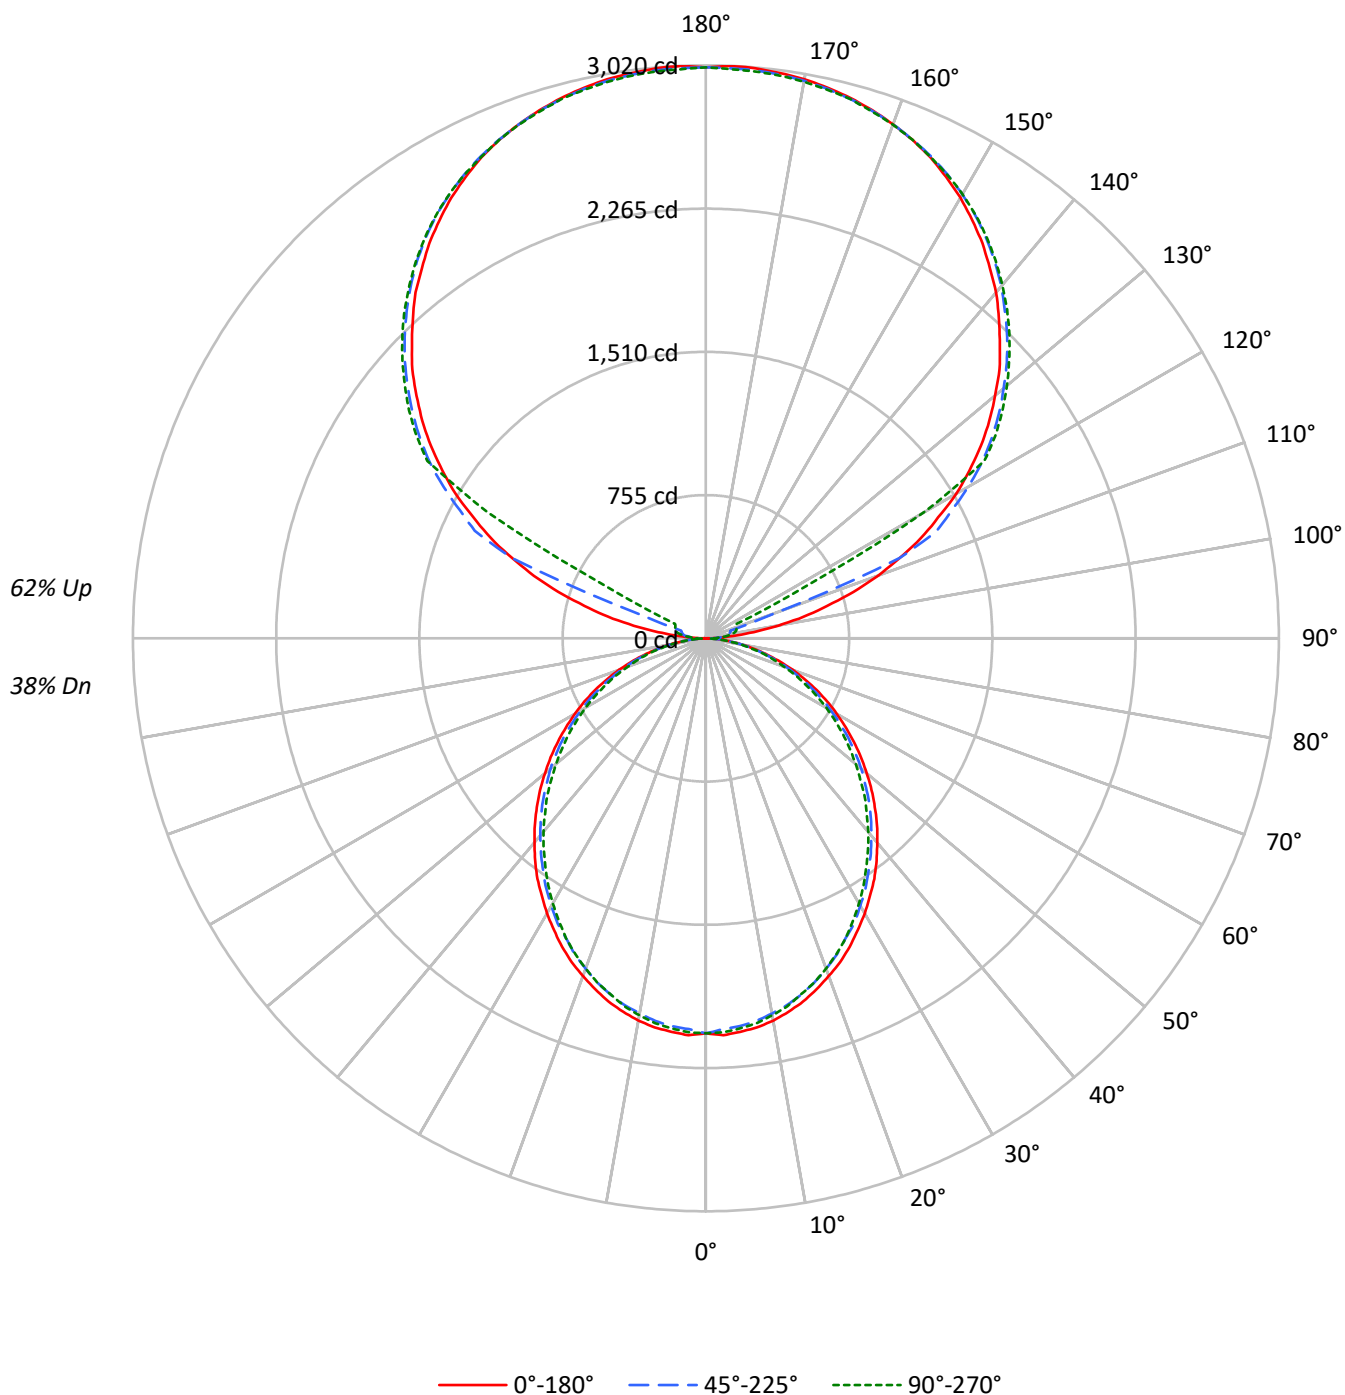

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2385	2385	2385
5°	2388	2350	2367
10°	2367	2317	2334
15°	2330	2278	2284
20°	2282	2223	2231
25°	2234	2158	2171
30°	2173	2097	2095
35°	2116	2026	2015
40°	2046	1954	1938
45°	1976	1882	1860
50°	1899	1806	1769
55°	1819	1718	1685
60°	1728	1614	1589
65°	1629	1506	1476
70°	1502	1375	1354
75°	1327	1217	1240
80°	1115	1015	1025
85°	784	672	671

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2061 cd/sqm

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.4
10°-20°	551.3	3.9
20°-30°	810.2	5.7
30°-40°	941.0	6.7
40°-50°	939.8	6.7
50°-60°	819.5	5.8
60°-70°	605.8	4.3
70°-80°	342.7	2.4
80°-90°	95.8	0.7
90°-100°	99.2	0.7
100°-110°	369.9	2.6
110°-120°	981.1	6.9
120°-130°	1627.2	11.5
130°-140°	1728.5	12.2
140°-150°	1606.5	11.4
150°-160°	1291.5	9.1
160°-170°	832.2	5.9
170°-180°	286.4	2.0
0°-30°	1557.4	11.0
0°-40°	2498.4	17.7
0°-60°	4257.8	30.1
0°-90°	5302.1	37.5
90°-120°	1450.3	10.3
90°-150°	6412.5	45.4
90°-180°	8823.0	62.5
0°-180°	14124.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	2	26	43	55	59	13
95°	141	70	85	96	94	168
105°	662	727	133	157	166	707
115°	1252	1289	1344	335	179	1233
125°	1770	1799	1840	1855	1862	1579
135°	2191	2226	2245	2267	2263	1692
145°	2541	2539	2576	2591	2580	1589
155°	2798	2779	2805	2818	2800	1289
165°	2948	2935	2942	2957	2942	833
175°	3016	3001	3005	3020	2999	287
180°	3009	3009	3009	3009	3009	

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	2.1	26.1	43.4	54.6	58.7
92.5°	54.6	45.7	52.3	56.6	58.7
95°	141.4	69.6	84.8	95.9	93.6
97.5°	254.7	76.2	110.9	117.6	119.8
100°	385.6	87.1	124.1	141.4	145.9
102.5°	529.1	524.9	128.5	152.3	159.0
105°	662.0	727.4	133.0	156.7	165.5
107.5°	816.6	870.9	137.3	161.1	169.9
110°	964.7	1010.3	381.1	163.5	171.9

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1104.1	1143.2	1106.3	167.6	174.3
115°	1252.1	1289.1	1343.6	335.4	178.7
117.5°	1380.5	1424.1	1461.2	1149.7	579.3
120°	1524.4	1556.9	1596.3	1622.4	1328.4
122.5°	1646.2	1681.1	1724.7	1737.7	1740.0
125°	1770.3	1798.8	1840.1	1855.4	1861.8
127.5°	1883.6	1914.1	1946.9	1968.6	1970.7
130°	1990.3	2025.3	2049.1	2073.0	2071.0
132.5°	2099.2	2127.6	2151.4	2171.0	2169.0
135°	2190.8	2225.6	2245.1	2267.0	2262.6
137.5°	2286.4	2312.6	2334.5	2356.3	2349.7
140°	2380.0	2397.6	2421.4	2441.1	2430.2
142.5°	2458.6	2473.9	2502.1	2519.3	2508.6
145°	2541.4	2539.1	2576.1	2591.3	2580.4
147.5°	2613.0	2606.6	2643.5	2654.4	2645.9
150°	2682.8	2667.6	2702.5	2715.4	2704.6
152.5°	2741.5	2724.2	2756.8	2769.9	2754.7
155°	2798.2	2778.7	2804.9	2817.8	2800.5
157.5°	2843.9	2826.6	2846.3	2861.5	2843.9
160°	2883.3	2870.1	2883.3	2896.2	2880.9
162.5°	2917.9	2904.9	2915.8	2931.1	2911.4
165°	2948.4	2935.4	2941.9	2957.2	2941.9
167.5°	2972.4	2959.2	2966.0	2981.3	2961.5
170°	2992.0	2978.9	2983.3	2998.6	2978.9
172.5°	3005.0	2992.0	2996.5	3011.8	2992.0
175°	3015.9	3000.6	3005.0	3020.3	2998.6
177.5°	3020.3	3005.0	3007.4	3022.6	3002.9
180°	3009.4	3009.4	3009.4	3009.4	3009.4

TEST NUMBER: P922805

CATALOG NUMBER: DFN2DIP-SQ3F0-060D100US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.98	9.74	10.04	10.80	12.24	8.54	9.30	9.60	10.36	11.80
	3H	10.63	11.31	11.70	12.38	13.84	10.14	10.82	11.21	11.89	13.35
	4H	11.21	11.86	12.29	12.93	14.39	10.72	11.36	11.80	12.43	13.90
	6H	11.60	12.20	12.69	13.27	14.75	11.10	11.70	12.19	12.77	14.25
	8H	11.70	12.27	12.79	13.36	14.83	11.20	11.77	12.29	12.86	14.33
	12H	11.75	12.28	12.84	13.37	14.86	11.24	11.77	12.33	12.86	14.35
4H	2H	9.43	10.07	10.51	11.14	12.61	9.07	9.72	10.16	10.79	12.25
	3H	11.28	11.82	12.37	12.92	14.39	10.87	11.41	11.96	12.51	13.98
	4H	11.99	12.48	13.08	13.57	15.07	11.56	12.06	12.66	13.14	14.64
	6H	12.49	12.91	13.59	14.03	15.52	12.06	12.48	13.16	13.59	15.08
	8H	12.64	13.03	13.74	14.14	15.64	12.20	12.59	13.30	13.70	15.20
	12H	12.70	13.06	13.82	14.18	15.69	12.25	12.61	13.37	13.73	15.24
8H	4H	12.17	12.57	13.27	13.67	15.18	11.79	12.19	12.90	13.29	14.80
	6H	12.79	13.12	13.92	14.26	15.77	12.41	12.73	13.53	13.88	15.38
	8H	13.01	13.29	14.14	14.42	15.94	12.61	12.90	13.75	14.03	15.55
	12H	13.13	13.38	14.27	14.51	16.07	12.72	12.97	13.86	14.09	15.65
12H	4H	12.15	12.51	13.27	13.62	15.14	11.78	12.14	12.90	13.26	14.77
	6H	12.82	13.10	13.95	14.23	15.75	12.44	12.73	13.58	13.86	15.38
	8H	13.05	13.30	14.19	14.43	15.99	12.67	12.92	13.81	14.04	15.61