

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922819

Luminaire Tested: DFN2DIP-SQ3F0-070D040US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922819
REPORT IS A COMBINATION OF REPORTS P901388 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D040US940-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8836.8 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLLONL

Luminous Intensity Polar Plot

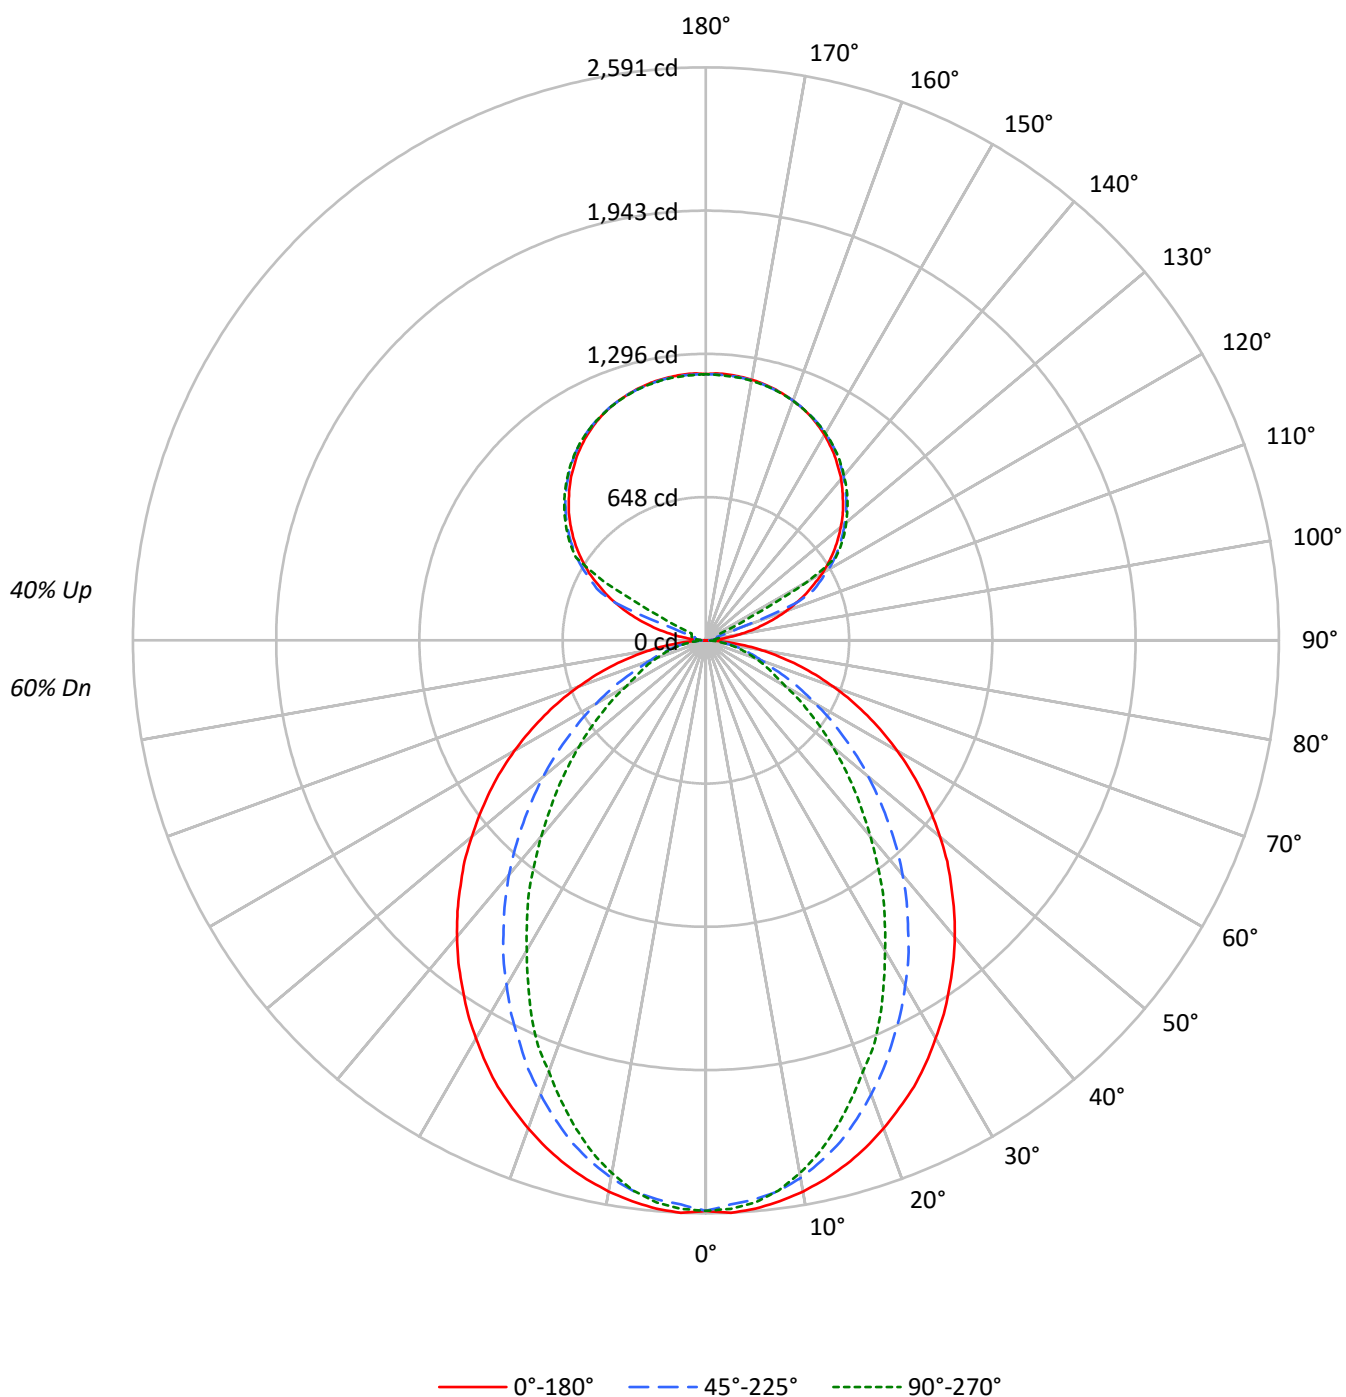

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2956	2956	2956
5°	2959	2907	2927
10°	2928	2848	2831
15°	2885	2752	2682
20°	2830	2620	2501
25°	2774	2473	2326
30°	2698	2323	2104
35°	2624	2161	1909
40°	2549	1994	1686
45°	2462	1808	1484
50°	2372	1621	1286
55°	2277	1422	1096
60°	2168	1214	901
65°	2041	1002	810
70°	1888	805	732
75°	1695	705	664
80°	1417	586	572
85°	960	381	424

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2462 cd/sqm

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.8	2.7
10°-20°	663.7	7.5
20°-30°	931.9	10.5
30°-40°	1015.8	11.5
40°-50°	933.6	10.6
50°-60°	733.2	8.3
60°-70°	477.3	5.4
70°-80°	245.7	2.8
80°-90°	64.8	0.7
90°-100°	39.7	0.4
100°-110°	148.0	1.7
110°-120°	392.4	4.4
120°-130°	650.9	7.4
130°-140°	691.4	7.8
140°-150°	642.6	7.3
150°-160°	516.6	5.8
160°-170°	332.9	3.8
170°-180°	114.6	1.3
0°-30°	1837.4	20.8
0°-40°	2853.2	32.3
0°-60°	4520.0	51.2
0°-90°	5307.8	60.1
90°-120°	580.1	6.6
90°-150°	2565.0	29.0
90°-180°	3529.0	39.9
0°-180°	8836.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2580	2580	2580	2580	2580	
5°	2580	2568	2538	2559	2552	245
15°	2454	2428	2349	2304	2281	691
25°	2227	2152	1998	1903	1868	1024
35°	1919	1800	1595	1448	1396	1201
45°	1569	1412	1167	1002	946	1212
55°	1193	1011	759	619	574	1066
65°	806	616	406	327	320	799
75°	430	266	187	170	168	454
85°	100	51	44	44	44	115
90°	1	10	17	22	24	8
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2579.8	2579.8	2579.8	2579.8	2579.8
2.5°	2591.4	2579.8	2554.0	2577.6	2572.9
5°	2579.8	2568.1	2537.7	2558.8	2551.8
7.5°	2558.8	2544.9	2512.2	2521.3	2509.7
10°	2530.8	2514.4	2467.8	2460.7	2446.8
12.5°	2495.8	2474.8	2411.6	2397.7	2371.9
15°	2453.7	2427.9	2348.7	2304.4	2281.1
17.5°	2404.7	2367.3	2269.2	2217.9	2180.5
20°	2348.7	2301.9	2185.2	2127.0	2075.5
22.5°	2288.0	2234.3	2098.7	2019.5	1984.6
25°	2227.3	2152.5	1998.4	1902.8	1867.7
27.5°	2155.0	2075.5	1905.1	1795.4	1741.6
30°	2078.0	1989.0	1802.2	1683.4	1620.2
32.5°	2003.1	1895.7	1704.4	1564.2	1505.7
35°	1919.1	1800.0	1594.7	1447.6	1396.1
37.5°	1837.5	1708.9	1491.9	1330.6	1272.5
40°	1751.0	1611.1	1384.4	1218.7	1158.0
42.5°	1662.3	1513.0	1277.1	1104.2	1046.1
45°	1569.0	1412.4	1167.4	1001.5	945.5
47.5°	1480.2	1314.6	1062.4	896.4	845.2
50°	1382.2	1216.5	959.6	798.3	749.6
52.5°	1286.3	1111.2	861.5	707.4	663.1
55°	1192.9	1010.8	758.7	618.8	574.4
57.5°	1097.3	910.5	667.8	537.0	499.6
60°	999.3	812.4	571.9	453.1	415.6
62.5°	903.6	716.8	490.2	378.3	359.6
65°	805.5	616.3	406.3	327.0	319.8
67.5°	712.1	522.9	327.0	287.0	280.2
70°	614.0	431.9	270.7	247.4	238.0
72.5°	520.7	347.8	226.4	207.9	203.1
75°	429.5	266.0	186.7	170.4	168.2
77.5°	338.6	189.0	147.1	137.7	133.0
80°	254.4	135.5	112.0	102.8	102.8
82.5°	177.4	91.1	77.0	72.3	72.3
85°	100.3	51.3	44.3	44.3	44.3
87.5°	37.4	18.5	18.5	16.3	16.3
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P922819

CATALOG NUMBER: DFN2DIP-SQ3F0-070D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.77	12.69	12.64	13.58	14.70	7.73	8.65	8.60	9.54	10.66
	3H	13.45	14.27	14.33	15.17	16.32	8.92	9.74	9.80	10.64	11.79
	4H	14.06	14.84	14.96	15.74	16.90	9.37	10.15	10.27	11.05	12.21
	6H	14.48	15.20	15.39	16.11	17.28	9.69	10.40	10.60	11.31	12.49
	8H	14.61	15.29	15.53	16.22	17.39	9.78	10.46	10.70	11.39	12.56
	12H	14.67	15.32	15.60	16.24	17.44	9.82	10.47	10.75	11.39	12.59
4H	2H	11.80	12.57	12.70	13.48	14.64	8.33	9.11	9.24	10.01	11.17
	3H	13.63	14.27	14.55	15.21	16.38	9.69	10.33	10.60	11.27	12.44
	4H	14.32	14.91	15.25	15.84	17.04	10.23	10.82	11.16	11.75	12.95
	6H	14.84	15.34	15.78	16.30	17.50	10.65	11.15	11.59	12.11	13.31
	8H	15.01	15.48	15.95	16.43	17.64	10.78	11.25	11.72	12.20	13.41
	12H	15.11	15.53	16.07	16.50	17.72	10.84	11.27	11.80	12.23	13.45
8H	4H	14.29	14.77	15.24	15.71	16.93	10.51	10.99	11.46	11.94	13.15
	6H	14.86	15.25	15.83	16.24	17.45	11.03	11.42	12.00	12.41	13.62
	8H	15.07	15.42	16.05	16.40	17.63	11.21	11.56	12.19	12.54	13.77
	12H	15.21	15.51	16.19	16.49	17.77	11.33	11.64	12.31	12.61	13.89
12H	4H	14.25	14.67	15.21	15.64	16.86	10.52	10.95	11.49	11.91	13.13
	6H	14.83	15.18	15.81	16.16	17.39	11.08	11.42	12.05	12.40	13.63
	8H	15.05	15.36	16.03	16.33	17.61	11.29	11.59	12.27	12.56	13.84

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8