

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922840

Luminaire Tested: DFN2DIP-SQ3F0-070D100US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922840
REPORT IS A COMBINATION OF REPORTS P899975 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D100US940-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14071.2 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 143.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFLL

Luminous Intensity Polar Plot

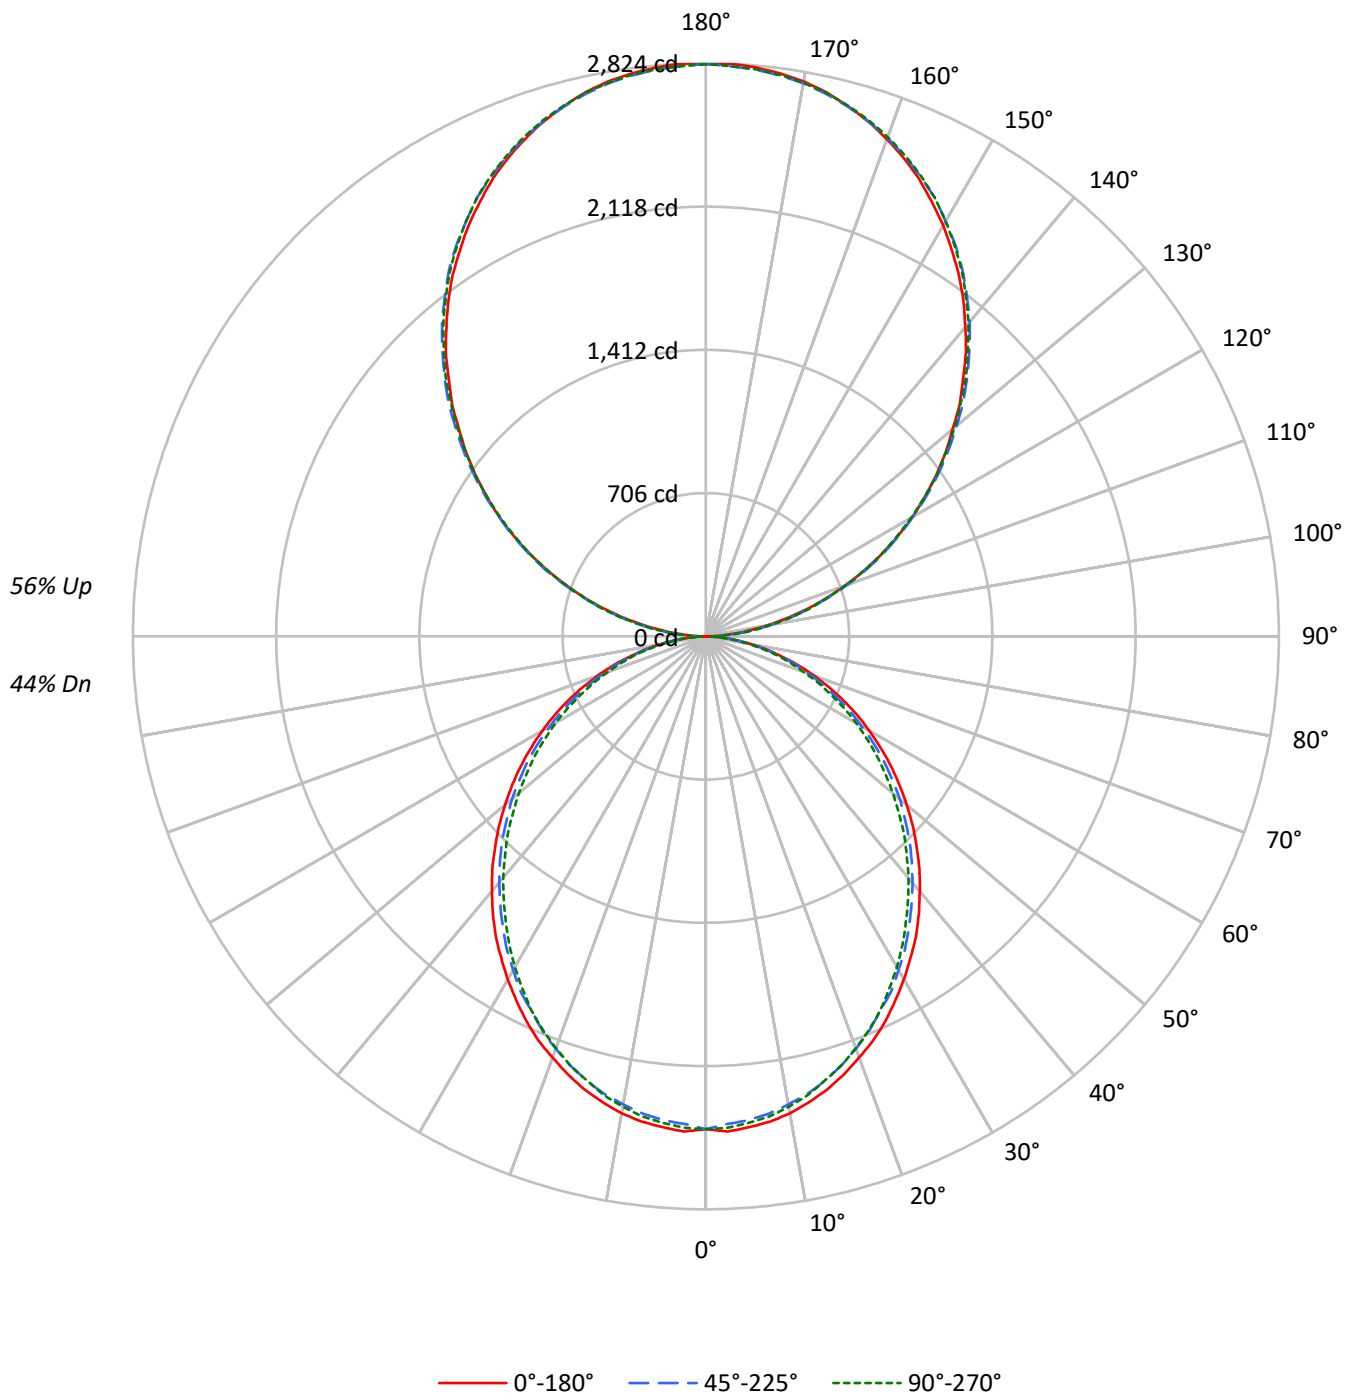

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	96	92	88	85	88	84	81	78	70	68	66	57	55	54	45	44	43
2	88	80	74	69	80	74	69	64	61	58	54	50	47	45	39	38	36
3	80	71	63	58	73	65	59	54	54	49	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	45	48	43	39	39	36	33	31	29	26
5	67	56	48	42	61	51	44	39	43	38	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	39	33	29	32	28	25	25	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	27	23	26	22	19	21	18	16
9	49	37	30	25	45	35	28	23	29	24	20	24	20	17	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2783	2783	2783
5°	2786	2742	2762
10°	2761	2703	2723
15°	2719	2657	2664
20°	2662	2594	2603
25°	2606	2518	2533
30°	2536	2447	2444
35°	2469	2364	2351
40°	2387	2280	2261
45°	2305	2196	2170
50°	2216	2107	2064
55°	2122	2005	1966
60°	2016	1884	1854
65°	1900	1758	1722
70°	1752	1604	1580
75°	1548	1420	1448
80°	1301	1185	1196
85°	916	785	783

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2838 cd/sqm

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.6	1.6
10°-20°	643.2	4.6
20°-30°	945.2	6.7
30°-40°	1097.8	7.8
40°-50°	1096.5	7.8
50°-60°	956.1	6.8
60°-70°	706.8	5.0
70°-80°	399.9	2.8
80°-90°	113.6	0.8
90°-100°	174.5	1.2
100°-110°	554.5	3.9
110°-120°	948.9	6.7
120°-130°	1247.9	8.9
130°-140°	1400.8	10.0
140°-150°	1373.6	9.8
150°-160°	1152.3	8.2
160°-170°	764.1	5.4
170°-180°	267.1	1.9
0°-30°	1817.0	12.9
0°-40°	2914.9	20.7
0°-60°	4967.4	35.3
0°-90°	6187.6	44.0
90°-120°	1677.9	11.9
90°-150°	5700.1	40.5
90°-180°	7884.0	56.0
0°-180°	14071.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2429	2429	2429	2429	2429	
5°	2429	2420	2394	2412	2408	231
15°	2312	2298	2268	2277	2266	651
25°	2093	2074	2034	2039	2034	963
35°	1805	1782	1745	1730	1719	1127
45°	1469	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	712	691	680	741
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	3	31	83	78	81	14
95°	124	148	152	152	148	138
105°	512	519	524	528	528	540
115°	952	966	962	959	952	942
125°	1385	1406	1400	1392	1389	1238
135°	1791	1818	1823	1820	1814	1385
145°	2175	2192	2206	2208	2199	1359
155°	2487	2494	2501	2513	2506	1145
165°	2705	2703	2703	2720	2708	763
175°	2815	2808	2803	2820	2806	267
180°	2820	2820	2820	2820	2820	

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2428.8	2428.8	2428.8	2428.8	2428.8
2.5°	2442.9	2431.2	2405.5	2428.8	2424.3
5°	2428.8	2419.7	2393.9	2412.4	2408.0
7.5°	2412.4	2398.5	2372.8	2391.7	2386.9
10°	2386.9	2370.5	2342.5	2361.2	2354.2
12.5°	2351.7	2337.9	2309.9	2321.5	2316.8
15°	2312.1	2298.2	2267.7	2277.2	2265.5
17.5°	2263.0	2249.2	2218.7	2230.3	2218.7
20°	2209.2	2195.4	2162.7	2169.6	2160.4
22.5°	2155.7	2134.7	2104.2	2104.2	2099.4
25°	2092.6	2073.9	2034.3	2038.8	2034.3
27.5°	2022.4	2006.1	1975.9	1968.9	1957.2
30°	1952.6	1933.7	1898.8	1891.9	1882.4
32.5°	1877.7	1863.9	1826.4	1812.3	1802.9
35°	1805.4	1782.1	1744.6	1730.5	1718.9
37.5°	1723.6	1702.5	1665.1	1648.8	1637.1
40°	1639.6	1620.8	1583.3	1562.5	1553.1
42.5°	1557.8	1539.0	1501.8	1478.3	1464.4
45°	1469.1	1452.8	1417.6	1392.0	1382.6
47.5°	1382.6	1366.3	1328.8	1303.1	1289.2
50°	1291.5	1279.8	1247.1	1214.4	1202.7
52.5°	1202.7	1186.4	1156.2	1130.4	1114.0
55°	1111.8	1097.7	1069.7	1041.7	1030.0
57.5°	1020.7	1009.0	978.5	950.5	941.1
60°	929.4	920.2	887.6	861.8	854.9
62.5°	840.7	824.4	801.1	777.8	768.4
65°	749.8	735.7	712.4	691.3	679.7
67.5°	656.4	644.5	623.7	607.3	597.9
70°	569.9	560.5	539.4	523.1	513.9
72.5°	481.2	471.8	460.1	443.8	436.8
75°	392.3	387.8	375.9	362.0	366.8
77.5°	313.0	303.5	298.8	291.9	285.0
80°	233.6	231.2	226.5	219.5	214.8
82.5°	158.8	158.8	156.6	147.2	147.2
85°	95.7	93.5	91.2	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	2.6	30.6	83.3	78.2	80.8
92.5°	52.7	71.4	74.0	76.5	76.5
95°	124.1	147.9	152.2	152.2	147.9
97.5°	206.6	228.7	238.1	238.1	238.1
100°	301.8	321.4	328.1	328.1	325.7
102.5°	402.2	416.6	426.0	428.5	426.0
105°	511.8	518.6	523.7	528.0	528.0
107.5°	620.6	630.9	630.9	632.6	620.6
110°	726.1	739.7	739.7	739.7	732.9

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	840.0	854.4	851.9	845.1	840.0
115°	952.3	965.8	961.6	959.0	952.3
117.5°	1063.6	1082.4	1070.4	1063.6	1056.8
120°	1175.8	1194.5	1175.8	1175.8	1168.2
122.5°	1277.8	1301.6	1289.8	1283.0	1277.8
125°	1385.0	1406.2	1399.5	1391.8	1389.3
127.5°	1489.6	1515.9	1506.5	1496.4	1489.6
130°	1587.3	1617.9	1613.7	1608.6	1599.3
132.5°	1697.0	1720.8	1722.5	1710.7	1703.8
135°	1791.4	1817.8	1822.8	1820.3	1813.5
137.5°	1896.8	1918.1	1922.3	1920.7	1910.4
140°	1989.5	2010.7	2022.7	2022.7	2013.3
142.5°	2084.7	2106.0	2112.7	2115.3	2106.0
145°	2174.8	2191.8	2205.5	2208.0	2198.6
147.5°	2255.6	2276.9	2287.1	2291.3	2282.0
150°	2339.0	2353.4	2362.8	2370.3	2362.8
152.5°	2412.9	2427.3	2439.3	2448.6	2439.3
155°	2486.9	2493.7	2501.3	2513.2	2505.5
157.5°	2550.6	2555.7	2560.0	2577.0	2565.1
160°	2607.6	2612.7	2615.2	2629.7	2619.5
162.5°	2660.3	2660.3	2662.8	2679.0	2667.1
165°	2705.4	2702.8	2702.8	2719.8	2707.9
167.5°	2746.2	2738.5	2738.5	2755.6	2743.6
170°	2776.8	2770.0	2767.4	2784.5	2770.0
172.5°	2798.0	2791.2	2788.6	2805.7	2791.2
175°	2815.0	2808.3	2803.2	2820.1	2805.7
177.5°	2824.4	2817.6	2812.5	2826.9	2812.5
180°	2820.1	2820.1	2820.1	2820.1	2820.1

TEST NUMBER: P922840

CATALOG NUMBER: DFN2DIP-SQ3F0-070D100US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.21	11.02	11.22	12.04	13.39	9.76	10.57	10.77	11.59	12.95
	3H	11.86	12.59	12.88	13.61	14.99	11.37	12.10	12.39	13.12	14.50
	4H	12.44	13.13	13.47	14.16	15.54	11.95	12.64	12.98	13.66	15.05
	6H	12.84	13.47	13.88	14.50	15.90	12.34	12.97	13.38	14.00	15.40
	8H	12.94	13.54	13.98	14.59	15.98	12.44	13.04	13.48	14.09	15.48
	12H	12.98	13.56	14.03	14.60	16.01	12.47	13.05	13.52	14.09	15.50
4H	2H	10.66	11.35	11.70	12.38	13.76	10.30	10.99	11.34	12.02	13.40
	3H	12.51	13.09	13.56	14.15	15.54	12.11	12.68	13.15	13.74	15.13
	4H	13.22	13.75	14.27	14.80	16.22	12.80	13.32	13.85	14.37	15.79
	6H	13.73	14.18	14.79	15.25	16.67	13.30	13.75	14.36	14.82	16.24
	8H	13.88	14.30	14.94	15.36	16.79	13.44	13.86	14.50	14.93	16.36
	12H	13.95	14.33	15.03	15.41	16.84	13.50	13.88	14.58	14.96	16.39
8H	4H	13.41	13.83	14.47	14.90	16.33	13.03	13.46	14.10	14.52	15.95
	6H	14.03	14.38	15.12	15.49	16.92	13.65	14.00	14.74	15.11	16.53
	8H	14.25	14.56	15.34	15.65	17.09	13.86	14.16	14.95	15.25	16.70
	12H	14.38	14.65	15.47	15.73	17.22	13.97	14.24	15.06	15.32	16.81
12H	4H	13.39	13.78	14.47	14.85	16.29	13.02	13.41	14.10	14.49	15.92
	6H	14.06	14.37	15.15	15.46	16.90	13.69	14.00	14.78	15.09	16.53
	8H	14.30	14.57	15.39	15.65	17.14	13.92	14.19	15.01	15.27	16.76

END OF REPORT