

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922915

Luminaire Tested: DFN2DIP-SQ3F0-090D100US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922915
REPORT IS A COMBINATION OF REPORTS P901500 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D100US940-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15649.6 lumens
Efficiency: N/A
Efficacy: 94.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 165.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLONL

Luminous Intensity Polar Plot

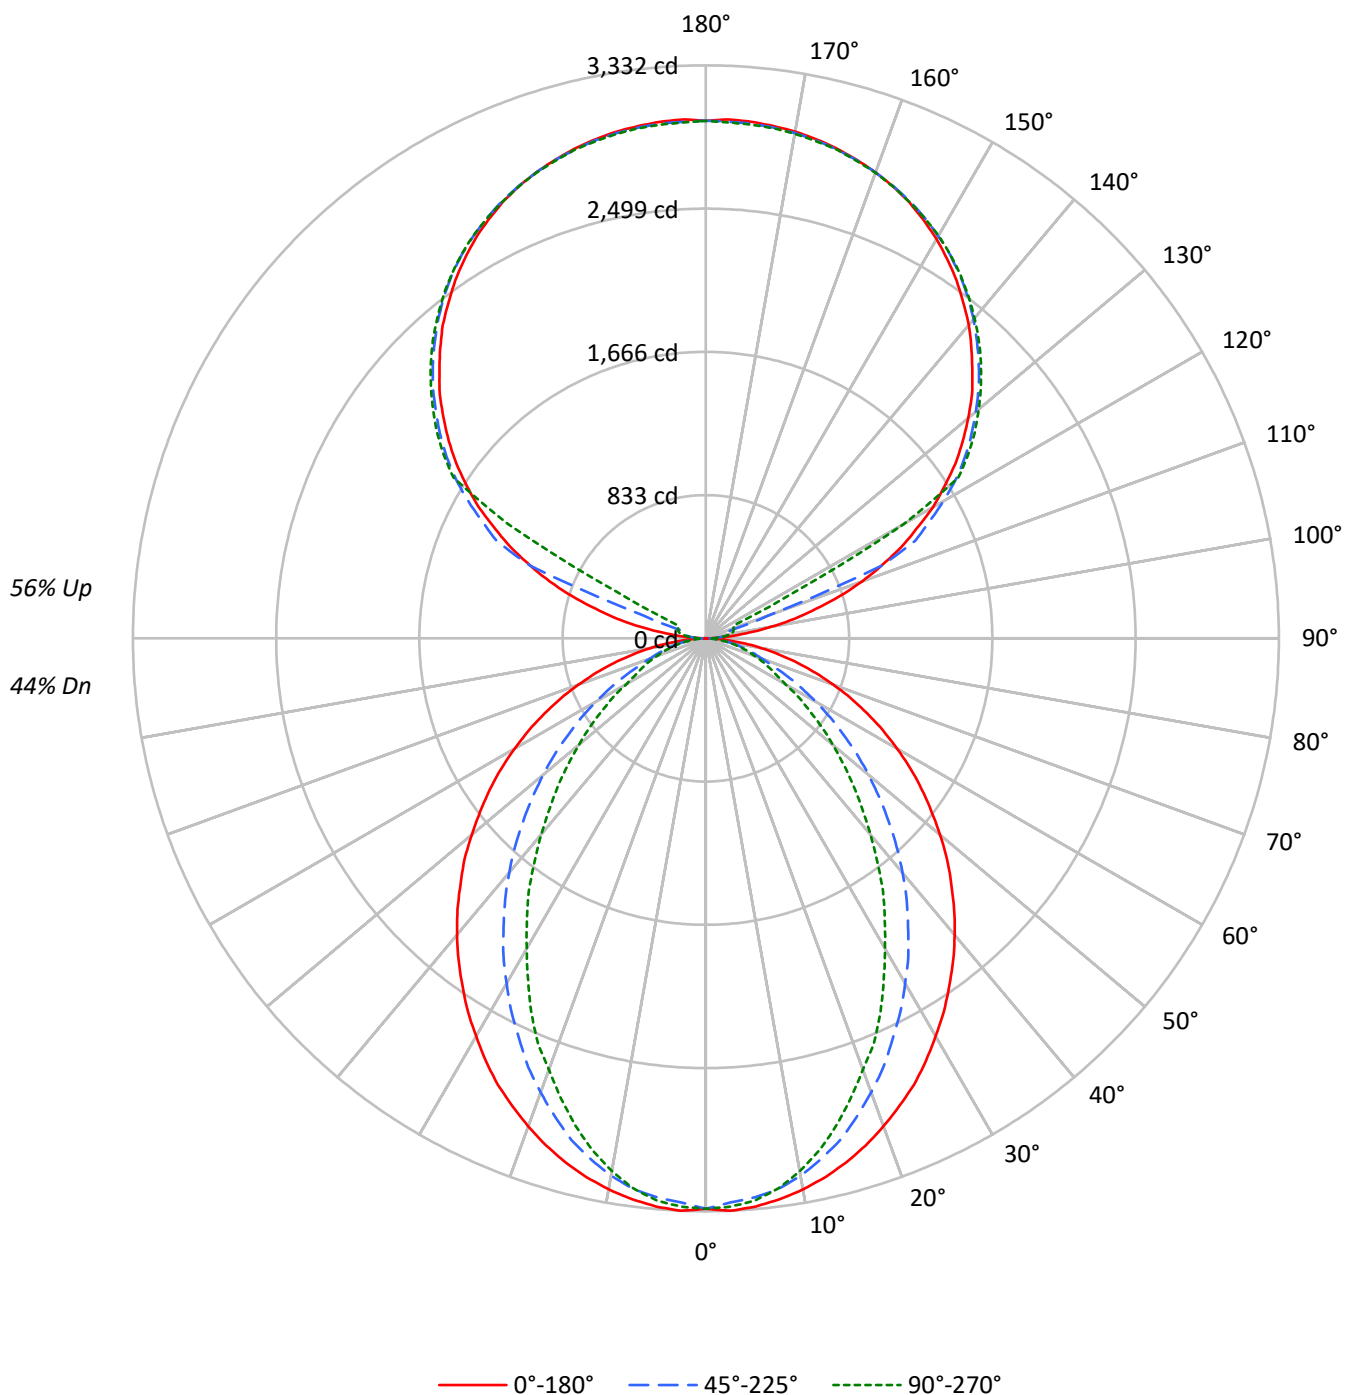

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	71	68	66	57	56	54	45	44	43
2	88	81	76	71	81	75	70	65	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	41	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3801	3801	3801
5°	3804	3738	3763
10°	3764	3662	3639
15°	3710	3538	3449
20°	3639	3369	3215
25°	3566	3180	2990
30°	3469	2986	2705
35°	3374	2778	2455
40°	3278	2563	2168
45°	3165	2325	1908
50°	3049	2085	1654
55°	2927	1828	1410
60°	2787	1561	1159
65°	2624	1289	1042
70°	2427	1035	941
75°	2179	907	853
80°	1821	753	736
85°	1234	491	546

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3165 cd/sqm

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.9	2.0
10°-20°	853.4	5.5
20°-30°	1198.1	7.7
30°-40°	1306.0	8.3
40°-50°	1200.4	7.7
50°-60°	942.7	6.0
60°-70°	613.6	3.9
70°-80°	315.9	2.0
80°-90°	85.9	0.5
90°-100°	99.2	0.6
100°-110°	369.9	2.4
110°-120°	981.1	6.3
120°-130°	1627.2	10.4
130°-140°	1728.5	11.0
140°-150°	1606.5	10.3
150°-160°	1291.5	8.3
160°-170°	832.2	5.3
170°-180°	286.4	1.8
0°-30°	2362.4	15.1
0°-40°	3668.4	23.4
0°-60°	5811.5	37.1
0°-90°	6826.9	43.6
90°-120°	1450.3	9.3
90°-150°	6412.5	41.0
90°-180°	8823.0	56.4
0°-180°	15649.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3317	3317	3317	3317	3317	
5°	3317	3302	3263	3290	3281	315
15°	3155	3122	3020	2963	2933	889
25°	2864	2768	2570	2446	2401	1317
35°	2468	2314	2050	1861	1795	1544
45°	2017	1816	1501	1288	1216	1558
55°	1534	1300	975	796	738	1371
65°	1036	792	522	420	411	1027
75°	552	342	240	219	216	584
85°	129	66	57	57	57	148
90°	2	26	43	55	59	15
95°	141	70	85	96	94	168
105°	662	727	133	157	166	707
115°	1252	1289	1344	335	179	1233
125°	1770	1799	1840	1855	1862	1579
135°	2191	2226	2245	2267	2263	1692
145°	2541	2539	2576	2591	2580	1589
155°	2798	2779	2805	2818	2800	1289
165°	2948	2935	2942	2957	2942	833
175°	3016	3001	3005	3020	2999	287
180°	3009	3009	3009	3009	3009	

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3316.9	3316.9	3316.9	3316.9	3316.9
2.5°	3331.9	3316.9	3283.7	3314.0	3308.0
5°	3316.9	3301.9	3262.8	3289.8	3280.9
7.5°	3289.8	3272.0	3230.0	3241.7	3226.7
10°	3253.9	3232.8	3173.0	3163.7	3145.9
12.5°	3208.9	3181.9	3100.7	3082.8	3049.6
15°	3154.8	3121.7	3019.8	2962.7	2932.8
17.5°	3091.7	3043.7	2917.5	2851.6	2803.5
20°	3019.8	2959.6	2809.5	2734.7	2668.4
22.5°	2941.8	2872.6	2698.4	2596.5	2551.6
25°	2863.7	2767.5	2569.5	2446.5	2401.3
27.5°	2770.7	2668.4	2449.4	2308.3	2239.2
30°	2671.7	2557.3	2317.2	2164.4	2083.1
32.5°	2575.4	2437.2	2191.4	2011.2	1936.0
35°	2467.5	2314.3	2050.3	1861.2	1794.9
37.5°	2362.4	2197.2	1918.2	1710.8	1636.0
40°	2251.3	2071.4	1779.9	1566.9	1488.9
42.5°	2137.3	1945.3	1642.0	1419.8	1344.9
45°	2017.2	1816.0	1500.9	1287.5	1215.6
47.5°	1903.2	1690.1	1365.9	1152.5	1086.6
50°	1777.1	1564.0	1233.8	1026.4	963.7
52.5°	1653.9	1428.7	1107.7	909.5	852.6
55°	1533.7	1299.7	975.4	795.6	738.5
57.5°	1410.9	1170.7	858.6	690.5	642.4
60°	1284.7	1044.5	735.4	582.5	534.4
62.5°	1161.8	921.7	630.3	486.3	462.4
65°	1035.6	792.4	522.3	420.4	411.2
67.5°	915.6	672.3	420.4	369.1	360.2
70°	789.5	555.4	348.1	318.2	306.0
72.5°	669.4	447.1	291.1	267.2	261.2
75°	552.2	342.1	240.1	219.1	216.2
77.5°	435.3	243.0	189.1	177.1	171.0
80°	327.1	174.2	143.9	132.2	132.2
82.5°	228.0	117.2	99.1	93.0	93.0
85°	128.9	65.9	57.0	57.0	57.0
87.5°	48.1	23.9	23.9	21.0	21.0
90°	2.1	26.1	43.4	54.6	58.7
92.5°	54.6	45.7	52.3	56.6	58.7
95°	141.4	69.6	84.8	95.9	93.6
97.5°	254.7	76.2	110.9	117.6	119.8
100°	385.6	87.1	124.1	141.4	145.9
102.5°	529.1	524.9	128.5	152.3	159.0
105°	662.0	727.4	133.0	156.7	165.5
107.5°	816.6	870.9	137.3	161.1	169.9
110°	964.7	1010.3	381.1	163.5	171.9

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1104.1	1143.2	1106.3	167.6	174.3
115°	1252.1	1289.1	1343.6	335.4	178.7
117.5°	1380.5	1424.1	1461.2	1149.7	579.3
120°	1524.4	1556.9	1596.3	1622.4	1328.4
122.5°	1646.2	1681.1	1724.7	1737.7	1740.0
125°	1770.3	1798.8	1840.1	1855.4	1861.8
127.5°	1883.6	1914.1	1946.9	1968.6	1970.7
130°	1990.3	2025.3	2049.1	2073.0	2071.0
132.5°	2099.2	2127.6	2151.4	2171.0	2169.0
135°	2190.8	2225.6	2245.1	2267.0	2262.6
137.5°	2286.4	2312.6	2334.5	2356.3	2349.7
140°	2380.0	2397.6	2421.4	2441.1	2430.2
142.5°	2458.6	2473.9	2502.1	2519.3	2508.6
145°	2541.4	2539.1	2576.1	2591.3	2580.4
147.5°	2613.0	2606.6	2643.5	2654.4	2645.9
150°	2682.8	2667.6	2702.5	2715.4	2704.6
152.5°	2741.5	2724.2	2756.8	2769.9	2754.7
155°	2798.2	2778.7	2804.9	2817.8	2800.5
157.5°	2843.9	2826.6	2846.3	2861.5	2843.9
160°	2883.3	2870.1	2883.3	2896.2	2880.9
162.5°	2917.9	2904.9	2915.8	2931.1	2911.4
165°	2948.4	2935.4	2941.9	2957.2	2941.9
167.5°	2972.4	2959.2	2966.0	2981.3	2961.5
170°	2992.0	2978.9	2983.3	2998.6	2978.9
172.5°	3005.0	2992.0	2996.5	3011.8	2992.0
175°	3015.9	3000.6	3005.0	3020.3	2998.6
177.5°	3020.3	3005.0	3007.4	3022.6	3002.9
180°	3009.4	3009.4	3009.4	3009.4	3009.4

TEST NUMBER: P922915

CATALOG NUMBER: DFN2DIP-SQ3F0-090D100US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.13	11.91	12.14	12.93	14.29	7.09	7.87	8.10	8.89	10.25
	3H	12.80	13.49	13.82	14.52	15.91	8.27	8.96	9.29	9.99	11.38
	4H	13.40	14.06	14.44	15.09	16.48	8.71	9.37	9.75	10.40	11.79
	6H	13.81	14.42	14.86	15.46	16.86	9.02	9.63	10.07	10.67	12.07
	8H	13.94	14.51	14.99	15.57	16.96	9.11	9.69	10.16	10.74	12.14
	12H	13.99	14.54	15.05	15.59	17.01	9.15	9.70	10.20	10.74	12.16
4H	2H	11.14	11.80	12.18	12.83	14.22	7.67	8.33	8.72	9.37	10.76
	3H	12.96	13.50	14.01	14.57	15.97	9.01	9.56	10.07	10.62	12.02
	4H	13.64	14.14	14.70	15.20	16.62	9.55	10.06	10.61	11.11	12.53
	6H	14.15	14.58	15.22	15.66	17.08	9.96	10.39	11.03	11.47	12.89
	8H	14.32	14.72	15.39	15.79	17.23	10.09	10.49	11.16	11.56	12.99
	12H	14.41	14.78	15.50	15.86	17.30	10.15	10.51	11.23	11.59	13.03
8H	4H	13.60	14.01	14.67	15.07	16.51	9.83	10.23	10.90	11.30	12.73
	6H	14.16	14.50	15.26	15.61	17.04	10.33	10.67	11.43	11.78	13.21
	8H	14.38	14.67	15.48	15.76	17.21	10.52	10.81	11.62	11.90	13.36
	12H	14.51	14.77	15.61	15.85	17.35	10.63	10.89	11.73	11.98	13.47
12H	4H	13.55	13.92	14.64	15.00	16.44	9.83	10.19	10.91	11.27	12.71
	6H	14.14	14.43	15.24	15.52	16.97	10.38	10.67	11.48	11.77	13.22
	8H	14.35	14.61	15.45	15.70	17.19	10.58	10.84	11.69	11.93	13.42

END OF REPORT