

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922927

Luminaire Tested: DFN2DIP-SQ3F0-100D040US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922927
REPORT IS A COMBINATION OF REPORTS P901394 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D040US940-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11110.7 lumens
Efficiency: N/A
Efficacy: 86.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 128.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLLONL

Luminous Intensity Polar Plot

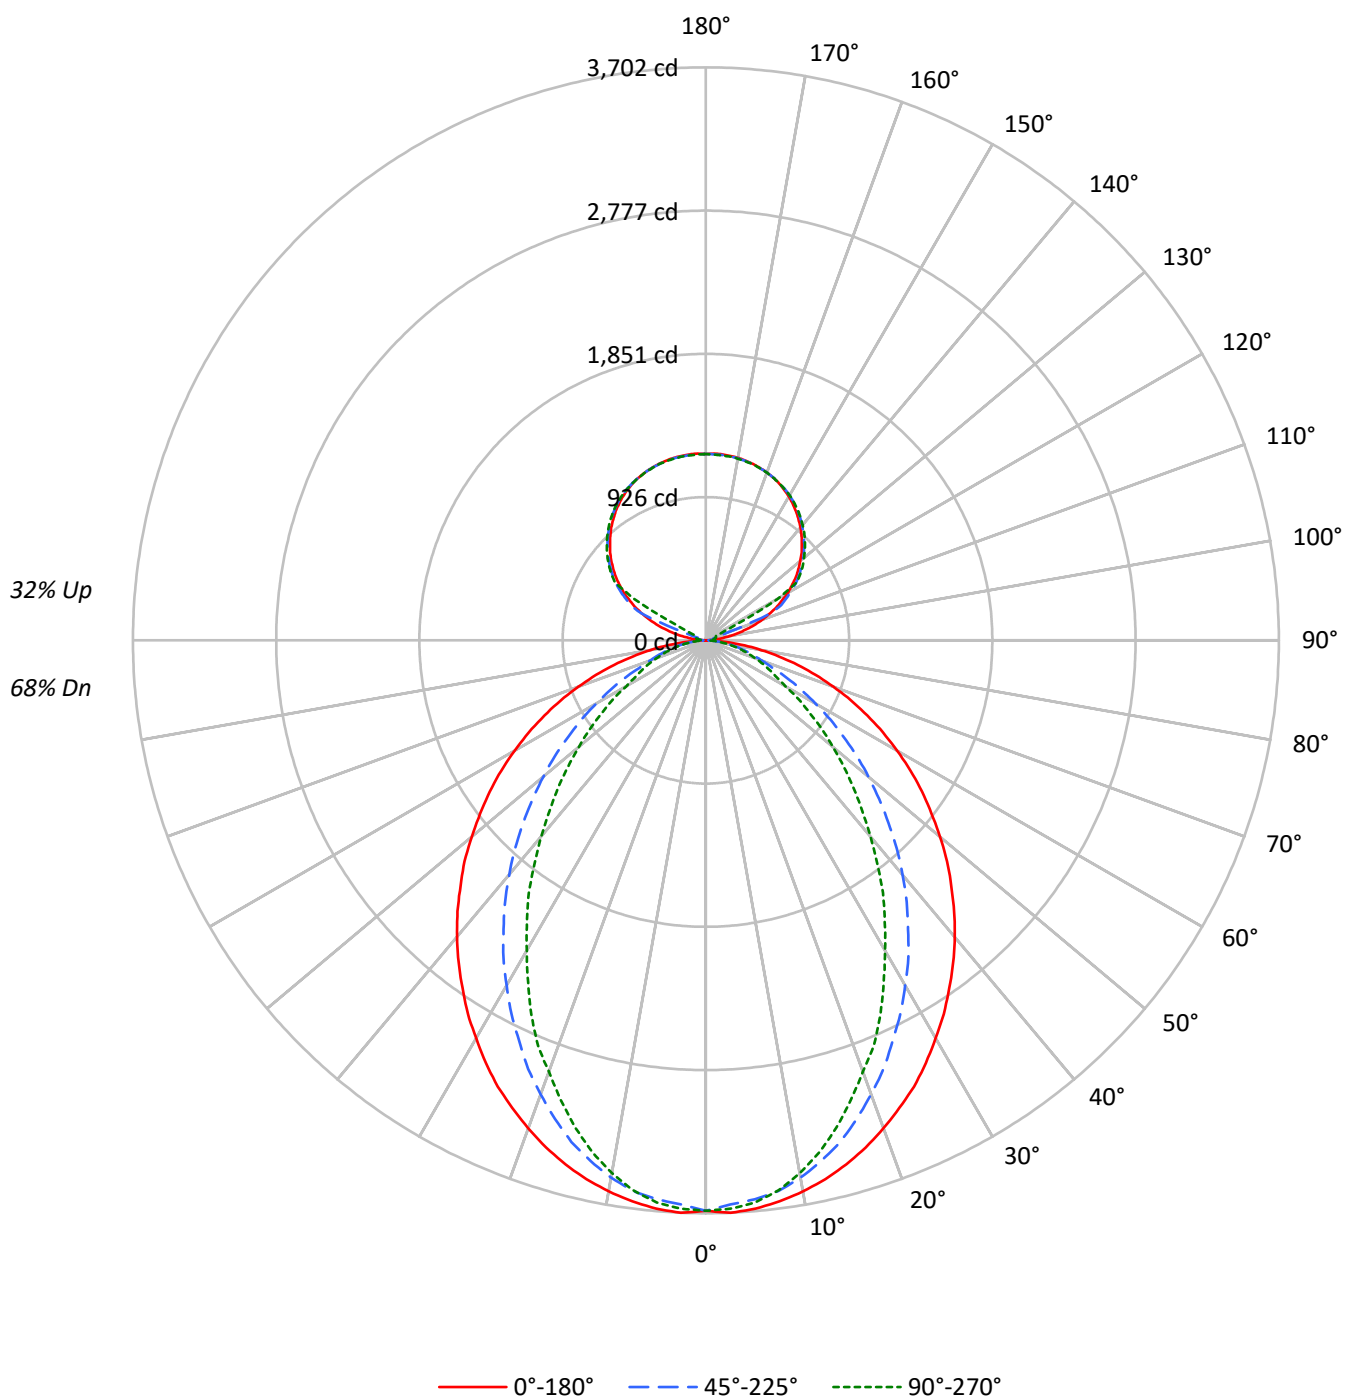

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	83	83	83	73	73	73
1	103	98	95	91	97	93	90	87	83	81	78	74	72	70	65	64	63
2	94	87	81	76	88	82	77	72	74	69	66	66	63	60	58	56	54
3	86	77	70	64	81	73	66	61	66	60	56	59	55	51	52	49	47
4	79	69	61	55	75	65	58	53	59	53	49	53	48	45	47	44	41
5	73	62	53	48	69	59	51	46	53	47	42	48	43	39	43	39	36
6	68	56	47	42	64	53	46	40	48	42	38	43	39	35	39	35	32
7	63	50	43	37	59	48	41	36	44	38	33	40	35	31	36	32	29
8	58	46	38	33	55	44	37	32	40	34	30	37	32	28	33	29	26
9	55	42	35	30	52	41	34	29	37	31	27	34	29	25	31	27	24
10	51	39	32	27	48	37	31	26	34	29	25	31	27	23	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4223	4223	4223
5°	4227	4153	4181
10°	4182	4069	4044
15°	4122	3931	3832
20°	4043	3744	3573
25°	3962	3533	3323
30°	3855	3318	3006
35°	3749	3087	2727
40°	3642	2848	2408
45°	3517	2583	2120
50°	3388	2316	1837
55°	3253	2031	1566
60°	3096	1734	1288
65°	2916	1432	1157
70°	2697	1150	1046
75°	2422	1008	948
80°	2023	837	818
85°	1372	545	606

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3517 cd/sqm

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	345.4	3.1
10°-20°	948.2	8.5
20°-30°	1331.2	12.0
30°-40°	1451.1	13.1
40°-50°	1333.8	12.0
50°-60°	1047.4	9.4
60°-70°	681.8	6.1
70°-80°	351.0	3.2
80°-90°	91.7	0.8
90°-100°	39.7	0.4
100°-110°	148.0	1.3
110°-120°	392.4	3.5
120°-130°	650.9	5.9
130°-140°	691.4	6.2
140°-150°	642.6	5.8
150°-160°	516.6	4.6
160°-170°	332.9	3.0
170°-180°	114.6	1.0
0°-30°	2624.8	23.6
0°-40°	4076.0	36.7
0°-60°	6457.2	58.1
0°-90°	7581.6	68.2
90°-120°	580.1	5.2
90°-150°	2565.0	23.1
90°-180°	3529.0	31.8
0°-180°	11110.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3685	3685	3685	3685	3685	
5°	3685	3669	3625	3655	3645	349
15°	3505	3468	3355	3292	3259	988
25°	3182	3075	2855	2718	2668	1463
35°	2742	2572	2278	2068	1994	1716
45°	2241	2018	1668	1431	1351	1731
55°	1704	1444	1084	884	821	1523
65°	1151	880	580	467	457	1141
75°	614	380	267	243	240	649
85°	143	73	63	63	63	164
90°	1	10	17	22	24	11
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3685.4	3685.4	3685.4	3685.4	3685.4
2.5°	3702.0	3685.4	3648.6	3682.2	3675.5
5°	3685.4	3668.8	3625.2	3655.4	3645.4
7.5°	3655.4	3635.5	3588.8	3601.9	3585.3
10°	3615.4	3592.0	3525.5	3515.2	3495.4
12.5°	3565.5	3535.4	3445.1	3425.3	3388.5
15°	3505.3	3468.5	3355.2	3291.9	3258.7
17.5°	3435.2	3381.8	3241.7	3168.4	3115.0
20°	3355.2	3288.4	3121.7	3038.6	2964.9
22.5°	3268.6	3191.8	2998.2	2885.0	2835.1
25°	3181.9	3075.1	2854.9	2718.3	2668.1
27.5°	3078.5	2964.9	2721.5	2564.7	2488.0
30°	2968.5	2841.4	2574.6	2404.9	2314.6
32.5°	2861.7	2708.0	2434.9	2234.6	2151.1
35°	2741.7	2571.5	2278.1	2068.0	1994.3
37.5°	2624.9	2441.2	2131.3	1900.9	1817.8
40°	2501.4	2301.5	1977.7	1741.0	1654.3
42.5°	2374.7	2161.3	1824.5	1577.5	1494.3
45°	2241.3	2017.7	1667.8	1430.7	1350.7
47.5°	2114.7	1877.9	1517.7	1280.6	1207.4
50°	1974.5	1737.8	1370.8	1140.5	1070.8
52.5°	1837.5	1587.4	1230.7	1010.6	947.3
55°	1704.1	1444.1	1083.9	884.0	820.6
57.5°	1567.6	1300.7	954.0	767.1	713.7
60°	1427.4	1160.7	817.1	647.2	593.8
62.5°	1290.8	1024.0	700.3	540.4	513.8
65°	1150.8	880.4	580.3	467.1	456.8
67.5°	1017.4	747.0	467.1	410.1	400.2
70°	877.2	617.2	386.7	353.5	340.1
72.5°	743.8	496.8	323.4	296.9	290.2
75°	613.6	380.0	266.8	243.4	240.2
77.5°	483.8	270.0	210.2	196.7	190.0
80°	363.4	193.6	160.0	146.9	146.9
82.5°	253.3	130.2	110.0	103.3	103.3
85°	143.3	73.2	63.3	63.3	63.3
87.5°	53.4	26.6	26.6	23.4	23.4
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P922927

CATALOG NUMBER: DFN2DIP-SQ3F0-100D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.67	14.68	14.46	15.48	16.47	9.63	10.64	10.42	11.45	12.43
	3H	15.36	16.26	16.16	17.08	18.09	10.83	11.73	11.63	12.54	13.56
	4H	15.97	16.82	16.79	17.65	18.67	11.28	12.13	12.10	12.95	13.98
	6H	16.40	17.18	17.23	18.01	19.05	11.61	12.39	12.44	13.22	14.26
	8H	16.53	17.27	17.37	18.12	19.16	11.70	12.44	12.54	13.29	14.33
	12H	16.59	17.30	17.44	18.15	19.21	11.74	12.45	12.59	13.30	14.36
4H	2H	13.71	14.56	14.54	15.38	16.41	10.25	11.09	11.07	11.92	12.95
	3H	15.55	16.25	16.39	17.11	18.16	11.61	12.31	12.44	13.17	14.21
	4H	16.24	16.88	17.09	17.74	18.81	12.16	12.79	13.00	13.65	14.72
	6H	16.77	17.32	17.63	18.20	19.27	12.58	13.13	13.44	14.01	15.09
	8H	16.94	17.46	17.81	18.33	19.42	12.71	13.22	13.57	14.10	15.18
	12H	17.04	17.50	17.93	18.40	19.49	12.77	13.24	13.66	14.13	15.23
8H	4H	16.22	16.74	17.09	17.61	18.70	12.44	12.96	13.31	13.84	14.92
	6H	16.79	17.22	17.69	18.13	19.22	12.96	13.39	13.86	14.30	15.39
	8H	17.00	17.38	17.91	18.29	19.40	13.15	13.53	14.05	14.44	15.54
	12H	17.15	17.48	18.06	18.38	19.54	13.27	13.60	14.18	14.50	15.66
12H	4H	16.18	16.65	17.07	17.54	18.64	12.46	12.92	13.35	13.82	14.91
	6H	16.77	17.14	17.67	18.06	19.16	13.01	13.39	13.92	14.30	15.40
	8H	16.99	17.32	17.90	18.23	19.38	13.22	13.55	14.13	14.46	15.62

END OF REPORT