

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922928

Luminaire Tested: DFN2DIP-SQ3F0-100D050US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922928
REPORT IS A COMBINATION OF REPORTS P899891 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D050US940-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12773.7 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 135.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFLL

Luminous Intensity Polar Plot

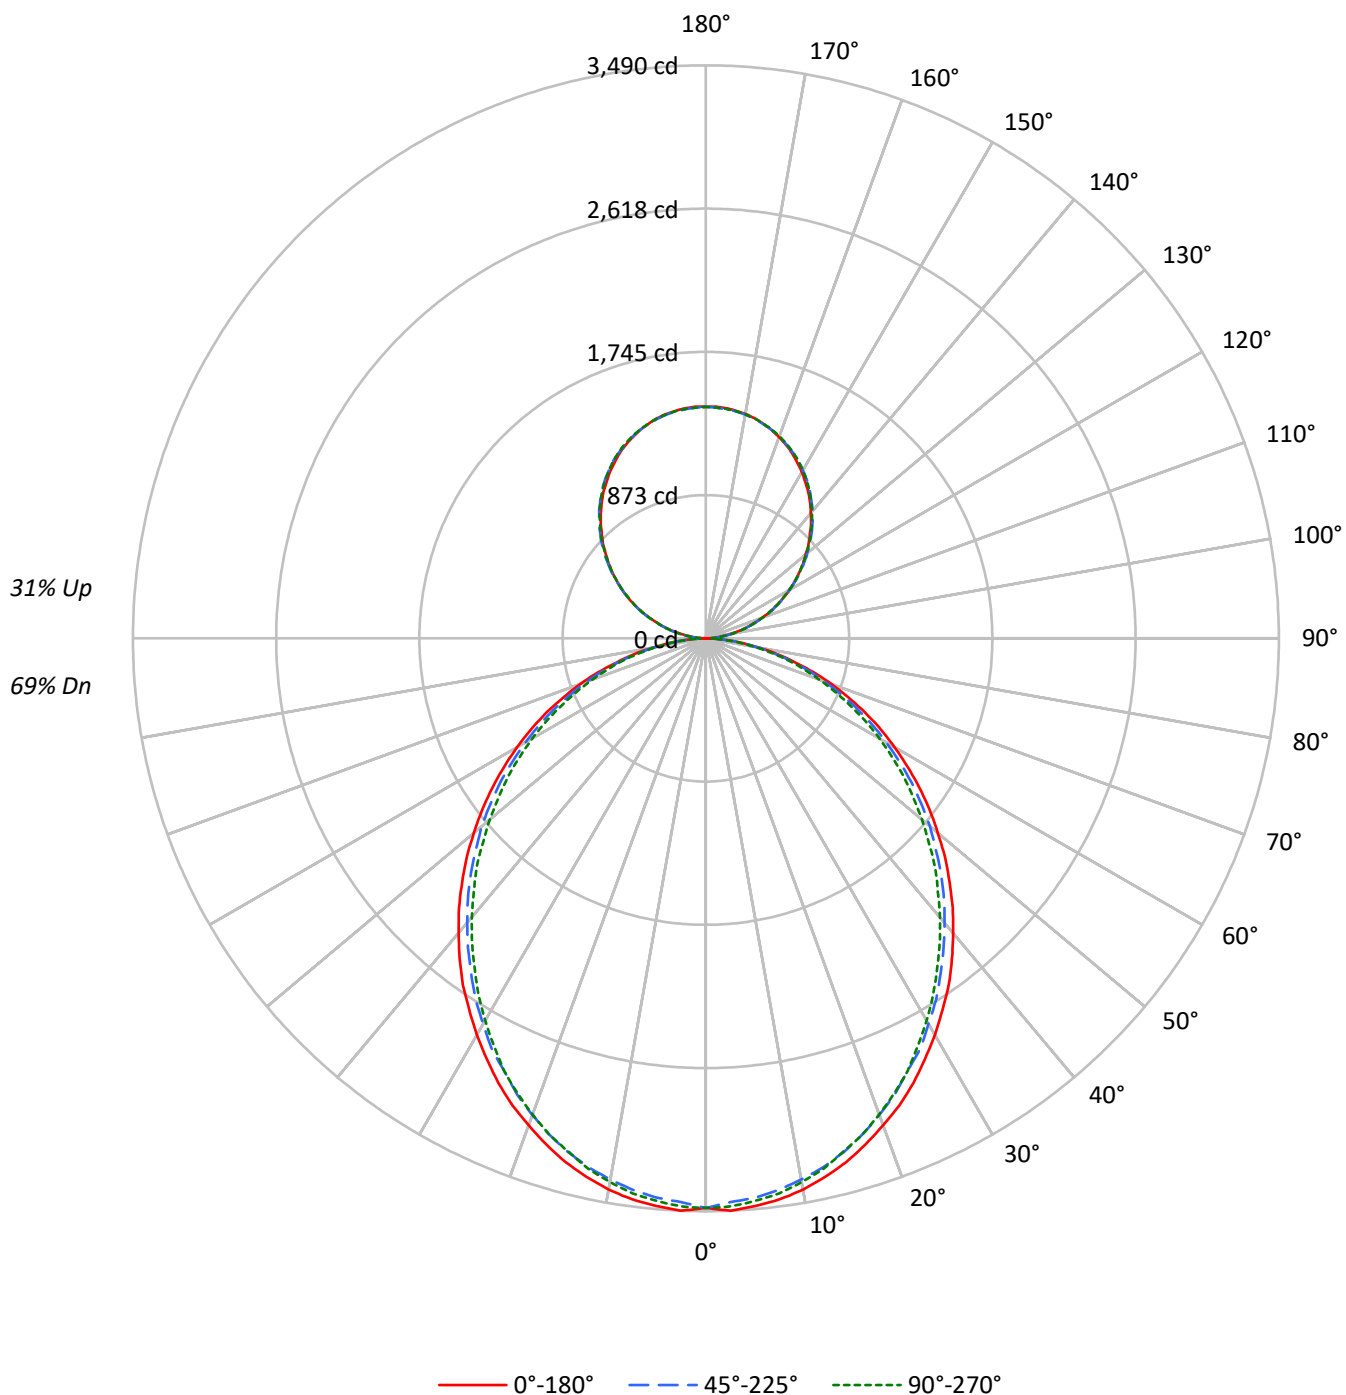

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	35	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3976	3976	3976
5°	3979	3918	3945
10°	3945	3862	3891
15°	3884	3796	3806
20°	3803	3705	3719
25°	3723	3597	3619
30°	3622	3496	3492
35°	3527	3377	3358
40°	3410	3257	3230
45°	3293	3137	3100
50°	3166	3010	2948
55°	3032	2864	2809
60°	2880	2691	2649
65°	2714	2511	2460
70°	2503	2291	2257
75°	2212	2028	2068
80°	1859	1692	1709
85°	1308	1122	1118

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3293 cd/sqm

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	2.6
10°-20°	918.8	7.2
20°-30°	1350.3	10.6
30°-40°	1568.3	12.3
40°-50°	1566.4	12.3
50°-60°	1365.8	10.7
60°-70°	1009.7	7.9
70°-80°	571.3	4.5
80°-90°	154.8	1.2
90°-100°	87.3	0.7
100°-110°	277.2	2.2
110°-120°	474.5	3.7
120°-130°	624.0	4.9
130°-140°	700.4	5.5
140°-150°	686.8	5.4
150°-160°	576.1	4.5
160°-170°	382.1	3.0
170°-180°	133.5	1.0
0°-30°	2595.7	20.3
0°-40°	4164.0	32.6
0°-60°	7096.2	55.6
0°-90°	8831.9	69.1
90°-120°	838.9	6.6
90°-150°	2850.1	22.3
90°-180°	3942.0	30.9
0°-180°	12773.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	1	15	42	39	40	12
95°	62	74	76	76	74	69
105°	256	259	262	264	264	270
115°	476	483	481	480	476	471
125°	692	703	700	696	695	619
135°	896	909	911	910	907	692
145°	1087	1096	1103	1104	1099	679
155°	1243	1247	1251	1257	1253	572
165°	1353	1351	1351	1360	1354	382
175°	1408	1404	1402	1410	1403	134
180°	1410	1410	1410	1410	1410	

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	1.2	15.3	41.6	39.1	40.4
92.5°	26.4	35.7	37.0	38.3	38.3
95°	62.1	74.0	76.1	76.1	74.0
97.5°	103.3	114.3	119.0	119.0	119.0
100°	150.9	160.7	164.1	164.1	162.8
102.5°	201.1	208.3	212.9	214.3	212.9
105°	255.9	259.3	261.9	263.9	263.9
107.5°	310.3	315.4	315.4	316.3	310.3
110°	363.0	369.9	369.9	369.9	366.4

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	420.0	427.2	426.0	422.6	420.0
115°	476.1	483.0	480.8	479.6	476.1
117.5°	531.8	541.2	535.2	531.8	528.4
120°	587.9	597.3	587.9	587.9	584.1
122.5°	638.9	650.9	644.9	641.5	638.9
125°	692.5	703.1	699.7	695.9	694.6
127.5°	744.8	758.0	753.3	748.1	744.8
130°	793.7	809.0	806.8	804.3	799.6
132.5°	848.6	860.4	861.3	855.3	851.9
135°	895.7	908.8	911.4	910.2	906.8
137.5°	948.4	959.0	961.2	960.3	955.2
140°	994.7	1005.4	1011.3	1011.3	1006.7
142.5°	1042.3	1053.0	1056.4	1057.7	1053.0
145°	1087.4	1095.9	1102.7	1104.0	1099.3
147.5°	1127.8	1138.4	1143.5	1145.7	1140.9
150°	1169.5	1176.7	1181.3	1185.2	1181.3
152.5°	1206.5	1213.7	1219.6	1224.3	1219.6
155°	1243.4	1246.8	1250.6	1256.6	1252.8
157.5°	1275.3	1277.8	1280.0	1288.5	1282.5
160°	1303.8	1306.4	1307.6	1314.8	1309.7
162.5°	1330.2	1330.2	1331.4	1339.5	1333.6
165°	1352.7	1351.4	1351.4	1359.9	1354.0
167.5°	1373.1	1369.2	1369.2	1377.8	1371.8
170°	1388.4	1385.0	1383.8	1392.2	1385.0
172.5°	1399.0	1395.6	1394.4	1402.8	1395.6
175°	1407.6	1404.1	1401.6	1410.1	1402.8
177.5°	1412.2	1408.8	1406.2	1413.5	1406.2
180°	1410.1	1410.1	1410.1	1410.1	1410.1

TEST NUMBER: P922928

CATALOG NUMBER: DFN2DIP-SQ3F0-100D050US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.64	14.70	14.41	15.50	16.46	13.19	14.26	13.96	15.05	16.02
	3H	15.31	16.26	16.09	17.07	18.07	14.82	15.77	15.60	16.58	17.58
	4H	15.90	16.80	16.70	17.62	18.63	15.41	16.31	16.21	17.12	18.13
	6H	16.31	17.14	17.12	17.96	18.99	15.81	16.64	16.62	17.46	18.49
	8H	16.42	17.21	17.24	18.05	19.08	15.91	16.71	16.74	17.55	18.57
	12H	16.47	17.23	17.30	18.06	19.11	15.96	16.72	16.79	17.55	18.60
4H	2H	14.12	15.02	14.93	15.83	16.84	13.76	14.67	14.57	15.48	16.49
	3H	16.00	16.75	16.82	17.60	18.62	15.59	16.34	16.41	17.19	18.22
	4H	16.71	17.40	17.55	18.25	19.30	16.29	16.98	17.12	17.82	18.88
	6H	17.24	17.83	18.09	18.70	19.76	16.80	17.40	17.65	18.27	19.33
	8H	17.39	17.94	18.24	18.81	19.88	16.95	17.51	17.81	18.37	19.44
	12H	17.47	17.97	18.34	18.86	19.93	17.02	17.52	17.89	18.41	19.48
8H	4H	16.92	17.48	17.78	18.34	19.41	16.55	17.10	17.40	17.97	19.04
	6H	17.56	18.02	18.44	18.92	20.00	17.17	17.63	18.05	18.54	19.61
	8H	17.78	18.18	18.67	19.09	20.17	17.38	17.79	18.28	18.69	19.78
	12H	17.91	18.27	18.81	19.17	20.31	17.50	17.86	18.40	18.76	19.90
12H	4H	16.92	17.42	17.79	18.30	19.38	16.55	17.05	17.42	17.94	19.01
	6H	17.59	18.00	18.48	18.90	19.99	17.21	17.62	18.11	18.52	19.61
	8H	17.83	18.19	18.73	19.09	20.23	17.45	17.81	18.35	18.71	19.85

END OF REPORT