

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922941

Luminaire Tested: DFN2DIP-SQ3F0-100D080US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922941
REPORT IS A COMBINATION OF REPORTS P901465 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-100D080US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15890.3 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 158.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLLONL

Luminous Intensity Polar Plot

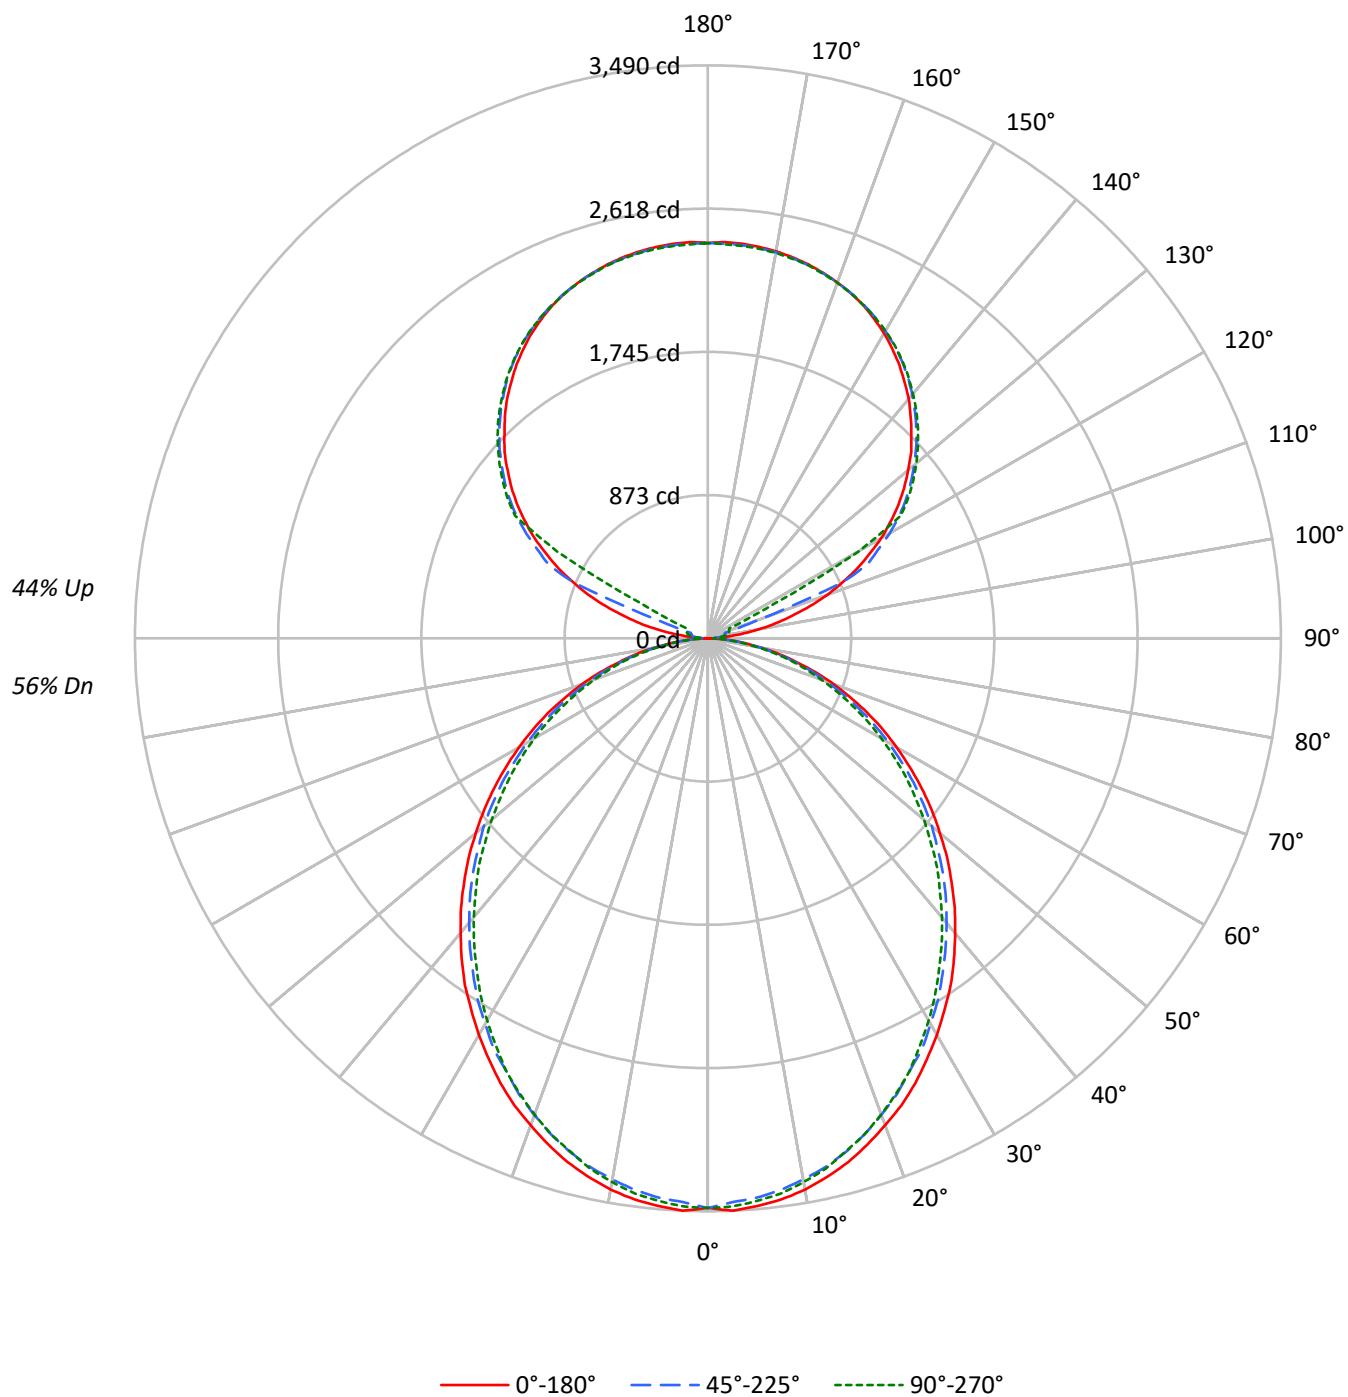

TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	76	71	84	77	72	67	66	62	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	46	43	42	39	37
4	75	64	56	50	70	60	53	48	52	47	42	45	40	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	34	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3976	3976	3976
5°	3979	3918	3945
10°	3945	3862	3891
15°	3884	3796	3806
20°	3803	3705	3719
25°	3723	3597	3619
30°	3622	3496	3492
35°	3527	3377	3358
40°	3410	3257	3230
45°	3293	3137	3100
50°	3166	3010	2948
55°	3032	2864	2809
60°	2880	2691	2649
65°	2714	2511	2460
70°	2503	2291	2257
75°	2212	2028	2068
80°	1859	1692	1709
85°	1308	1122	1118

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3293 cd/sqm

TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	2.1
10°-20°	918.8	5.8
20°-30°	1350.3	8.5
30°-40°	1568.3	9.9
40°-50°	1566.4	9.9
50°-60°	1365.8	8.6
60°-70°	1009.7	6.4
70°-80°	571.3	3.6
80°-90°	155.0	1.0
90°-100°	79.4	0.5
100°-110°	295.9	1.9
110°-120°	784.9	4.9
120°-130°	1301.8	8.2
130°-140°	1382.8	8.7
140°-150°	1285.1	8.1
150°-160°	1033.2	6.5
160°-170°	665.8	4.2
170°-180°	229.2	1.4
0°-30°	2595.7	16.3
0°-40°	4164.0	26.2
0°-60°	7096.2	44.7
0°-90°	8832.2	55.6
90°-120°	1160.2	7.3
90°-150°	5129.9	32.3
90°-180°	7058.0	44.4
0°-180°	15890.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	2	21	35	44	47	15
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1031	1075	268	143	986
125°	1416	1439	1472	1484	1489	1263
135°	1753	1780	1796	1814	1810	1354
145°	2033	2031	2061	2073	2064	1272
155°	2238	2223	2244	2254	2240	1032
165°	2359	2348	2354	2366	2354	666
175°	2413	2400	2404	2416	2399	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.6	41.8	45.3	47.0
95°	113.2	55.6	67.9	76.8	74.9
97.5°	203.8	61.0	88.7	94.2	95.8
100°	308.4	69.7	99.3	113.2	116.6
102.5°	423.3	419.9	102.8	121.8	127.2
105°	529.6	581.9	106.3	125.4	132.4
107.5°	653.3	696.7	109.9	128.9	135.9
110°	771.9	808.2	305.0	130.7	137.6



TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.3	914.5	885.0	134.0	139.5
115°	1001.7	1031.3	1074.9	268.3	142.9
117.5°	1104.5	1139.2	1169.0	919.7	463.4
120°	1219.5	1245.5	1277.0	1297.9	1062.7
122.5°	1316.9	1344.9	1379.8	1390.2	1392.0
125°	1416.2	1439.0	1472.0	1484.3	1489.4
127.5°	1506.8	1531.2	1557.6	1574.8	1576.5
130°	1592.2	1620.1	1639.2	1658.5	1656.8
132.5°	1679.4	1702.1	1721.2	1736.9	1735.2
135°	1752.6	1780.5	1796.0	1813.6	1810.1
137.5°	1829.2	1850.0	1867.6	1885.0	1879.8
140°	1904.0	1918.1	1937.2	1952.8	1944.1
142.5°	1966.9	1979.1	2001.6	2015.5	2006.8
145°	2033.1	2031.2	2060.8	2073.0	2064.3
147.5°	2090.4	2085.3	2114.8	2123.5	2116.7
150°	2146.3	2134.0	2162.0	2172.3	2163.6
152.5°	2193.3	2179.3	2205.4	2216.0	2203.8
155°	2238.5	2223.0	2243.9	2254.2	2240.4
157.5°	2275.1	2261.3	2277.0	2289.2	2275.1
160°	2306.6	2296.1	2306.6	2316.9	2304.7
162.5°	2334.3	2324.0	2332.6	2344.8	2329.1
165°	2358.8	2348.4	2353.6	2365.7	2353.6
167.5°	2377.9	2367.4	2372.8	2385.0	2369.3
170°	2393.7	2383.1	2386.7	2398.9	2383.1
172.5°	2404.1	2393.7	2397.2	2409.4	2393.7
175°	2412.7	2400.5	2404.1	2416.2	2398.9
177.5°	2416.2	2404.1	2405.8	2418.1	2402.4
180°	2407.5	2407.5	2407.5	2407.5	2407.5

TEST NUMBER: P922941

CATALOG NUMBER: DFN2DIP-SQ3F0-100D080US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.53	13.45	13.44	14.37	15.56	12.09	13.00	13.00	13.93	15.12
	3H	14.19	15.01	15.11	15.95	17.16	13.70	14.52	14.62	15.46	16.67
	4H	14.78	15.56	15.71	16.50	17.72	14.29	15.06	15.22	16.00	17.23
	6H	15.18	15.89	16.13	16.84	18.08	14.68	15.39	15.63	16.34	17.58
	8H	15.28	15.96	16.24	16.93	18.16	14.78	15.46	15.74	16.43	17.66
	12H	15.33	15.98	16.29	16.94	18.20	14.82	15.47	15.78	16.43	17.69
4H	2H	13.00	13.77	13.94	14.71	15.94	12.64	13.42	13.58	14.36	15.58
	3H	14.86	15.51	15.81	16.48	17.72	14.45	15.10	15.40	16.07	17.31
	4H	15.58	16.17	16.54	17.13	18.39	15.15	15.74	16.11	16.71	17.97
	6H	16.09	16.60	17.06	17.59	18.85	15.66	16.17	16.63	17.16	18.42
	8H	16.24	16.71	17.21	17.70	18.97	15.80	16.28	16.77	17.26	18.53
	12H	16.31	16.74	17.30	17.74	19.02	15.86	16.29	16.86	17.29	18.57
8H	4H	15.77	16.25	16.75	17.23	18.51	15.39	15.87	16.37	16.85	18.13
	6H	16.40	16.79	17.40	17.82	19.09	16.02	16.41	17.02	17.43	18.71
	8H	16.62	16.96	17.63	17.98	19.27	16.22	16.57	17.23	17.58	18.88
	12H	16.75	17.05	17.76	18.06	19.40	16.34	16.64	17.35	17.65	18.99
12H	4H	15.76	16.19	16.75	17.19	18.47	15.39	15.82	16.38	16.82	18.10
	6H	16.43	16.78	17.44	17.79	19.08	16.06	16.40	17.06	17.42	18.71
	8H	16.67	16.97	17.68	17.98	19.32	16.29	16.59	17.30	17.60	18.94

END OF REPORT