

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P922989

Luminaire Tested: DFN2DIP-SQ3F0-110D110US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P922989
REPORT IS A COMBINATION OF REPORTS P901521 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D110US940-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19421.5 lumens
Efficiency: N/A
Efficacy: 98.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 197.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLONL

Luminous Intensity Polar Plot

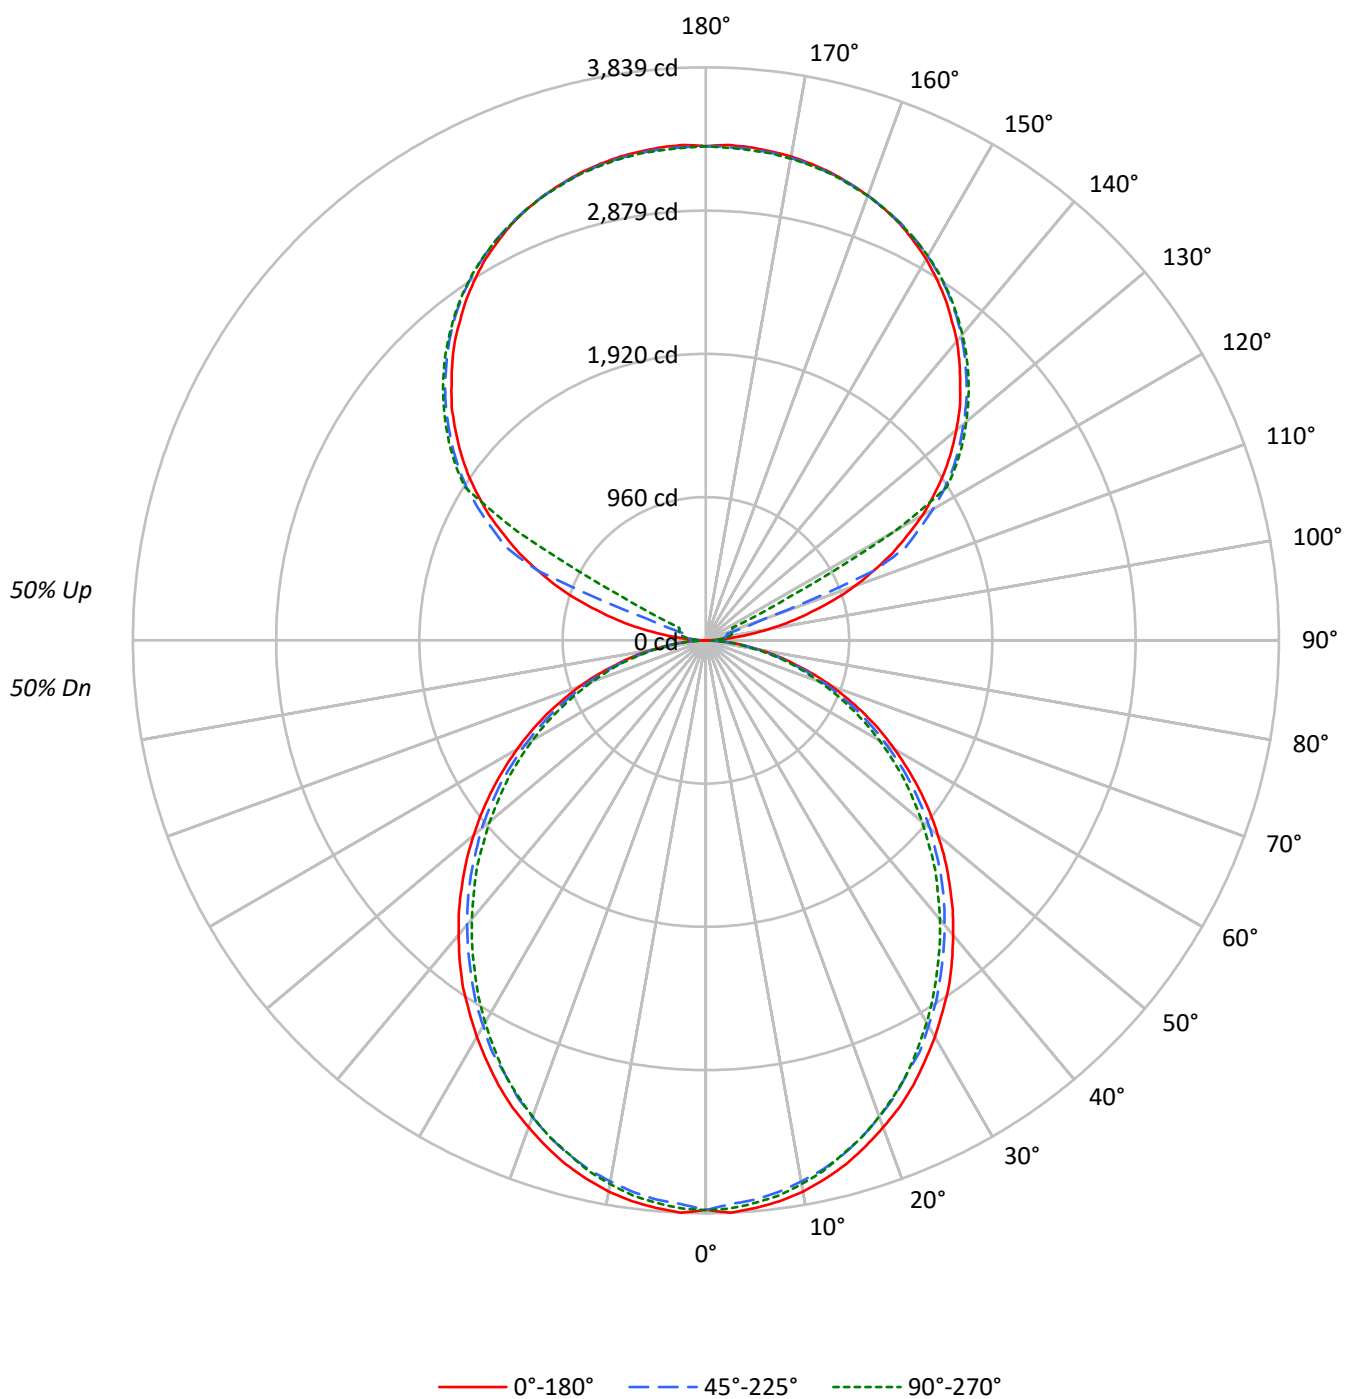

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4373	4373	4373
5°	4377	4309	4340
10°	4339	4248	4280
15°	4273	4175	4186
20°	4183	4075	4091
25°	4095	3956	3981
30°	3984	3845	3841
35°	3880	3715	3694
40°	3751	3583	3553
45°	3623	3450	3409
50°	3482	3311	3243
55°	3335	3150	3089
60°	3168	2960	2914
65°	2985	2762	2706
70°	2753	2520	2483
75°	2433	2231	2274
80°	2045	1861	1880
85°	1439	1233	1230

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3623 cd/sqm

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	1.8
10°-20°	1010.7	5.2
20°-30°	1485.4	7.6
30°-40°	1725.2	8.9
40°-50°	1723.0	8.9
50°-60°	1502.4	7.7
60°-70°	1110.6	5.7
70°-80°	628.4	3.2
80°-90°	171.7	0.9
90°-100°	109.2	0.6
100°-110°	406.9	2.1
110°-120°	1079.2	5.6
120°-130°	1789.9	9.2
130°-140°	1901.3	9.8
140°-150°	1767.1	9.1
150°-160°	1420.7	7.3
160°-170°	915.4	4.7
170°-180°	315.1	1.6
0°-30°	2855.3	14.7
0°-40°	4580.5	23.6
0°-60°	7805.9	40.2
0°-90°	9716.6	50.0
90°-120°	1595.3	8.2
90°-150°	7053.7	36.3
90°-180°	9705.0	50.0
0°-180°	19421.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	2	29	48	60	65	18
95°	156	76	93	106	103	184
105°	728	800	146	172	182	778
115°	1377	1418	1478	369	196	1356
125°	1947	1979	2024	2041	2048	1737
135°	2410	2448	2470	2494	2489	1862
145°	2796	2793	2834	2850	2838	1748
155°	3078	3057	3085	3100	3080	1418
165°	3243	3229	3236	3253	3236	916
175°	3317	3301	3306	3322	3298	316
180°	3310	3310	3310	3310	3310	

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	2.3	28.7	47.8	60.0	64.6
92.5°	60.0	50.4	57.4	62.3	64.6
95°	155.6	76.5	93.3	105.5	103.0
97.5°	280.2	83.9	122.0	129.4	131.7
100°	424.1	95.9	136.5	155.6	160.4
102.5°	581.9	577.4	141.3	167.6	175.0
105°	728.2	800.1	146.2	172.4	182.1
107.5°	898.3	958.0	151.1	177.2	186.9
110°	1061.2	1111.3	419.3	179.8	189.1

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1214.6	1257.5	1216.8	184.3	191.7
115°	1377.2	1417.9	1478.0	368.9	196.5
117.5°	1518.7	1566.5	1607.4	1264.6	637.1
120°	1676.8	1712.6	1755.9	1784.6	1461.2
122.5°	1810.8	1849.1	1897.2	1911.5	1914.1
125°	1947.3	1978.6	2024.1	2040.9	2048.0
127.5°	2071.9	2105.4	2141.5	2165.4	2167.7
130°	2189.3	2227.8	2253.9	2280.4	2278.1
132.5°	2309.1	2340.4	2366.6	2388.2	2385.9
135°	2409.8	2448.2	2469.5	2493.8	2488.9
137.5°	2515.1	2543.8	2567.9	2591.8	2584.7
140°	2618.1	2637.3	2663.5	2685.1	2673.2
142.5°	2704.5	2721.2	2752.3	2771.3	2759.4
145°	2795.5	2792.9	2833.6	2850.4	2838.5
147.5°	2874.3	2867.2	2907.9	2919.8	2910.5
150°	2951.1	2934.4	2972.7	2987.0	2975.0
152.5°	3015.7	2996.6	3032.4	3047.0	3030.2
155°	3078.0	3056.6	3085.3	3099.6	3080.5
157.5°	3128.3	3109.2	3130.9	3147.6	3128.3
160°	3171.5	3157.0	3171.5	3185.7	3169.0
162.5°	3209.6	3195.4	3207.4	3224.2	3202.6
165°	3243.2	3229.0	3236.1	3252.9	3236.1
167.5°	3269.6	3255.2	3262.6	3279.4	3257.8
170°	3291.3	3276.8	3281.6	3298.4	3276.8
172.5°	3305.5	3291.3	3296.1	3312.9	3291.3
175°	3317.4	3300.7	3305.5	3322.3	3298.4
177.5°	3322.3	3305.5	3308.1	3324.8	3303.3
180°	3310.4	3310.4	3310.4	3310.4	3310.4

TEST NUMBER: P922989

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US940-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.37	13.23	13.32	14.20	15.47	11.92	12.78	12.88	13.76	15.03
	3H	14.02	14.80	14.99	15.78	17.07	13.53	14.31	14.50	15.29	16.58
	4H	14.61	15.34	15.59	16.32	17.63	14.11	14.85	15.10	15.83	17.13
	6H	15.00	15.68	16.00	16.67	17.98	14.50	15.18	15.50	16.17	17.48
	8H	15.11	15.75	16.11	16.76	18.07	14.61	15.25	15.60	16.25	17.57
	12H	15.15	15.76	16.16	16.77	18.10	14.64	15.25	15.65	16.26	17.59
4H	2H	12.82	13.56	13.81	14.54	15.84	12.47	13.20	13.46	14.19	15.49
	3H	14.69	15.30	15.68	16.31	17.63	14.28	14.89	15.27	15.90	17.22
	4H	15.40	15.95	16.40	16.96	18.30	14.97	15.53	15.98	16.54	17.88
	6H	15.91	16.39	16.92	17.42	18.75	15.47	15.95	16.49	16.99	18.32
	8H	16.05	16.50	17.07	17.53	18.88	15.62	16.07	16.63	17.09	18.44
	12H	16.12	16.53	17.16	17.57	18.93	15.68	16.08	16.71	17.12	18.48
8H	4H	15.59	16.04	16.61	17.06	18.41	15.21	15.66	16.23	16.68	18.03
	6H	16.21	16.58	17.26	17.65	19.00	15.83	16.20	16.87	17.27	18.61
	8H	16.43	16.76	17.48	17.81	19.18	16.04	16.36	17.09	17.42	18.78
	12H	16.56	16.85	17.61	17.89	19.30	16.15	16.44	17.20	17.48	18.89
12H	4H	15.57	15.98	16.61	17.02	18.37	15.20	15.61	16.24	16.65	18.01
	6H	16.24	16.57	17.29	17.62	18.99	15.87	16.20	16.92	17.25	18.61
	8H	16.48	16.77	17.53	17.81	19.22	16.10	16.39	17.15	17.43	18.84

END OF REPORT