

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923011

Luminaire Tested: DFN2DIP-SQ3F0-120D070US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923011
REPORT IS A COMBINATION OF REPORTS P901452 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D070US940-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15275.0 lumens
Efficiency: N/A
Efficacy: 85.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 178.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLLONL

Luminous Intensity Polar Plot

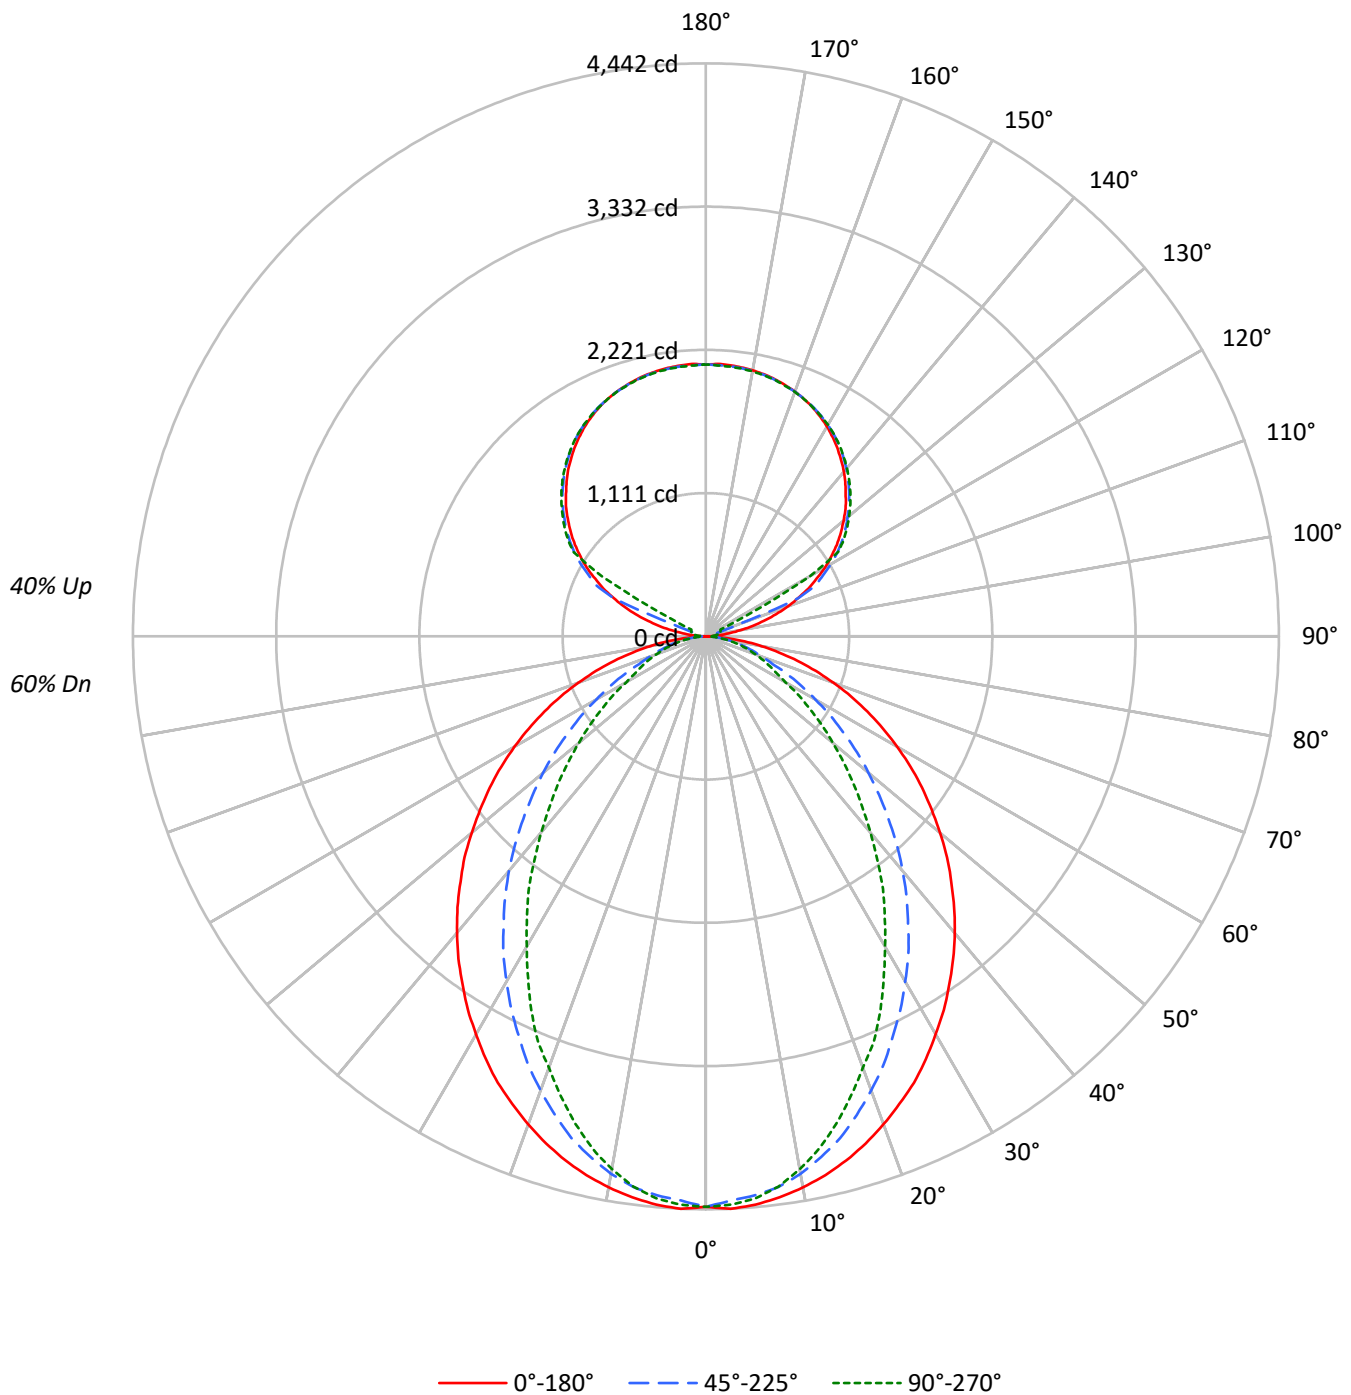

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	89	89	89	76	76	76	65	65	65
1	101	96	93	89	94	90	87	84	79	76	74	68	66	65	58	57	56
2	92	85	79	74	86	80	74	70	70	66	62	60	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	50	47	47	44	42
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	67	56	49	44	50	44	40	44	39	36	38	35	32
6	66	54	46	40	62	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5067	5067	5067
5°	5072	4984	5017
10°	5019	4882	4852
15°	4946	4718	4598
20°	4852	4492	4287
25°	4755	4240	3987
30°	4626	3982	3607
35°	4499	3704	3273
40°	4370	3418	2890
45°	4221	3100	2543
50°	4066	2779	2205
55°	3903	2438	1880
60°	3716	2080	1546
65°	3499	1718	1389
70°	3237	1380	1254
75°	2906	1209	1138
80°	2428	1004	981
85°	1647	654	728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4221 cd/sqm

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.5	2.7
10°-20°	1137.8	7.4
20°-30°	1597.5	10.5
30°-40°	1741.4	11.4
40°-50°	1600.5	10.5
50°-60°	1256.9	8.2
60°-70°	818.2	5.4
70°-80°	421.2	2.8
80°-90°	111.2	0.7
90°-100°	69.5	0.5
100°-110°	259.0	1.7
110°-120°	686.8	4.5
120°-130°	1139.1	7.5
130°-140°	1209.9	7.9
140°-150°	1124.5	7.4
150°-160°	904.1	5.9
160°-170°	582.6	3.8
170°-180°	200.5	1.3
0°-30°	3149.8	20.6
0°-40°	4891.2	32.0
0°-60°	7748.6	50.7
0°-90°	9099.1	59.6
90°-120°	1015.2	6.6
90°-150°	4488.7	29.4
90°-180°	6176.0	40.4
0°-180°	15275.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4422	4422	4422	4422	4422	
5°	4422	4403	4350	4386	4375	419
15°	4206	4162	4026	3950	3910	1185
25°	3818	3690	3426	3262	3202	1756
35°	3290	3086	2734	2482	2393	2059
45°	2690	2421	2001	1717	1621	2077
55°	2045	1733	1301	1061	985	1827
65°	1381	1056	696	560	548	1369
75°	736	456	320	292	288	779
85°	172	88	76	76	76	197
90°	1	18	30	38	41	14
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4422.5	4422.5	4422.5	4422.5	4422.5
2.5°	4442.5	4422.5	4378.4	4418.7	4410.6
5°	4422.5	4402.6	4350.3	4386.4	4374.6
7.5°	4386.4	4362.6	4306.6	4322.3	4302.3
10°	4338.4	4310.4	4230.5	4218.2	4194.5
12.5°	4278.5	4242.5	4134.1	4110.4	4066.3
15°	4206.4	4162.2	4026.3	3950.3	3910.4
17.5°	4122.3	4058.2	3890.0	3802.2	3738.0
20°	4026.3	3946.1	3746.1	3646.3	3557.9
22.5°	3922.3	3830.2	3597.9	3462.0	3402.1
25°	3818.3	3690.0	3425.9	3262.0	3201.7
27.5°	3694.3	3557.9	3265.8	3077.7	2985.5
30°	3562.2	3409.8	3089.6	2885.8	2777.5
32.5°	3434.0	3249.7	2921.9	2681.6	2581.3
35°	3290.1	3085.8	2733.7	2481.5	2393.2
37.5°	3149.9	2929.5	2557.5	2281.1	2181.3
40°	3001.7	2761.8	2373.3	2089.2	1985.1
42.5°	2849.6	2593.6	2189.4	1893.0	1793.2
45°	2689.6	2421.3	2001.3	1716.8	1620.8
47.5°	2537.5	2253.5	1821.2	1536.8	1448.9
50°	2369.5	2085.4	1645.0	1368.6	1285.0
52.5°	2205.1	1904.9	1476.9	1212.7	1136.8
55°	2045.0	1732.9	1300.6	1060.7	984.7
57.5°	1881.1	1560.9	1144.8	920.6	856.5
60°	1713.0	1392.8	980.4	776.7	712.6
62.5°	1549.1	1228.9	840.3	648.5	616.5
65°	1380.9	1056.5	696.4	560.5	548.2
67.5°	1220.8	896.3	560.5	492.1	480.3
70°	1052.7	740.6	464.1	424.2	408.0
72.5°	892.6	596.2	388.1	356.2	348.2
75°	736.3	456.0	320.2	292.1	288.3
77.5°	580.5	324.0	252.3	236.1	228.0
80°	436.1	232.3	191.9	176.2	176.2
82.5°	304.1	156.2	132.1	123.9	123.9
85°	172.0	87.9	76.0	76.0	76.0
87.5°	64.1	31.8	31.8	28.0	28.0
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P923011

CATALOG NUMBER: DFN2DIP-SQ3F0-120D070US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.60	14.52	14.48	15.41	16.54	9.56	10.48	10.44	11.37	12.50
	3H	15.28	16.10	16.17	17.00	18.16	10.75	11.57	11.64	12.47	13.63
	4H	15.89	16.66	16.80	17.57	18.74	11.20	11.97	12.11	12.88	14.05
	6H	16.31	17.02	17.23	17.94	19.12	11.52	12.23	12.44	13.15	14.32
	8H	16.44	17.11	17.36	18.05	19.23	11.61	12.29	12.53	13.22	14.40
	12H	16.50	17.14	17.43	18.07	19.27	11.65	12.30	12.58	13.22	14.42
4H	2H	13.63	14.40	14.54	15.31	16.47	10.16	10.94	11.08	11.85	13.01
	3H	15.46	16.10	16.38	17.04	18.22	11.52	12.16	12.44	13.10	14.28
	4H	16.15	16.73	17.08	17.67	18.88	12.06	12.65	12.99	13.58	14.79
	6H	16.67	17.17	17.61	18.13	19.34	12.48	12.98	13.42	13.94	15.15
	8H	16.84	17.31	17.79	18.26	19.48	12.60	13.07	13.55	14.03	15.25
	12H	16.94	17.36	17.90	18.33	19.56	12.67	13.09	13.64	14.06	15.29
8H	4H	16.12	16.59	17.07	17.55	18.77	12.34	12.81	13.29	13.77	14.99
	6H	16.69	17.07	17.66	18.07	19.29	12.86	13.25	13.83	14.24	15.46
	8H	16.90	17.24	17.88	18.23	19.46	13.04	13.39	14.03	14.37	15.61
	12H	17.04	17.34	18.02	18.32	19.60	13.16	13.46	14.15	14.44	15.73
12H	4H	16.08	16.50	17.04	17.47	18.70	12.35	12.78	13.32	13.75	14.97
	6H	16.66	17.00	17.64	17.99	19.23	12.91	13.25	13.89	14.23	15.47
	8H	16.88	17.18	17.87	18.16	19.45	13.11	13.42	14.10	14.39	15.68

END OF REPORT