

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923026

Luminaire Tested: DFN2DIP-SQ3F0-120D110US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923026
REPORT IS A COMBINATION OF REPORTS P900004 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D110US940-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17776.2 lumens
Efficiency: N/A
Efficacy: 84.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 211.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLLFLL

Luminous Intensity Polar Plot

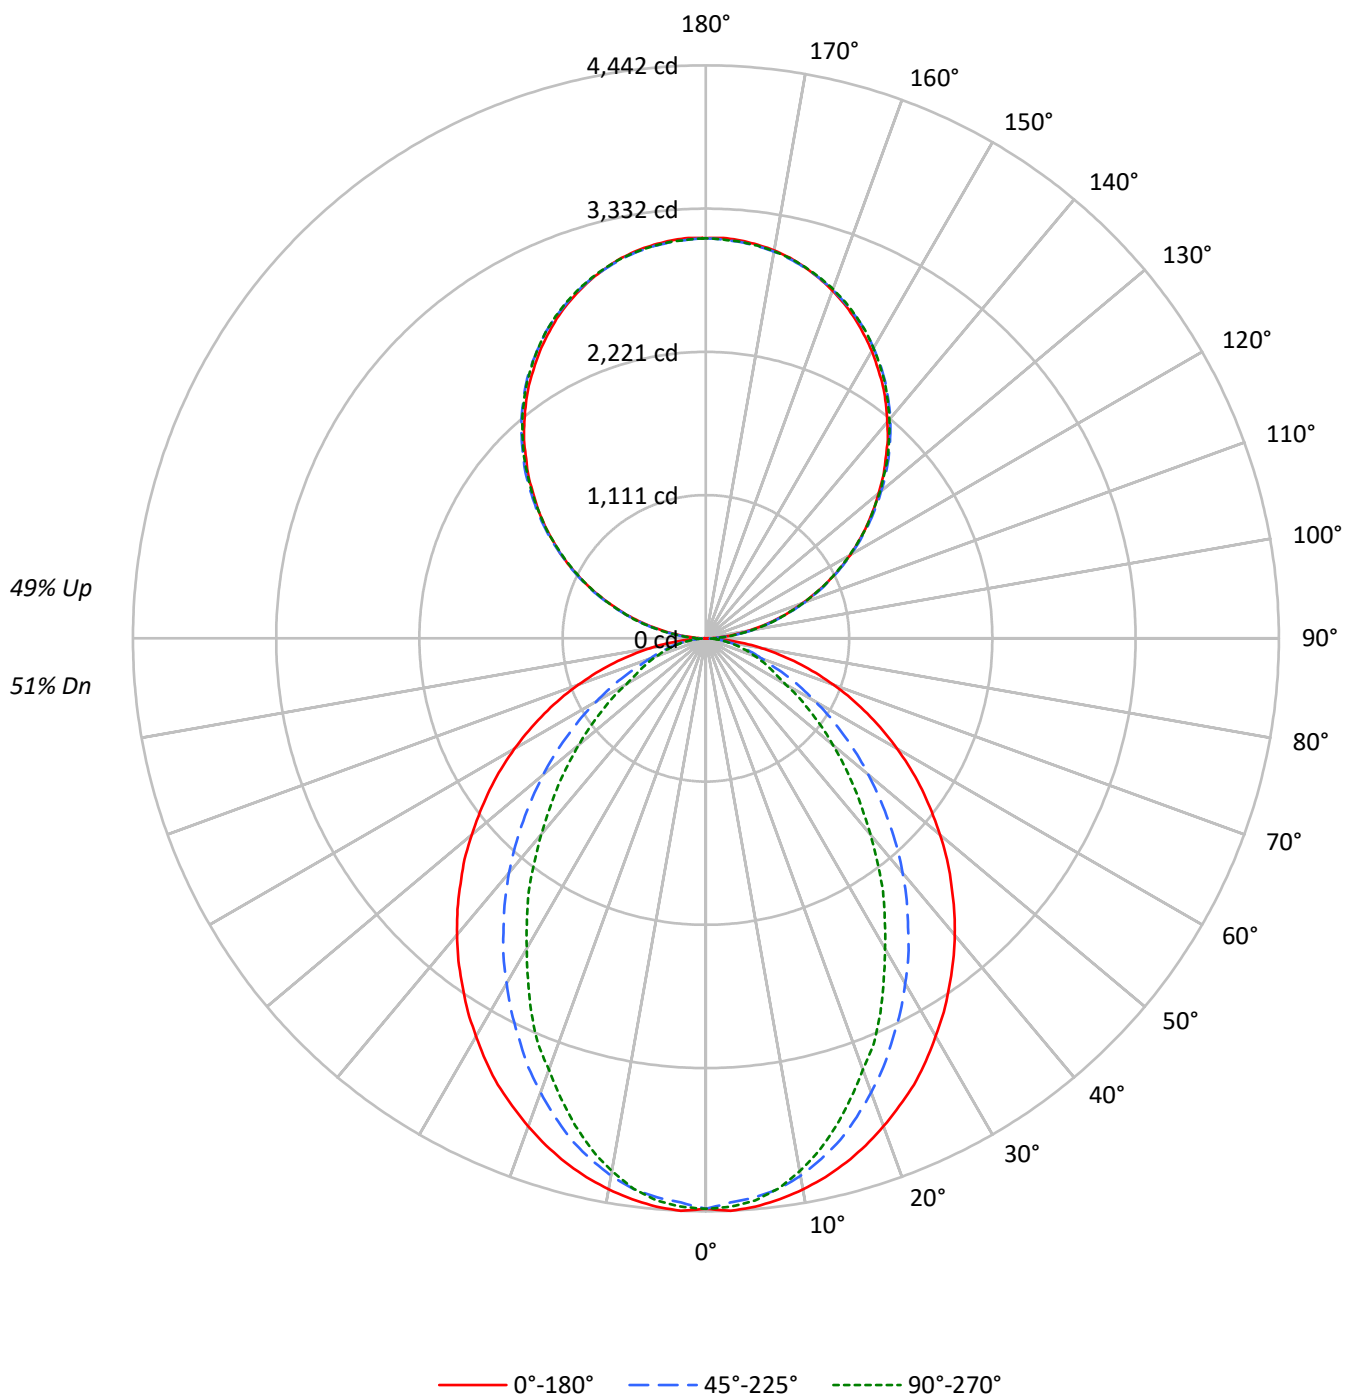

TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	99	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	68	66	62	59	55	53	50	46	44	42
3	83	73	66	61	76	68	62	57	58	54	50	49	46	43	41	39	37
4	76	65	58	52	70	61	54	49	52	47	43	44	41	37	37	34	32
5	70	58	51	45	64	54	47	42	47	42	37	40	36	33	34	31	28
6	64	53	45	39	59	49	42	37	43	37	33	36	32	29	31	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	31	26	23	26	23	20
9	52	40	32	27	48	37	31	26	33	27	24	28	24	21	24	21	18
10	48	37	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5067	5067	5067
5°	5072	4984	5017
10°	5019	4882	4852
15°	4946	4718	4598
20°	4852	4492	4287
25°	4755	4240	3987
30°	4626	3982	3607
35°	4499	3704	3273
40°	4370	3418	2890
45°	4221	3100	2543
50°	4066	2779	2205
55°	3903	2438	1880
60°	3716	2080	1546
65°	3499	1718	1389
70°	3237	1380	1254
75°	2906	1209	1138
80°	2428	1004	981
85°	1647	654	728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4221 cd/sqm

TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	414.5	2.3
10°-20°	1137.8	6.4
20°-30°	1597.5	9.0
30°-40°	1741.4	9.8
40°-50°	1600.5	9.0
50°-60°	1256.9	7.1
60°-70°	818.2	4.6
70°-80°	421.2	2.4
80°-90°	116.3	0.7
90°-100°	192.0	1.1
100°-110°	609.9	3.4
110°-120°	1043.8	5.9
120°-130°	1372.7	7.7
130°-140°	1540.8	8.7
140°-150°	1511.0	8.5
150°-160°	1267.5	7.1
160°-170°	840.6	4.7
170°-180°	293.8	1.7
0°-30°	3149.8	17.7
0°-40°	4891.2	27.5
0°-60°	7748.6	43.6
0°-90°	9104.3	51.2
90°-120°	1845.7	10.4
90°-150°	6270.1	35.3
90°-180°	8672.0	48.8
0°-180°	17776.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4422	4422	4422	4422	4422	
5°	4422	4403	4350	4386	4375	419
15°	4206	4162	4026	3950	3910	1185
25°	3818	3690	3426	3262	3202	1756
35°	3290	3086	2734	2482	2393	2059
45°	2690	2421	2001	1717	1621	2077
55°	2045	1733	1301	1061	985	1827
65°	1381	1056	696	560	548	1369
75°	736	456	320	292	288	779
85°	172	88	76	76	76	197
90°	3	34	92	86	89	17
95°	136	163	167	167	163	152
105°	563	570	576	581	581	594
115°	1048	1062	1058	1055	1048	1036
125°	1524	1547	1539	1531	1528	1361
135°	1970	2000	2005	2002	1995	1523
145°	2392	2411	2426	2429	2418	1495
155°	2736	2743	2752	2765	2756	1259
165°	2976	2973	2973	2992	2979	840
175°	3097	3089	3083	3102	3086	294
180°	3102	3102	3102	3102	3102	



TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4422.5	4422.5	4422.5	4422.5	4422.5
2.5°	4442.5	4422.5	4378.4	4418.7	4410.6
5°	4422.5	4402.6	4350.3	4386.4	4374.6
7.5°	4386.4	4362.6	4306.6	4322.3	4302.3
10°	4338.4	4310.4	4230.5	4218.2	4194.5
12.5°	4278.5	4242.5	4134.1	4110.4	4066.3
15°	4206.4	4162.2	4026.3	3950.3	3910.4
17.5°	4122.3	4058.2	3890.0	3802.2	3738.0
20°	4026.3	3946.1	3746.1	3646.3	3557.9
22.5°	3922.3	3830.2	3597.9	3462.0	3402.1
25°	3818.3	3690.0	3425.9	3262.0	3201.7
27.5°	3694.3	3557.9	3265.8	3077.7	2985.5
30°	3562.2	3409.8	3089.6	2885.8	2777.5
32.5°	3434.0	3249.7	2921.9	2681.6	2581.3
35°	3290.1	3085.8	2733.7	2481.5	2393.2
37.5°	3149.9	2929.5	2557.5	2281.1	2181.3
40°	3001.7	2761.8	2373.3	2089.2	1985.1
42.5°	2849.6	2593.6	2189.4	1893.0	1793.2
45°	2689.6	2421.3	2001.3	1716.8	1620.8
47.5°	2537.5	2253.5	1821.2	1536.8	1448.9
50°	2369.5	2085.4	1645.0	1368.6	1285.0
52.5°	2205.1	1904.9	1476.9	1212.7	1136.8
55°	2045.0	1732.9	1300.6	1060.7	984.7
57.5°	1881.1	1560.9	1144.8	920.6	856.5
60°	1713.0	1392.8	980.4	776.7	712.6
62.5°	1549.1	1228.9	840.3	648.5	616.5
65°	1380.9	1056.5	696.4	560.5	548.2
67.5°	1220.8	896.3	560.5	492.1	480.3
70°	1052.7	740.6	464.1	424.2	408.0
72.5°	892.6	596.2	388.1	356.2	348.2
75°	736.3	456.0	320.2	292.1	288.3
77.5°	580.5	324.0	252.3	236.1	228.0
80°	436.1	232.3	191.9	176.2	176.2
82.5°	304.1	156.2	132.1	123.9	123.9
85°	172.0	87.9	76.0	76.0	76.0
87.5°	64.1	31.8	31.8	28.0	28.0
90°	2.8	33.7	91.7	86.1	88.8
92.5°	58.0	78.6	81.3	84.2	84.2
95°	136.5	162.7	167.4	167.4	162.7
97.5°	227.3	251.6	261.9	261.9	261.9
100°	332.0	353.5	361.0	361.0	358.2
102.5°	442.4	458.2	468.6	471.4	468.6
105°	563.0	570.5	576.1	580.8	580.8
107.5°	682.7	693.9	693.9	695.8	682.7
110°	798.7	813.7	813.7	813.7	806.2

TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	924.0	939.9	937.1	929.6	924.0
115°	1047.5	1062.4	1057.7	1055.0	1047.5
117.5°	1170.0	1190.5	1177.4	1170.0	1162.5
120°	1293.4	1314.0	1293.4	1293.4	1285.0
122.5°	1405.7	1431.8	1418.7	1411.2	1405.7
125°	1523.5	1546.8	1539.4	1531.0	1528.1
127.5°	1638.5	1667.5	1657.2	1646.0	1638.5
130°	1746.1	1779.8	1775.0	1769.4	1759.2
132.5°	1866.7	1892.9	1894.8	1881.7	1874.2
135°	1970.5	1999.5	2005.1	2002.3	1994.8
137.5°	2086.5	2109.9	2114.5	2112.6	2101.5
140°	2188.4	2211.8	2224.9	2224.9	2214.7
142.5°	2293.2	2316.6	2324.1	2326.8	2316.6
145°	2392.3	2411.0	2426.0	2428.8	2418.5
147.5°	2481.2	2504.5	2515.8	2520.4	2510.2
150°	2572.9	2588.7	2599.0	2607.5	2599.0
152.5°	2654.2	2670.0	2683.2	2693.5	2683.2
155°	2735.6	2743.0	2751.5	2764.6	2756.1
157.5°	2805.7	2811.3	2815.9	2834.7	2821.5
160°	2868.4	2874.0	2876.7	2892.7	2881.5
162.5°	2926.3	2926.3	2929.2	2946.9	2933.8
165°	2975.9	2973.1	2973.1	2991.8	2978.7
167.5°	3020.8	3012.4	3012.4	3031.1	3018.0
170°	3054.5	3047.0	3044.2	3062.8	3047.0
172.5°	3077.8	3070.3	3067.6	3086.3	3070.3
175°	3096.6	3089.1	3083.4	3102.2	3086.3
177.5°	3106.8	3099.3	3093.7	3109.7	3093.7
180°	3102.2	3102.2	3102.2	3102.2	3102.2

TEST NUMBER: P923026

CATALOG NUMBER: DFN2DIP-SQ3F0-120D110US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.86	13.70	13.82	14.67	15.92	8.82	9.66	9.78	10.63	11.88
	3H	14.54	15.29	15.50	16.26	17.54	10.01	10.76	10.97	11.73	13.01
	4H	15.14	15.85	16.12	16.83	18.12	10.45	11.16	11.43	12.14	13.43
	6H	15.56	16.21	16.55	17.20	18.50	10.77	11.42	11.76	12.41	13.71
	8H	15.69	16.31	16.68	17.31	18.60	10.86	11.48	11.85	12.48	13.77
	12H	15.75	16.34	16.75	17.33	18.65	10.90	11.49	11.90	12.48	13.80
4H	2H	12.88	13.59	13.87	14.57	15.86	9.42	10.13	10.40	11.11	12.39
	3H	14.71	15.30	15.70	16.30	17.60	10.76	11.35	11.76	12.36	13.66
	4H	15.39	15.93	16.40	16.93	18.26	11.30	11.84	12.31	12.84	14.17
	6H	15.91	16.37	16.92	17.39	18.72	11.72	12.18	12.73	13.20	14.53
	8H	16.08	16.51	17.09	17.53	18.86	11.84	12.27	12.86	13.29	14.63
	12H	16.17	16.56	17.20	17.59	18.94	11.90	12.29	12.94	13.33	14.67
8H	4H	15.36	15.79	16.38	16.81	18.15	11.58	12.02	12.60	13.03	14.37
	6H	15.92	16.28	16.96	17.34	18.67	12.09	12.45	13.13	13.51	14.84
	8H	16.14	16.45	17.18	17.49	18.85	12.28	12.59	13.33	13.64	14.99
	12H	16.27	16.55	17.32	17.59	18.98	12.39	12.67	13.44	13.71	15.11
12H	4H	15.31	15.70	16.35	16.74	18.08	11.59	11.98	12.62	13.01	14.35
	6H	15.90	16.21	16.94	17.26	18.61	12.14	12.46	13.19	13.50	14.85
	8H	16.11	16.39	17.16	17.43	18.83	12.35	12.62	13.39	13.66	15.06

END OF REPORT