

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925498

Luminaire Tested: DFN2DIP-SQ3F0-050D100US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925498
REPORT IS A COMBINATION OF REPORTS P899972 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D100US950-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12497.5 lumens
Efficiency: N/A
Efficacy: 104.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLLFLL

Luminous Intensity Polar Plot

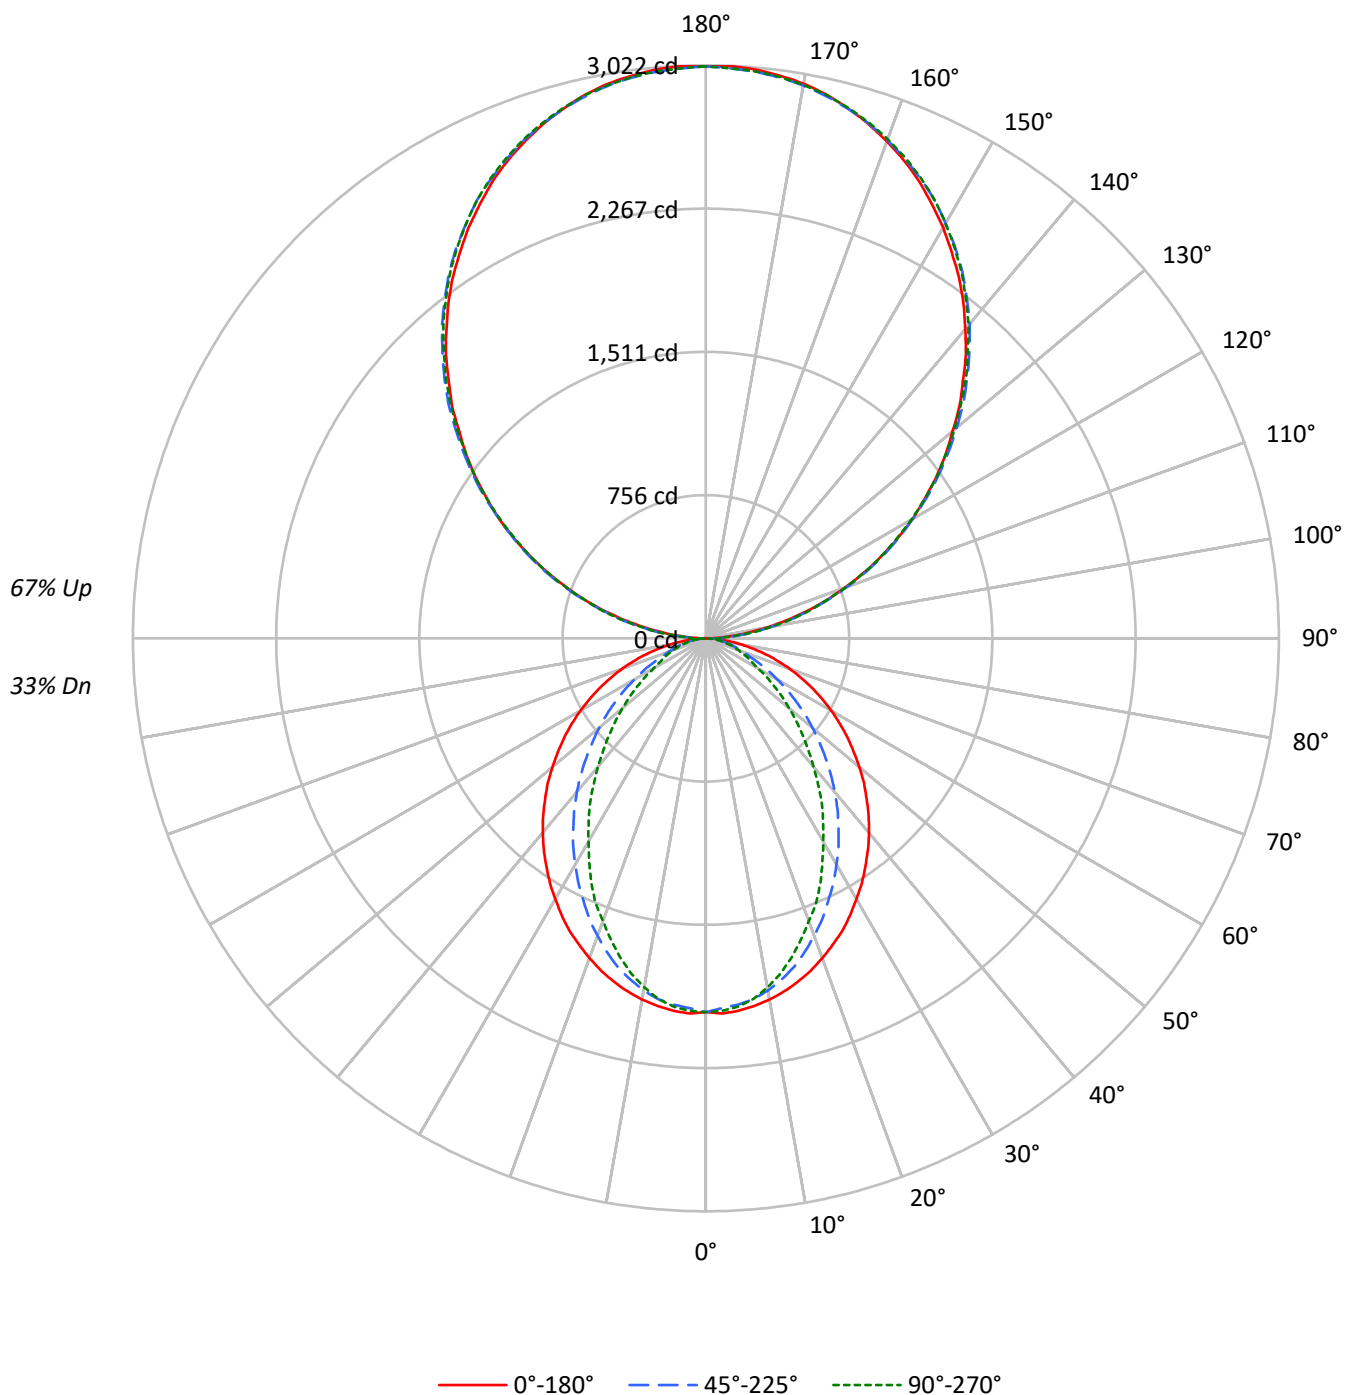

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	79	73	68	77	71	67	62	57	54	51	44	42	40	32	31	29
3	79	70	63	57	71	63	57	52	51	46	43	39	36	34	29	27	25
4	72	62	54	49	65	56	50	45	45	41	37	35	32	29	26	24	22
5	66	55	47	42	59	50	43	38	40	36	32	32	28	26	23	21	19
6	61	49	42	36	55	45	38	33	36	32	28	29	25	23	21	19	17
7	56	45	37	32	51	41	34	29	33	28	25	26	23	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	16	14
9	49	37	30	25	44	34	27	23	28	23	20	22	19	16	17	14	13
10	45	34	27	22	41	31	25	21	25	21	18	20	17	15	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2259	2259	2259
5°	2261	2222	2237
10°	2237	2176	2163
15°	2205	2103	2050
20°	2163	2003	1911
25°	2120	1890	1777
30°	2062	1775	1608
35°	2006	1651	1459
40°	1948	1523	1288
45°	1881	1382	1134
50°	1812	1239	983
55°	1740	1086	838
60°	1656	927	689
65°	1560	766	619
70°	1443	615	559
75°	1296	539	507
80°	1082	448	437
85°	734	292	325

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3034 cd/sqm

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.5
10°-20°	507.2	4.1
20°-30°	712.1	5.7
30°-40°	776.3	6.2
40°-50°	713.5	5.7
50°-60°	560.3	4.5
60°-70°	364.7	2.9
70°-80°	187.7	1.5
80°-90°	56.5	0.5
90°-100°	186.7	1.5
100°-110°	593.2	4.7
110°-120°	1015.2	8.1
120°-130°	1335.1	10.7
130°-140°	1498.6	12.0
140°-150°	1469.5	11.8
150°-160°	1232.7	9.9
160°-170°	817.5	6.5
170°-180°	285.7	2.3
0°-30°	1404.1	11.2
0°-40°	2180.4	17.4
0°-60°	3454.1	27.6
0°-90°	4063.1	32.5
90°-120°	1795.1	14.4
90°-150°	6098.3	48.8
90°-180°	8434.0	67.5
0°-180°	12497.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	3	33	89	84	86	12
95°	133	158	163	163	158	148
105°	548	555	560	565	565	578
115°	1019	1033	1029	1026	1019	1008
125°	1482	1504	1497	1489	1486	1324
135°	1916	1945	1950	1948	1940	1481
145°	2327	2345	2360	2362	2352	1454
155°	2661	2668	2676	2689	2680	1225
165°	2894	2892	2892	2910	2897	817
175°	3012	3004	2999	3017	3002	286
180°	3017	3017	3017	3017	3017	

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	2.8	32.7	89.1	83.7	86.4
92.5°	56.4	76.4	79.2	81.9	81.9
95°	132.8	158.3	162.8	162.8	158.3
97.5°	221.0	244.7	254.7	254.7	254.7
100°	322.9	343.8	351.1	351.1	348.4
102.5°	430.3	445.7	455.7	458.4	455.7
105°	547.6	554.8	560.3	564.9	564.9
107.5°	664.0	675.0	675.0	676.8	664.0
110°	776.8	791.3	791.3	791.3	784.1

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	898.7	914.1	911.5	904.1	898.7
115°	1018.8	1033.3	1028.8	1026.0	1018.8
117.5°	1137.9	1158.0	1145.2	1137.9	1130.6
120°	1257.9	1278.0	1257.9	1257.9	1249.8
122.5°	1367.1	1392.6	1379.9	1372.6	1367.1
125°	1481.8	1504.5	1497.2	1489.0	1486.3
127.5°	1593.7	1621.8	1611.8	1600.9	1593.7
130°	1698.2	1730.9	1726.5	1720.9	1711.0
132.5°	1815.6	1841.0	1842.8	1830.2	1822.8
135°	1916.5	1944.7	1950.2	1947.5	1940.1
137.5°	2029.3	2052.1	2056.6	2054.8	2043.8
140°	2128.5	2151.2	2164.0	2164.0	2153.9
142.5°	2230.4	2253.1	2260.3	2263.1	2253.1
145°	2326.7	2344.9	2359.5	2362.2	2352.2
147.5°	2413.1	2435.9	2446.8	2451.4	2441.4
150°	2502.3	2517.8	2527.8	2535.9	2527.8
152.5°	2581.4	2596.9	2609.7	2619.7	2609.7
155°	2660.6	2667.9	2676.1	2688.8	2680.5
157.5°	2728.8	2734.3	2738.8	2757.0	2744.3
160°	2789.8	2795.2	2797.9	2813.3	2802.5
162.5°	2846.2	2846.2	2848.8	2866.1	2853.4
165°	2894.3	2891.6	2891.6	2909.8	2897.1
167.5°	2938.0	2929.8	2929.8	2948.1	2935.3
170°	2970.8	2963.5	2960.7	2979.0	2963.5
172.5°	2993.5	2986.2	2983.4	3001.7	2986.2
175°	3011.7	3004.4	2999.0	3017.1	3001.7
177.5°	3021.7	3014.4	3008.9	3024.4	3008.9
180°	3017.1	3017.1	3017.1	3017.1	3017.1

TEST NUMBER: P925498

CATALOG NUMBER: DFN2DIP-SQ3F0-050D100US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.04	8.75	9.14	9.84	11.34	4.00	4.71	5.10	5.80	7.31
	3H	9.71	10.34	10.81	11.44	12.96	5.18	5.81	6.28	6.91	8.43
	4H	10.31	10.90	11.42	12.01	13.53	5.62	6.21	6.73	7.32	8.84
	6H	10.72	11.27	11.84	12.37	13.91	5.92	6.47	7.05	7.58	9.12
	8H	10.84	11.36	11.97	12.48	14.01	6.01	6.53	7.14	7.65	9.18
	12H	10.89	11.39	12.03	12.50	14.06	6.04	6.54	7.18	7.66	9.21
4H	2H	8.04	8.64	9.17	9.74	11.27	4.58	5.18	5.71	6.28	7.81
	3H	9.86	10.35	10.99	11.48	13.02	5.91	6.41	7.04	7.54	9.08
	4H	10.54	11.00	11.67	12.12	13.67	6.45	6.91	7.58	8.03	9.58
	6H	11.04	11.43	12.18	12.58	14.13	6.85	7.25	8.00	8.39	9.94
	8H	11.21	11.58	12.35	12.71	14.28	6.98	7.34	8.12	8.48	10.04
	12H	11.30	11.63	12.46	12.78	14.35	7.03	7.36	8.19	8.51	10.08
8H	4H	10.50	10.86	11.64	11.99	13.56	6.72	7.08	7.86	8.22	9.78
	6H	11.05	11.35	12.21	12.53	14.09	7.22	7.52	8.38	8.70	10.26
	8H	11.27	11.53	12.43	12.68	14.27	7.41	7.67	8.57	8.83	10.41
	12H	11.40	11.63	12.56	12.78	14.40	7.52	7.75	8.69	8.90	10.52
12H	4H	10.44	10.77	11.60	11.92	13.49	6.72	7.05	7.87	8.19	9.76
	6H	11.03	11.29	12.19	12.44	14.03	7.27	7.53	8.44	8.69	10.27
	8H	11.24	11.47	12.41	12.62	14.24	7.47	7.70	8.64	8.85	10.47

END OF REPORT