

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925507

Luminaire Tested: DFN2DIP-SQ3F0-050D120US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925507
REPORT IS A COMBINATION OF REPORTS P901528 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-050D120US950-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15388.0 lumens
Efficiency: N/A
Efficacy: 112.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 136.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLLONL

Luminous Intensity Polar Plot

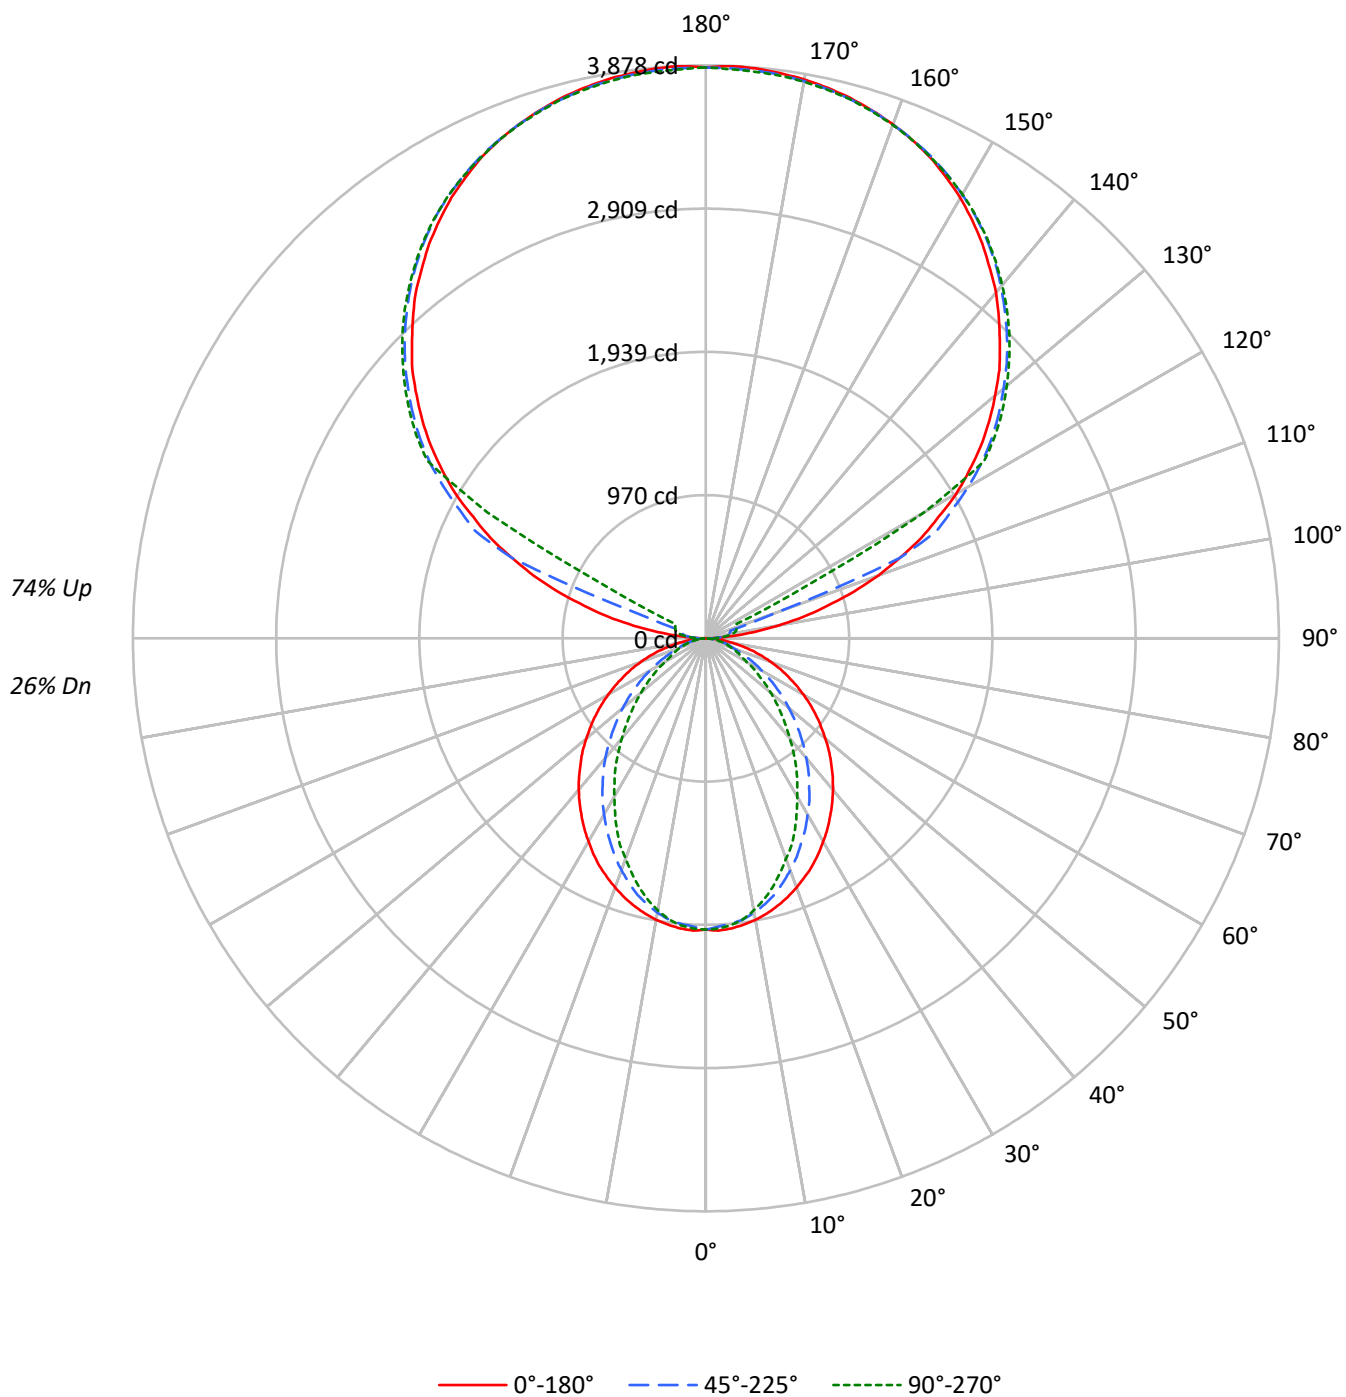

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	70	70	70	52	52	52	34	34	34
1	93	89	85	82	83	79	76	74	62	60	58	46	44	43	31	30	29
2	85	78	72	67	75	70	65	61	54	51	48	40	38	36	27	26	25
3	77	68	62	56	69	61	56	51	48	44	41	36	33	31	24	23	22
4	71	61	53	47	63	54	48	43	43	38	35	32	29	27	22	20	19
5	65	54	46	41	58	49	42	37	38	34	30	29	26	23	20	18	17
6	60	48	41	35	53	44	37	32	35	30	26	26	23	20	18	16	15
7	55	44	36	31	49	39	33	28	31	27	23	24	20	18	17	15	13
8	51	39	32	27	46	36	29	25	28	24	20	22	18	16	15	13	12
9	48	36	29	24	42	33	26	22	26	21	18	20	17	14	14	12	11
10	44	33	26	21	40	30	24	20	24	19	16	18	15	13	13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2259	2259	2259
5°	2261	2222	2237
10°	2237	2176	2163
15°	2205	2103	2050
20°	2163	2003	1911
25°	2120	1890	1777
30°	2062	1775	1608
35°	2006	1651	1459
40°	1948	1523	1288
45°	1881	1382	1134
50°	1812	1239	983
55°	1740	1086	838
60°	1656	927	689
65°	1560	766	619
70°	1443	615	559
75°	1296	539	507
80°	1082	448	437
85°	734	292	325

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2648 cd/sqm

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.2
10°-20°	507.2	3.3
20°-30°	712.1	4.6
30°-40°	776.3	5.0
40°-50°	713.5	4.6
50°-60°	560.3	3.6
60°-70°	364.7	2.4
70°-80°	187.7	1.2
80°-90°	54.7	0.4
90°-100°	127.4	0.8
100°-110°	474.9	3.1
110°-120°	1259.5	8.2
120°-130°	2089.1	13.6
130°-140°	2219.1	14.4
140°-150°	2062.4	13.4
150°-160°	1658.1	10.8
160°-170°	1068.4	6.9
170°-180°	367.7	2.4
0°-30°	1404.1	9.1
0°-40°	2180.4	14.2
0°-60°	3454.1	22.4
0°-90°	4061.3	26.4
90°-120°	1861.9	12.1
90°-150°	8232.4	53.5
90°-180°	11327.0	73.6
0°-180°	15388.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	3	34	56	70	75	14
95°	182	89	109	123	120	215
105°	850	934	171	201	212	908
115°	1607	1655	1725	430	229	1582
125°	2273	2309	2362	2382	2390	2027
135°	2812	2857	2882	2910	2905	2173
145°	3263	3260	3307	3327	3313	2041
155°	3592	3567	3601	3618	3595	1655
165°	3785	3769	3777	3796	3777	1069
175°	3872	3852	3858	3878	3850	368
180°	3864	3864	3864	3864	3864	

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	2.7	33.5	55.8	70.0	75.4
92.5°	70.0	58.8	67.1	72.7	75.4
95°	181.5	89.3	108.9	123.2	120.2
97.5°	327.0	98.0	142.4	151.0	153.7
100°	494.9	111.9	159.3	181.5	187.3
102.5°	679.2	673.9	164.9	195.6	204.2
105°	849.8	933.9	170.7	201.2	212.5
107.5°	1048.4	1118.1	176.3	206.8	218.1
110°	1238.6	1297.1	489.3	209.8	220.8

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1417.5	1467.6	1420.2	215.1	223.7
115°	1607.4	1654.9	1724.9	430.5	229.4
117.5°	1772.4	1828.2	1876.0	1475.9	743.6
120°	1957.0	1998.8	2049.3	2082.9	1705.4
122.5°	2113.4	2158.2	2214.3	2230.9	2233.9
125°	2272.7	2309.3	2362.4	2381.9	2390.2
127.5°	2418.1	2457.3	2499.5	2527.3	2530.0
130°	2555.2	2600.0	2630.6	2661.5	2658.8
132.5°	2695.0	2731.5	2762.0	2787.3	2784.6
135°	2812.5	2857.3	2882.2	2910.5	2904.8
137.5°	2935.4	2968.8	2997.1	3024.9	3016.6
140°	3055.6	3078.1	3108.6	3133.9	3120.0
142.5°	3156.4	3176.1	3212.2	3234.4	3220.5
145°	3262.7	3259.7	3307.1	3326.8	3312.8
147.5°	3354.6	3346.3	3393.9	3407.8	3396.8
150°	3444.2	3424.7	3469.5	3486.1	3472.2
152.5°	3519.6	3497.4	3539.2	3556.1	3536.6
155°	3592.3	3567.4	3601.0	3617.6	3595.3
157.5°	3651.1	3628.8	3654.1	3673.7	3651.1
160°	3701.5	3684.6	3701.5	3718.1	3698.6
162.5°	3746.1	3729.5	3743.4	3763.0	3737.8
165°	3785.2	3768.6	3776.9	3796.5	3776.9
167.5°	3816.1	3799.1	3807.8	3827.4	3802.2
170°	3841.3	3824.4	3830.0	3849.6	3824.4
172.5°	3857.9	3841.3	3847.0	3866.6	3841.3
175°	3871.8	3852.3	3857.9	3877.5	3849.6
177.5°	3877.5	3857.9	3860.9	3880.5	3855.3
180°	3863.6	3863.6	3863.6	3863.6	3863.6

TEST NUMBER: P925507

CATALOG NUMBER: DFN2DIP-SQ3F0-050D120US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.19	7.86	8.33	8.99	10.56	3.15	3.82	4.29	4.95	6.52
	3H	8.85	9.45	10.00	10.58	12.17	4.32	4.92	5.47	6.05	7.64
	4H	9.45	10.02	10.61	11.15	12.75	4.76	5.33	5.92	6.46	8.06
	6H	9.86	10.38	11.02	11.52	13.12	5.07	5.59	6.23	6.73	8.33
	8H	9.98	10.47	11.15	11.63	13.23	5.15	5.64	6.32	6.80	8.40
	12H	10.03	10.50	11.20	11.65	13.27	5.18	5.65	6.35	6.80	8.42
4H	2H	7.19	7.75	8.35	8.89	10.49	3.72	4.29	4.89	5.43	7.02
	3H	9.00	9.47	10.17	10.63	12.24	5.05	5.52	6.22	6.69	8.29
	4H	9.68	10.11	10.85	11.26	12.89	5.59	6.02	6.76	7.17	8.80
	6H	10.18	10.55	11.36	11.72	13.34	5.99	6.36	7.17	7.54	9.15
	8H	10.35	10.70	11.52	11.86	13.49	6.11	6.46	7.29	7.62	9.26
	12H	10.43	10.75	11.62	11.92	13.56	6.17	6.48	7.36	7.66	9.29
8H	4H	9.63	9.98	10.81	11.14	12.78	5.85	6.20	7.03	7.36	9.00
	6H	10.19	10.47	11.38	11.68	13.31	6.36	6.64	7.55	7.85	9.48
	8H	10.40	10.65	11.60	11.83	13.48	6.54	6.79	7.74	7.98	9.62
	12H	10.53	10.75	11.73	11.93	13.61	6.65	6.87	7.85	8.05	9.73
12H	4H	9.58	9.89	10.77	11.07	12.70	5.85	6.16	7.04	7.34	8.98
	6H	10.16	10.41	11.36	11.59	13.24	6.40	6.65	7.60	7.84	9.49
	8H	10.37	10.59	11.57	11.77	13.45	6.60	6.82	7.80	8.00	9.68

END OF REPORT