

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925539

Luminaire Tested: DFN2DIP-SQ3F0-060D110US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925539
REPORT IS A COMBINATION OF REPORTS P901512 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-060D110US950-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15254.5 lumens
Efficiency: N/A
Efficacy: 109.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 139.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLLONL

Luminous Intensity Polar Plot

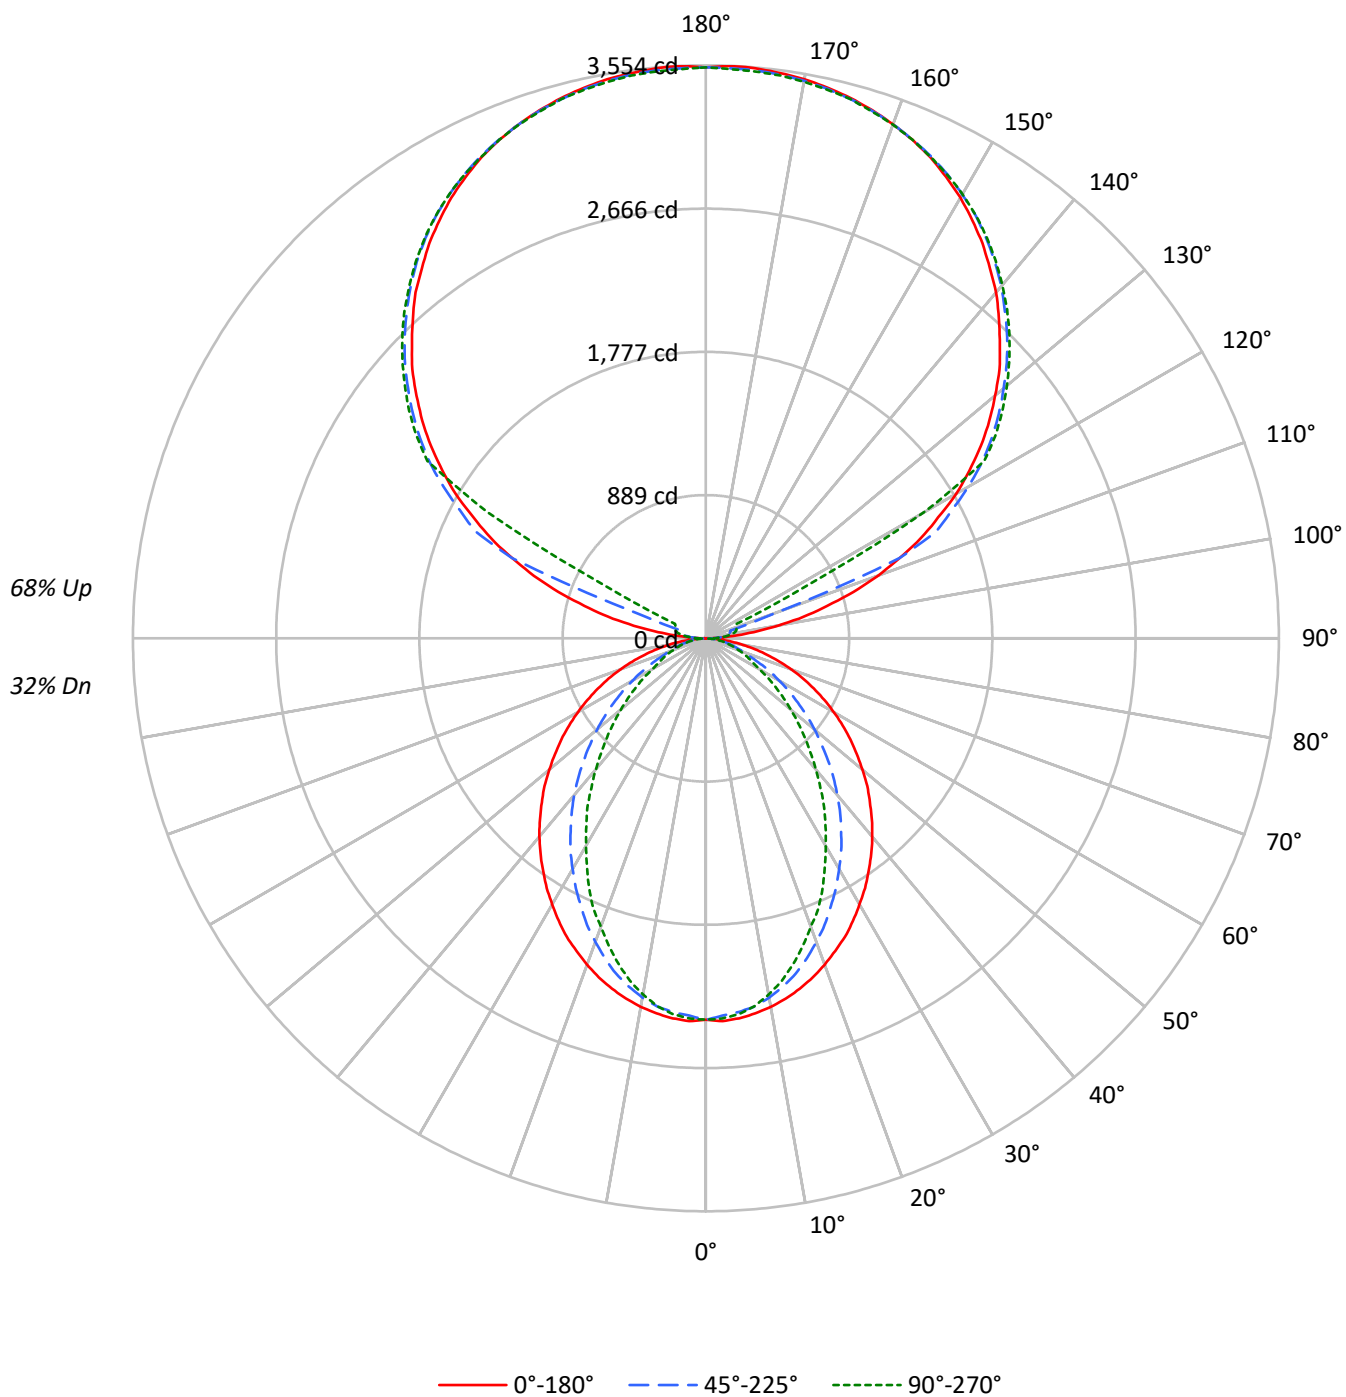

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	54	51	44	42	40	31	30	29
3	78	70	63	57	70	63	57	52	50	46	43	39	36	34	28	26	25
4	72	62	54	48	64	56	49	44	45	40	37	35	32	29	25	23	22
5	66	55	47	42	59	50	43	38	40	35	32	31	28	25	23	21	19
6	61	49	42	36	55	45	38	33	36	31	28	28	25	22	21	19	17
7	56	44	37	32	51	41	34	29	33	28	24	26	22	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	15	14
9	48	37	30	25	44	34	27	23	27	23	19	22	18	16	16	14	12
10	45	34	27	22	41	31	25	21	25	21	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2711	2711	2711
5°	2713	2666	2684
10°	2685	2612	2596
15°	2646	2524	2460
20°	2595	2403	2293
25°	2544	2268	2133
30°	2474	2130	1929
35°	2407	1982	1751
40°	2338	1828	1546
45°	2258	1658	1361
50°	2175	1487	1179
55°	2088	1304	1005
60°	1987	1113	827
65°	1872	919	743
70°	1731	738	671
75°	1555	647	609
80°	1299	537	525
85°	881	349	389

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2427 cd/sqm

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	1.5
10°-20°	608.7	4.0
20°-30°	854.5	5.6
30°-40°	931.5	6.1
40°-50°	856.2	5.6
50°-60°	672.4	4.4
60°-70°	437.7	2.9
70°-80°	225.3	1.5
80°-90°	63.7	0.4
90°-100°	116.8	0.8
100°-110°	435.4	2.9
110°-120°	1154.6	7.6
120°-130°	1915.0	12.6
130°-140°	2034.2	13.3
140°-150°	1890.5	12.4
150°-160°	1519.9	10.0
160°-170°	979.4	6.4
170°-180°	337.1	2.2
0°-30°	1684.9	11.0
0°-40°	2616.4	17.2
0°-60°	4144.9	27.2
0°-90°	4871.6	31.9
90°-120°	1706.7	11.2
90°-150°	7546.4	49.5
90°-180°	10383.0	68.1
0°-180°	15254.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	2	31	51	64	69	14
95°	166	82	100	113	110	197
105°	779	856	156	184	195	832
115°	1474	1517	1581	395	210	1451
125°	2083	2117	2166	2183	2191	1858
135°	2578	2619	2642	2668	2663	1992
145°	2991	2988	3032	3050	3037	1871
155°	3293	3270	3301	3316	3296	1517
165°	3470	3454	3462	3480	3462	980
175°	3549	3531	3536	3554	3529	338
180°	3542	3542	3542	3542	3542	

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	2.5	30.7	51.1	64.2	69.1
92.5°	64.2	53.9	61.4	66.7	69.1
95°	166.5	81.9	99.8	112.9	110.2
97.5°	299.7	89.8	130.5	138.4	140.9
100°	453.7	102.6	146.1	166.5	171.6
102.5°	622.6	617.7	151.2	179.3	187.2
105°	779.0	856.0	156.5	184.4	194.8
107.5°	961.1	1024.9	161.6	189.6	200.0
110°	1135.4	1189.0	448.6	192.3	202.3

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1299.4	1345.3	1301.8	197.2	205.1
115°	1473.5	1517.0	1581.3	394.7	210.3
117.5°	1624.8	1675.9	1719.7	1353.0	681.6
120°	1793.9	1832.3	1878.5	1909.2	1563.2
122.5°	1937.3	1978.3	2029.7	2045.0	2047.8
125°	2083.3	2116.8	2165.5	2183.4	2191.1
127.5°	2216.6	2252.5	2291.1	2316.7	2319.2
130°	2342.3	2383.4	2411.3	2439.7	2437.3
132.5°	2470.4	2503.9	2531.9	2555.0	2552.6
135°	2578.2	2619.2	2642.0	2668.0	2662.7
137.5°	2690.8	2721.5	2747.3	2772.9	2765.3
140°	2800.9	2821.6	2849.6	2872.7	2859.9
142.5°	2893.4	2911.3	2944.5	2964.9	2952.2
145°	2990.8	2988.0	3031.5	3049.6	3036.8
147.5°	3075.1	3067.5	3111.0	3123.8	3113.8
150°	3157.3	3139.3	3180.3	3195.6	3182.8
152.5°	3226.3	3205.9	3244.3	3259.8	3241.9
155°	3293.0	3270.1	3300.8	3316.1	3295.7
157.5°	3346.8	3326.4	3349.6	3367.5	3346.8
160°	3393.1	3377.5	3393.1	3408.3	3390.3
162.5°	3433.8	3418.7	3431.4	3449.4	3426.3
165°	3469.8	3454.5	3462.2	3480.1	3462.2
167.5°	3498.0	3482.6	3490.5	3508.4	3485.3
170°	3521.2	3505.7	3510.8	3528.8	3505.7
172.5°	3536.4	3521.2	3526.4	3544.3	3521.2
175°	3549.2	3531.2	3536.4	3554.4	3528.8
177.5°	3554.4	3536.4	3539.1	3557.1	3534.0
180°	3541.6	3541.6	3541.6	3541.6	3541.6

TEST NUMBER: P925539

CATALOG NUMBER: DFN2DIP-SQ3F0-060D110US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.60	9.31	9.71	10.40	11.91	4.57	5.27	5.67	6.36	7.87
	3H	10.27	10.89	11.38	12.00	13.53	5.74	6.37	6.85	7.47	9.00
	4H	10.87	11.46	11.99	12.57	14.10	6.18	6.77	7.30	7.88	9.41
	6H	11.28	11.83	12.41	12.93	14.48	6.49	7.03	7.62	8.14	9.69
	8H	11.40	11.92	12.53	13.04	14.58	6.57	7.09	7.70	8.22	9.75
	12H	11.46	11.95	12.59	13.07	14.63	6.61	7.10	7.74	8.22	9.78
4H	2H	8.60	9.20	9.73	10.31	11.84	5.14	5.74	6.27	6.84	8.38
	3H	10.42	10.91	11.55	12.04	13.59	6.47	6.97	7.61	8.10	9.65
	4H	11.10	11.56	12.24	12.68	14.24	7.01	7.47	8.15	8.59	10.15
	6H	11.60	11.99	12.75	13.14	14.69	7.42	7.81	8.56	8.95	10.51
	8H	11.77	12.14	12.92	13.27	14.85	7.54	7.90	8.68	9.04	10.61
	12H	11.86	12.19	13.02	13.34	14.91	7.59	7.92	8.75	9.07	10.65
8H	4H	11.06	11.42	12.20	12.56	14.13	7.28	7.64	8.42	8.78	10.35
	6H	11.61	11.91	12.78	13.09	14.66	7.78	8.08	8.95	9.26	10.83
	8H	11.83	12.09	13.00	13.24	14.83	7.97	8.23	9.14	9.39	10.98
	12H	11.96	12.19	13.13	13.34	14.96	8.08	8.31	9.25	9.46	11.09
12H	4H	11.00	11.33	12.16	12.48	14.06	7.28	7.61	8.44	8.75	10.33
	6H	11.59	11.85	12.76	13.01	14.60	7.83	8.09	9.00	9.25	10.84
	8H	11.80	12.03	12.97	13.18	14.81	8.03	8.26	9.20	9.41	11.04