

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925551

Luminaire Tested: DFN2DIP-SQ3F0-070D050US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925551
REPORT IS A COMBINATION OF REPORTS P901406 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-070D050US950-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10398.6 lumens
Efficiency: N/A
Efficacy: 101.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9963
Total Harmonic Distortion (THDi): 0.065
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLLONL

Luminous Intensity Polar Plot

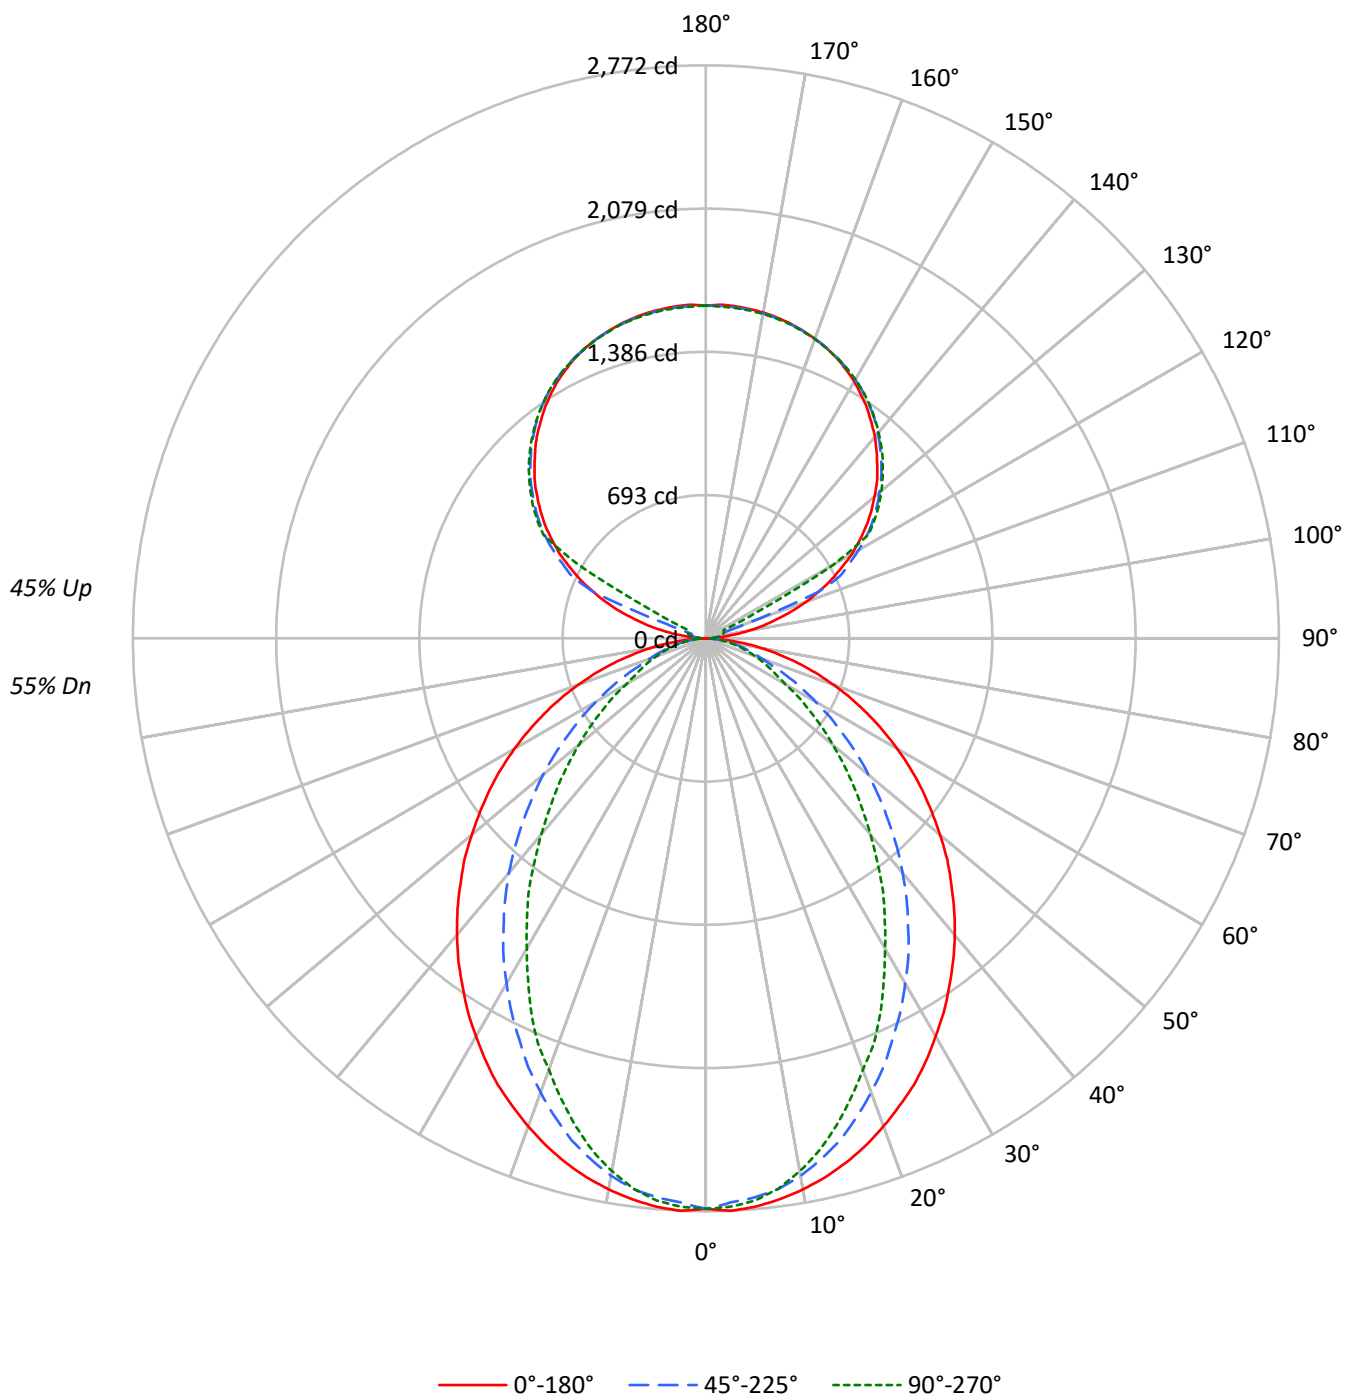

TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3162	3162	3162
5°	3165	3110	3131
10°	3132	3047	3028
15°	3087	2944	2870
20°	3028	2804	2676
25°	2967	2646	2488
30°	2887	2485	2251
35°	2808	2312	2043
40°	2727	2133	1804
45°	2634	1935	1587
50°	2537	1735	1376
55°	2436	1521	1173
60°	2319	1298	965
65°	2183	1072	867
70°	2020	861	783
75°	1813	755	710
80°	1516	627	612
85°	1027	408	454

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2634 cd/sqm

TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.7	2.5
10°-20°	710.1	6.8
20°-30°	997.0	9.6
30°-40°	1086.8	10.5
40°-50°	998.8	9.6
50°-60°	784.4	7.5
60°-70°	510.6	4.9
70°-80°	262.8	2.5
80°-90°	69.9	0.7
90°-100°	53.1	0.5
100°-110°	197.9	1.9
110°-120°	524.8	5.0
120°-130°	870.4	8.4
130°-140°	924.6	8.9
140°-150°	859.3	8.3
150°-160°	690.9	6.6
160°-170°	445.2	4.3
170°-180°	153.2	1.5
0°-30°	1965.7	18.9
0°-40°	3052.5	29.4
0°-60°	4835.8	46.5
0°-90°	5679.1	54.6
90°-120°	775.8	7.5
90°-150°	3430.2	33.0
90°-180°	4719.0	45.4
0°-180°	10398.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2760	2760	2760	2760	2760	
5°	2760	2748	2715	2738	2730	262
15°	2625	2598	2513	2465	2440	740
25°	2383	2303	2138	2036	1998	1096
35°	2053	1926	1706	1549	1494	1285
45°	1679	1511	1249	1071	1012	1296
55°	1276	1082	812	662	615	1140
65°	862	659	435	350	342	854
75°	460	285	200	182	180	486
85°	107	55	47	47	47	123
90°	1	14	23	29	31	10
95°	76	37	45	51	50	90
105°	354	389	71	84	88	378
115°	670	690	719	179	96	659
125°	947	962	984	992	996	845
135°	1172	1191	1201	1213	1210	905
145°	1359	1358	1378	1386	1380	850
155°	1497	1486	1500	1507	1498	690
165°	1577	1570	1574	1582	1574	446
175°	1613	1605	1608	1616	1604	154
180°	1610	1610	1610	1610	1610	

TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2760.0	2760.0	2760.0	2760.0	2760.0
2.5°	2772.4	2760.0	2732.4	2757.6	2752.6
5°	2760.0	2747.5	2715.0	2737.5	2730.1
7.5°	2737.5	2722.6	2687.7	2697.4	2685.0
10°	2707.5	2690.1	2640.2	2632.6	2617.7
12.5°	2670.2	2647.6	2580.1	2565.2	2537.6
15°	2625.1	2597.6	2512.7	2465.3	2440.4
17.5°	2572.7	2532.7	2427.7	2372.8	2332.8
20°	2512.7	2462.7	2337.9	2275.6	2220.4
22.5°	2447.9	2390.3	2245.3	2160.5	2123.2
25°	2382.9	2302.9	2138.0	2035.7	1998.2
27.5°	2305.5	2220.4	2038.1	1920.8	1863.3
30°	2223.1	2128.0	1928.1	1801.0	1733.4
32.5°	2143.1	2028.1	1823.5	1673.5	1610.9
35°	2053.2	1925.7	1706.1	1548.7	1493.6
37.5°	1965.8	1828.2	1596.1	1423.6	1361.4
40°	1873.3	1723.6	1481.1	1303.8	1238.9
42.5°	1778.4	1618.7	1366.3	1181.3	1119.1
45°	1678.6	1511.0	1249.0	1071.4	1011.5
47.5°	1583.6	1406.4	1136.6	959.1	904.2
50°	1478.7	1301.4	1026.6	854.1	801.9
52.5°	1376.1	1188.8	921.7	756.8	709.4
55°	1276.3	1081.5	811.7	662.0	614.6
57.5°	1174.0	974.1	714.5	574.5	534.5
60°	1069.1	869.2	611.9	484.7	444.7
62.5°	966.7	766.9	524.4	404.7	384.7
65°	861.7	659.3	434.6	349.8	342.1
67.5°	761.9	559.4	349.8	307.1	299.7
70°	656.9	462.1	289.6	264.7	254.6
72.5°	557.0	372.1	242.2	222.4	217.3
75°	459.5	284.6	199.8	182.3	179.9
77.5°	362.2	202.2	157.4	147.3	142.3
80°	272.2	144.9	119.8	110.0	110.0
82.5°	189.8	97.5	82.4	77.4	77.4
85°	107.3	54.9	47.4	47.4	47.4
87.5°	40.0	19.8	19.8	17.5	17.5
90°	1.1	13.9	23.3	29.2	31.4
92.5°	29.2	24.5	28.0	30.3	31.4
95°	75.7	37.2	45.4	51.3	50.1
97.5°	136.2	40.8	59.3	63.0	64.0
100°	206.3	46.7	66.4	75.7	78.0
102.5°	283.1	280.8	68.8	81.5	85.1
105°	354.1	389.1	71.1	83.9	88.5
107.5°	436.8	465.8	73.5	86.1	90.9
110°	516.1	540.4	203.9	87.4	92.0



TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	590.6	611.5	591.8	89.7	93.2
115°	669.8	689.6	718.7	179.4	95.6
117.5°	738.5	761.8	781.7	614.9	309.9
120°	815.4	832.8	853.8	867.9	710.5
122.5°	880.5	899.2	922.6	929.6	930.8
125°	946.9	962.2	984.3	992.4	996.0
127.5°	1007.5	1023.8	1041.5	1053.0	1054.2
130°	1064.7	1083.4	1096.1	1108.9	1107.9
132.5°	1123.0	1138.1	1150.8	1161.4	1160.3
135°	1171.9	1190.6	1200.9	1212.7	1210.3
137.5°	1223.0	1237.1	1248.8	1260.4	1257.0
140°	1273.1	1282.6	1295.2	1305.7	1300.0
142.5°	1315.2	1323.4	1338.5	1347.7	1341.9
145°	1359.4	1358.2	1378.0	1386.2	1380.3
147.5°	1397.8	1394.3	1414.1	1419.9	1415.4
150°	1435.1	1427.0	1445.6	1452.6	1446.7
152.5°	1466.5	1457.2	1474.7	1481.8	1473.5
155°	1496.8	1486.4	1500.4	1507.3	1498.1
157.5°	1521.2	1512.0	1522.5	1530.7	1521.2
160°	1542.3	1535.3	1542.3	1549.2	1541.1
162.5°	1560.8	1554.0	1559.7	1567.9	1557.4
165°	1577.2	1570.3	1573.7	1581.8	1573.7
167.5°	1590.0	1583.0	1586.6	1594.7	1584.2
170°	1600.5	1593.5	1595.9	1604.0	1593.5
172.5°	1607.5	1600.5	1602.9	1611.0	1600.5
175°	1613.3	1605.1	1607.5	1615.6	1604.0
177.5°	1615.6	1607.5	1608.7	1616.8	1606.3
180°	1609.8	1609.8	1609.8	1609.8	1609.8

TEST NUMBER: P925551

CATALOG NUMBER: DFN2DIP-SQ3F0-070D050US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.53	12.40	12.46	13.34	14.55	7.49	8.36	8.42	9.30	10.51
	3H	13.21	13.99	14.15	14.93	16.16	8.68	9.46	9.61	10.40	11.63
	4H	13.82	14.55	14.77	15.50	16.74	9.13	9.86	10.08	10.81	12.05
	6H	14.24	14.91	15.20	15.87	17.12	9.44	10.12	10.41	11.08	12.33
	8H	14.36	15.01	15.33	15.98	17.23	9.53	10.18	10.50	11.15	12.40
	12H	14.42	15.04	15.40	16.00	17.28	9.57	10.19	10.55	11.15	12.43
4H	2H	11.56	12.29	12.51	13.24	14.48	8.09	8.83	9.05	9.78	11.02
	3H	13.38	13.99	14.35	14.97	16.23	9.44	10.05	10.40	11.03	12.28
	4H	14.07	14.63	15.05	15.60	16.88	9.98	10.54	10.96	11.51	12.79
	6H	14.59	15.06	15.57	16.06	17.34	10.40	10.88	11.38	11.87	13.15
	8H	14.76	15.21	15.75	16.20	17.49	10.52	10.97	11.51	11.96	13.25
	12H	14.85	15.26	15.86	16.26	17.56	10.59	10.99	11.59	12.00	13.29
8H	4H	14.04	14.49	15.03	15.48	16.77	10.26	10.71	11.25	11.70	12.99
	6H	14.60	14.97	15.62	16.01	17.30	10.77	11.14	11.79	12.18	13.47
	8H	14.82	15.14	15.84	16.16	17.47	10.96	11.29	11.98	12.31	13.61
	12H	14.95	15.24	15.98	16.25	17.61	11.08	11.36	12.10	12.38	13.73
12H	4H	14.00	14.40	15.00	15.41	16.70	10.27	10.67	11.28	11.68	12.98
	6H	14.58	14.90	15.60	15.93	17.23	10.82	11.15	11.84	12.17	13.48
	8H	14.80	15.08	15.82	16.10	17.45	11.03	11.32	12.05	12.33	13.68

END OF REPORT