

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925605

Luminaire Tested: DFN2DIP-SQ3F0-080D100US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925605
REPORT IS A COMBINATION OF REPORTS P901497 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D100US950-FLLONL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17000.3 lumens
Efficiency: N/A
Efficacy: 110.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 153.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

Luminous Intensity Polar Plot

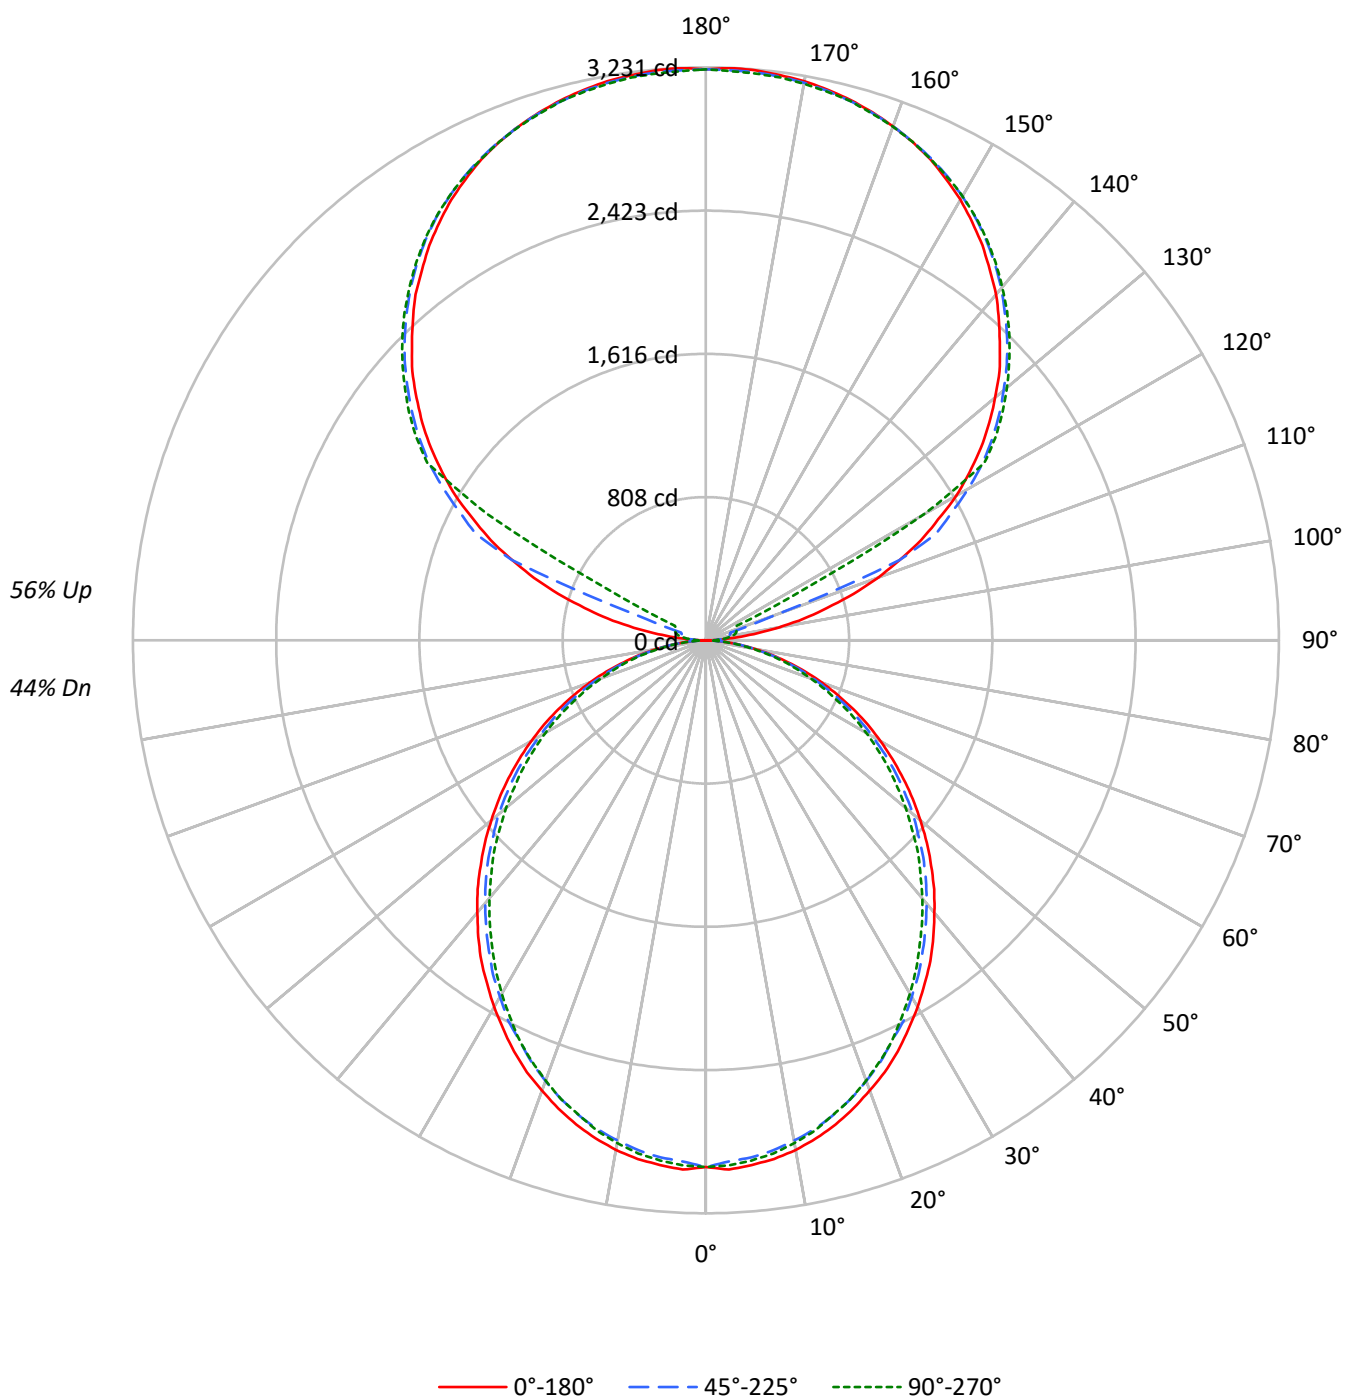

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3403	3403	3403
5°	3406	3353	3377
10°	3376	3306	3330
15°	3324	3249	3257
20°	3255	3171	3183
25°	3186	3078	3098
30°	3100	2992	2989
35°	3019	2890	2874
40°	2919	2788	2765
45°	2819	2685	2653
50°	2709	2576	2523
55°	2595	2451	2404
60°	2465	2303	2267
65°	2323	2149	2106
70°	2142	1961	1932
75°	1893	1736	1770
80°	1591	1448	1462
85°	1120	960	958

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2819 cd/sqm

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	1.6
10°-20°	786.4	4.6
20°-30°	1155.7	6.8
30°-40°	1342.3	7.9
40°-50°	1340.6	7.9
50°-60°	1169.0	6.9
60°-70°	864.1	5.1
70°-80°	488.9	2.9
80°-90°	134.7	0.8
90°-100°	106.2	0.6
100°-110°	395.8	2.3
110°-120°	1049.6	6.2
120°-130°	1740.9	10.2
130°-140°	1849.2	10.9
140°-150°	1718.7	10.1
150°-160°	1381.8	8.1
160°-170°	890.4	5.2
170°-180°	306.5	1.8
0°-30°	2221.6	13.1
0°-40°	3563.9	21.0
0°-60°	6073.6	35.7
0°-90°	7561.3	44.5
90°-120°	1551.6	9.1
90°-150°	6860.4	40.4
90°-180°	9439.0	55.5
0°-180°	17000.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	2	28	46	58	63	16
95°	151	74	91	103	100	179
105°	708	778	142	168	177	757
115°	1340	1379	1438	359	191	1319
125°	1894	1924	1969	1985	1992	1689
135°	2344	2381	2402	2425	2421	1810
145°	2719	2716	2756	2772	2761	1700
155°	2994	2973	3001	3015	2996	1380
165°	3154	3140	3147	3164	3147	891
175°	3226	3210	3215	3231	3208	307
180°	3220	3220	3220	3220	3220	

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	2.2	28.0	46.5	58.4	62.8
92.5°	58.4	48.9	55.9	60.6	62.8
95°	151.3	74.4	90.7	102.7	100.2
97.5°	272.5	81.6	118.7	125.8	128.1
100°	412.5	93.2	132.8	151.3	156.1
102.5°	566.0	561.6	137.5	162.9	170.1
105°	708.2	778.2	142.2	167.6	177.1
107.5°	873.7	931.8	146.9	172.4	181.7
110°	1032.1	1080.9	407.7	174.9	183.9

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1181.2	1223.0	1183.5	179.3	186.5
115°	1339.5	1379.1	1437.5	358.8	191.2
117.5°	1477.0	1523.5	1563.3	1230.0	619.7
120°	1630.9	1665.7	1707.8	1735.7	1421.2
122.5°	1761.2	1798.5	1845.2	1859.1	1861.5
125°	1894.0	1924.4	1968.7	1985.0	1991.9
127.5°	2015.1	2047.8	2082.9	2106.1	2108.3
130°	2129.3	2166.7	2192.2	2217.9	2215.7
132.5°	2245.8	2276.2	2301.7	2322.7	2320.5
135°	2343.8	2381.1	2401.9	2425.4	2420.7
137.5°	2446.2	2474.1	2497.6	2520.8	2513.9
140°	2546.2	2565.1	2590.5	2611.6	2599.9
142.5°	2630.4	2646.7	2676.8	2695.3	2683.8
145°	2718.9	2716.4	2756.0	2772.3	2760.7
147.5°	2795.5	2788.6	2828.1	2839.8	2830.7
150°	2870.2	2853.9	2891.3	2905.1	2893.5
152.5°	2933.0	2914.5	2949.4	2963.4	2947.1
155°	2993.7	2972.9	3000.8	3014.6	2996.1
157.5°	3042.6	3024.1	3045.1	3061.4	3042.6
160°	3084.7	3070.5	3084.7	3098.5	3082.2
162.5°	3121.7	3107.8	3119.5	3135.8	3114.8
165°	3154.3	3140.5	3147.4	3163.8	3147.4
167.5°	3180.1	3165.9	3173.2	3189.5	3168.4
170°	3201.1	3187.0	3191.7	3208.0	3187.0
172.5°	3214.9	3201.1	3205.8	3222.1	3201.1
175°	3226.5	3210.2	3214.9	3231.3	3208.0
177.5°	3231.3	3214.9	3217.5	3233.8	3212.7
180°	3219.7	3219.7	3219.7	3219.7	3219.7

TEST NUMBER: P925605

CATALOG NUMBER: DFN2DIP-SQ3F0-080D100US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.96	11.77	11.96	12.79	14.13	10.52	11.33	11.52	12.34	13.69
	3H	12.61	13.34	13.63	14.36	15.73	12.12	12.85	13.14	13.87	15.24
	4H	13.19	13.89	14.22	14.91	16.29	12.70	13.39	13.73	14.42	15.79
	6H	13.59	14.22	14.62	15.25	16.64	13.09	13.72	14.12	14.75	16.14
	8H	13.69	14.30	14.73	15.34	16.73	13.19	13.79	14.23	14.84	16.22
	12H	13.73	14.31	14.78	15.35	16.76	13.23	13.80	14.27	14.84	16.25
4H	2H	11.41	12.10	12.44	13.13	14.50	11.06	11.75	12.09	12.77	14.15
	3H	13.27	13.84	14.31	14.90	16.29	12.86	13.44	13.90	14.49	15.88
	4H	13.98	14.50	15.02	15.55	16.96	13.55	14.08	14.60	15.13	16.54
	6H	14.48	14.94	15.54	16.01	17.41	14.05	14.51	15.11	15.57	16.98
	8H	14.63	15.05	15.69	16.12	17.54	14.19	14.62	15.25	15.68	17.10
	12H	14.70	15.08	15.77	16.16	17.59	14.25	14.63	15.33	15.71	17.14
8H	4H	14.16	14.59	15.22	15.65	17.07	13.79	14.21	14.85	15.27	16.70
	6H	14.79	15.14	15.87	16.24	17.66	14.40	14.75	15.49	15.86	17.28
	8H	15.00	15.31	16.09	16.40	17.84	14.61	14.92	15.70	16.01	17.45
	12H	15.13	15.40	16.22	16.48	17.96	14.72	14.99	15.81	16.07	17.55
12H	4H	14.15	14.53	15.22	15.61	17.03	13.78	14.16	14.85	15.24	16.66
	6H	14.81	15.12	15.90	16.21	17.65	14.44	14.75	15.53	15.84	17.28
	8H	15.05	15.32	16.14	16.40	17.88	14.67	14.94	15.76	16.02	17.50

END OF REPORT