

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925610

Luminaire Tested: DFN2DIP-SQ3F0-080D110US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925610
REPORT IS A COMBINATION OF REPORTS P899996 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-080D110US950-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15774.4 lumens
Efficiency: N/A
Efficacy: 97.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 162.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLLFLL

Luminous Intensity Polar Plot

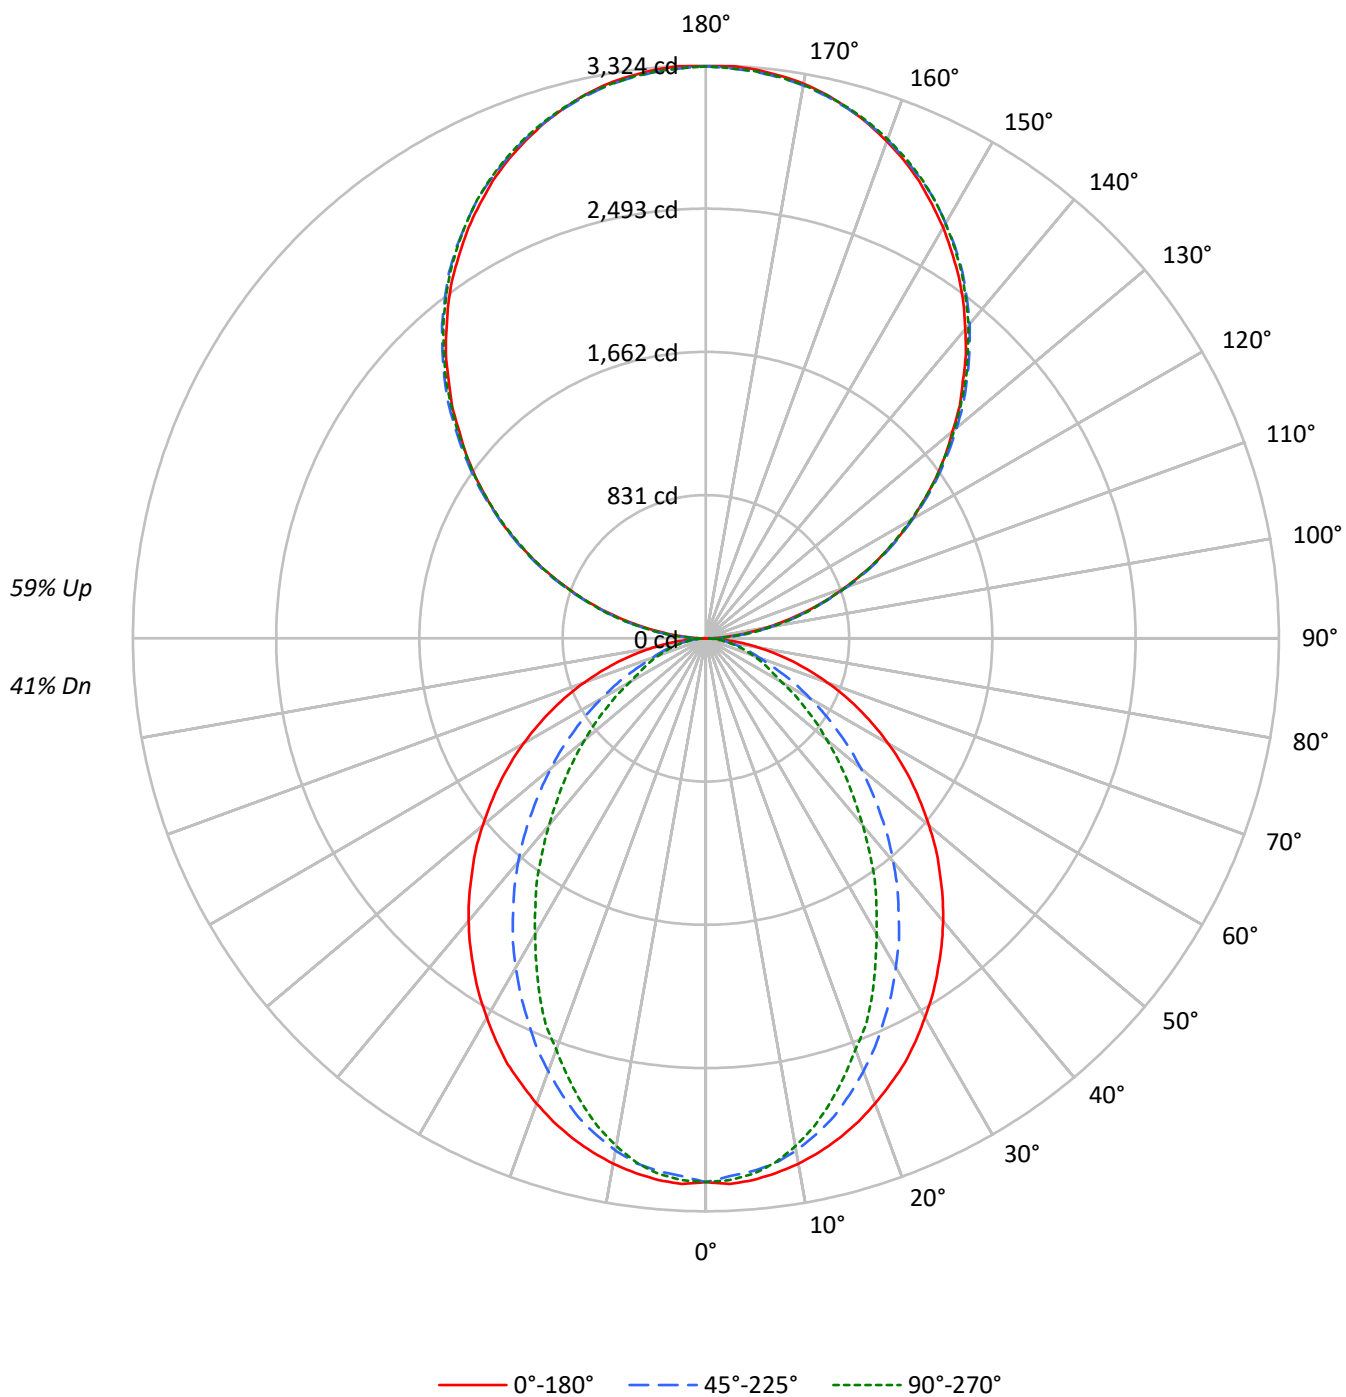

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	58	55	49	47	45	38	37	35
3	80	71	64	59	73	65	59	55	54	50	46	44	41	38	34	32	31
4	74	63	56	50	67	58	52	47	48	44	40	39	36	33	31	29	27
5	68	57	49	43	62	52	45	40	43	38	34	36	32	29	28	26	23
6	63	51	43	37	57	47	40	35	39	34	30	32	28	25	26	23	21
7	58	46	38	33	53	42	36	31	36	31	27	29	26	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3614	3614	3614
5°	3618	3554	3578
10°	3580	3482	3461
15°	3528	3365	3280
20°	3460	3204	3058
25°	3391	3024	2844
30°	3299	2840	2573
35°	3209	2642	2334
40°	3117	2437	2061
45°	3010	2211	1814
50°	2900	1982	1572
55°	2784	1739	1340
60°	2650	1484	1102
65°	2496	1225	991
70°	2308	984	895
75°	2073	863	812
80°	1732	716	699
85°	1175	467	519

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3336 cd/sqm

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.6	1.9
10°-20°	811.5	5.1
20°-30°	1139.4	7.2
30°-40°	1242.0	7.9
40°-50°	1141.5	7.2
50°-60°	896.5	5.7
60°-70°	583.5	3.7
70°-80°	300.4	1.9
80°-90°	86.1	0.5
90°-100°	205.4	1.3
100°-110°	652.5	4.1
110°-120°	1116.7	7.1
120°-130°	1468.6	9.3
130°-140°	1648.4	10.5
140°-150°	1616.5	10.2
150°-160°	1356.0	8.6
160°-170°	899.3	5.7
170°-180°	314.3	2.0
0°-30°	2246.6	14.2
0°-40°	3488.6	22.1
0°-60°	5526.6	35.0
0°-90°	6496.6	41.2
90°-120°	1974.6	12.5
90°-150°	6708.2	42.5
90°-180°	9278.0	58.8
0°-180°	15774.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3154	3154	3154	3154	3154	
5°	3154	3140	3103	3128	3120	299
15°	3000	2969	2872	2818	2789	845
25°	2723	2632	2444	2327	2284	1252
35°	2347	2201	1950	1770	1707	1469
45°	1918	1727	1427	1224	1156	1481
55°	1459	1236	928	756	702	1303
65°	985	754	497	400	391	976
75°	525	325	228	208	206	555
85°	123	63	54	54	54	141
90°	3	36	98	92	95	16
95°	146	174	179	179	174	163
105°	602	610	616	621	621	636
115°	1121	1137	1132	1129	1121	1108
125°	1630	1655	1647	1638	1635	1457
135°	2108	2139	2145	2142	2134	1630
145°	2559	2579	2596	2598	2587	1599
155°	2927	2935	2944	2958	2949	1347
165°	3184	3181	3181	3201	3187	898
175°	3313	3305	3299	3319	3302	315
180°	3319	3319	3319	3319	3319	

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3154.3	3154.3	3154.3	3154.3	3154.3
2.5°	3168.5	3154.3	3122.8	3151.5	3145.8
5°	3154.3	3140.1	3102.8	3128.5	3120.1
7.5°	3128.5	3111.6	3071.6	3082.9	3068.5
10°	3094.3	3074.4	3017.4	3008.6	2991.6
12.5°	3051.7	3025.9	2948.6	2931.6	2900.2
15°	3000.1	2968.7	2871.7	2817.5	2789.0
17.5°	2940.1	2894.4	2774.5	2711.8	2666.0
20°	2871.7	2814.5	2671.9	2600.7	2537.6
22.5°	2797.5	2731.8	2566.2	2469.2	2426.5
25°	2723.3	2631.9	2443.5	2326.6	2283.6
27.5°	2634.9	2537.6	2329.3	2195.2	2129.4
30°	2540.7	2431.9	2203.6	2058.3	1981.0
32.5°	2449.2	2317.8	2084.0	1912.6	1841.1
35°	2346.6	2200.9	1949.8	1770.0	1706.9
37.5°	2246.6	2089.5	1824.1	1627.0	1555.8
40°	2141.0	1969.8	1692.7	1490.1	1415.8
42.5°	2032.5	1849.9	1561.5	1350.2	1278.9
45°	1918.3	1726.9	1427.4	1224.5	1156.1
47.5°	1809.9	1607.3	1299.0	1096.1	1033.4
50°	1689.9	1487.4	1173.3	976.1	916.4
52.5°	1572.8	1358.6	1053.3	865.0	810.8
55°	1458.6	1236.0	927.7	756.5	702.3
57.5°	1341.7	1113.3	816.5	656.6	610.8
60°	1221.7	993.4	699.3	553.9	508.2
62.5°	1104.8	876.4	599.4	462.5	439.8
65°	984.9	753.5	496.7	399.8	390.9
67.5°	870.7	639.4	399.8	351.0	342.6
70°	750.8	528.2	331.0	302.5	291.1
72.5°	636.6	425.2	276.9	254.1	248.3
75°	525.2	325.3	228.4	208.4	205.7
77.5°	414.0	231.1	179.9	168.4	162.7
80°	311.0	165.7	136.9	125.6	125.6
82.5°	216.8	111.4	94.2	88.4	88.4
85°	122.7	62.7	54.2	54.2	54.2
87.5°	45.7	22.7	22.7	20.0	20.0
90°	3.0	36.1	98.1	92.1	95.0
92.5°	62.0	84.0	87.0	90.1	90.1
95°	146.1	174.1	179.1	179.1	174.1
97.5°	243.2	269.1	280.2	280.2	280.2
100°	355.2	378.2	386.2	386.2	383.2
102.5°	473.3	490.3	501.3	504.3	501.3
105°	602.4	610.4	616.4	621.3	621.3
107.5°	730.4	742.4	742.4	744.4	730.4
110°	854.5	870.5	870.5	870.5	862.5

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	988.5	1005.5	1002.6	994.5	988.5
115°	1120.7	1136.6	1131.6	1128.7	1120.7
117.5°	1251.7	1273.7	1259.7	1251.7	1243.7
120°	1383.8	1405.8	1383.8	1383.8	1374.8
122.5°	1503.9	1531.8	1517.8	1509.8	1503.9
125°	1629.9	1654.9	1646.9	1637.9	1634.9
127.5°	1753.0	1784.0	1773.0	1761.0	1753.0
130°	1868.0	1904.1	1899.0	1893.0	1882.1
132.5°	1997.1	2025.2	2027.2	2013.1	2005.1
135°	2108.1	2139.2	2145.2	2142.2	2134.2
137.5°	2232.3	2257.3	2262.2	2260.2	2248.3
140°	2341.3	2366.3	2380.3	2380.3	2369.4
142.5°	2453.4	2478.4	2486.4	2489.4	2478.4
145°	2559.4	2579.4	2595.5	2598.4	2587.4
147.5°	2654.5	2679.5	2691.5	2696.5	2685.5
150°	2752.6	2769.6	2780.5	2789.6	2780.5
152.5°	2839.6	2856.6	2870.6	2881.7	2870.6
155°	2926.7	2934.6	2943.7	2957.7	2948.6
157.5°	3001.7	3007.7	3012.6	3032.7	3018.6
160°	3068.7	3074.7	3077.7	3094.8	3082.8
162.5°	3130.7	3130.7	3133.8	3152.8	3138.8
165°	3183.8	3180.7	3180.7	3200.8	3186.7
167.5°	3231.8	3222.8	3222.8	3242.8	3228.8
170°	3267.8	3259.8	3256.9	3276.8	3259.8
172.5°	3292.8	3284.8	3281.9	3301.9	3284.8
175°	3312.9	3304.8	3298.8	3318.9	3301.9
177.5°	3323.8	3315.8	3309.8	3326.9	3309.8
180°	3318.9	3318.9	3318.9	3318.9	3318.9

TEST NUMBER: P925610

CATALOG NUMBER: DFN2DIP-SQ3F0-080D110US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.69	11.46	11.73	12.49	13.89	6.65	7.42	7.69	8.45	9.85
	3H	12.36	13.04	13.41	14.09	15.50	7.83	8.51	8.88	9.56	10.97
	4H	12.96	13.61	14.02	14.66	16.08	8.27	8.92	9.33	9.97	11.39
	6H	13.38	13.97	14.44	15.02	16.46	8.58	9.18	9.65	10.23	11.66
	8H	13.50	14.07	14.57	15.13	16.56	8.67	9.24	9.74	10.30	11.73
	12H	13.56	14.09	14.63	15.16	16.61	8.71	9.25	9.78	10.31	11.76
4H	2H	10.70	11.35	11.76	12.40	13.82	7.24	7.88	8.30	8.93	10.35
	3H	12.52	13.06	13.59	14.13	15.57	8.57	9.11	9.65	10.19	11.62
	4H	13.20	13.70	14.28	14.76	16.22	9.11	9.61	10.19	10.67	12.13
	6H	13.71	14.13	14.80	15.22	16.67	9.52	9.95	10.61	11.04	12.49
	8H	13.88	14.28	14.97	15.36	16.82	9.65	10.04	10.73	11.12	12.59
	12H	13.97	14.33	15.07	15.42	16.89	9.70	10.06	10.81	11.16	12.63
8H	4H	13.17	13.56	14.25	14.64	16.11	9.39	9.78	10.47	10.86	12.33
	6H	13.72	14.05	14.83	15.17	16.64	9.89	10.22	11.00	11.34	12.81
	8H	13.94	14.22	15.05	15.33	16.81	10.08	10.36	11.19	11.47	12.95
	12H	14.07	14.32	15.19	15.42	16.94	10.19	10.44	11.31	11.54	13.06
12H	4H	13.11	13.47	14.22	14.57	16.04	9.39	9.74	10.49	10.84	12.31
	6H	13.70	13.98	14.81	15.09	16.57	9.94	10.23	11.06	11.33	12.82
	8H	13.91	14.16	15.03	15.27	16.79	10.14	10.39	11.26	11.50	13.02

END OF REPORT