

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925624

Luminaire Tested: DFN2DIP-SQ3F0-090D060US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925624
REPORT IS A COMBINATION OF REPORTS P899907 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-090D060US950-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13565.9 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 132.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFLL

Luminous Intensity Polar Plot

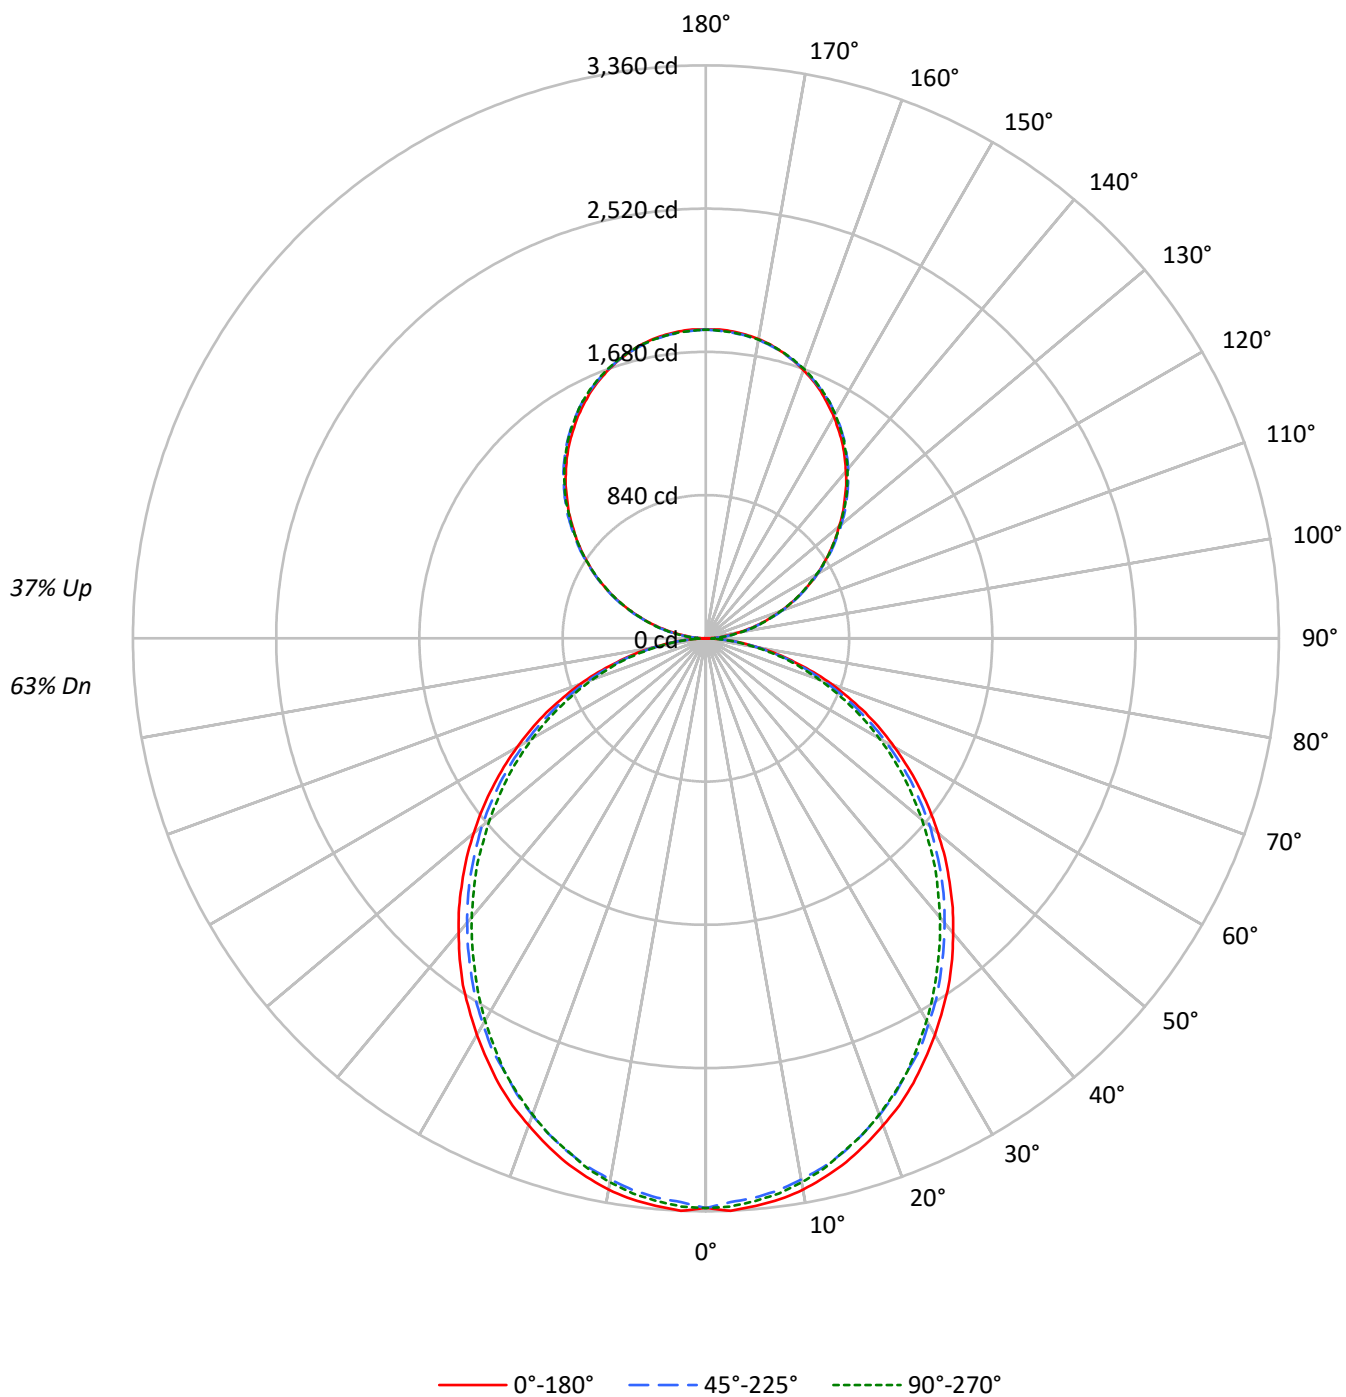

TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3828	3828	3828
5°	3832	3772	3799
10°	3798	3719	3746
15°	3740	3655	3664
20°	3662	3567	3581
25°	3584	3463	3485
30°	3488	3366	3362
35°	3396	3252	3233
40°	3283	3136	3110
45°	3171	3020	2984
50°	3048	2898	2839
55°	2919	2758	2704
60°	2773	2591	2551
65°	2613	2417	2369
70°	2410	2206	2173
75°	2130	1953	1991
80°	1790	1629	1645
85°	1260	1080	1077

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3171 cd/sqm

TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	314.4	2.3
10°-20°	884.7	6.5
20°-30°	1300.2	9.6
30°-40°	1510.1	11.1
40°-50°	1508.2	11.1
50°-60°	1315.1	9.7
60°-70°	972.2	7.2
70°-80°	550.0	4.1
80°-90°	150.3	1.1
90°-100°	112.0	0.8
100°-110°	355.9	2.6
110°-120°	609.1	4.5
120°-130°	801.1	5.9
130°-140°	899.2	6.6
140°-150°	881.7	6.5
150°-160°	739.6	5.5
160°-170°	490.5	3.6
170°-180°	171.4	1.3
0°-30°	2499.3	18.4
0°-40°	4009.4	29.6
0°-60°	6832.8	50.4
0°-90°	8505.3	62.7
90°-120°	1077.0	7.9
90°-150°	3659.0	27.0
90°-180°	5061.0	37.3
0°-180°	13565.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3341	3341	3341	3341	3341	
5°	3341	3328	3293	3318	3312	317
15°	3180	3161	3119	3132	3116	896
25°	2878	2853	2798	2804	2798	1324
35°	2483	2451	2400	2380	2364	1551
45°	2021	1998	1950	1915	1902	1560
55°	1529	1510	1471	1433	1417	1367
65°	1031	1012	980	951	935	1020
75°	540	533	517	498	504	576
85°	132	128	126	116	112	147
90°	2	20	54	50	52	13
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3340.8	3340.8	3340.8	3340.8	3340.8
2.5°	3360.3	3344.2	3308.9	3340.8	3334.7
5°	3340.8	3328.2	3292.8	3318.4	3312.2
7.5°	3318.4	3299.3	3263.8	3289.8	3283.3
10°	3283.3	3260.8	3222.2	3247.8	3238.3
12.5°	3234.8	3215.7	3177.3	3193.2	3186.8
15°	3180.3	3161.3	3119.3	3132.3	3116.2
17.5°	3112.8	3093.7	3051.8	3067.9	3051.8
20°	3038.9	3019.8	2974.8	2984.3	2971.7
22.5°	2965.2	2936.3	2894.3	2894.3	2887.9
25°	2878.3	2852.7	2798.3	2804.4	2798.3
27.5°	2781.9	2759.3	2717.9	2708.3	2692.3
30°	2685.8	2659.8	2611.8	2602.2	2589.3
32.5°	2582.9	2563.8	2512.3	2492.9	2479.9
35°	2483.4	2451.3	2399.8	2380.4	2364.4
37.5°	2370.9	2341.9	2290.4	2267.9	2251.9
40°	2255.3	2229.4	2177.9	2149.3	2136.4
42.5°	2142.8	2116.9	2065.8	2033.5	2014.4
45°	2020.8	1998.3	1949.9	1914.8	1901.9
47.5°	1901.9	1879.4	1827.9	1792.5	1773.4
50°	1776.4	1760.4	1715.4	1670.5	1654.4
52.5°	1654.4	1631.9	1590.3	1554.9	1532.4
55°	1529.4	1509.9	1471.4	1432.9	1416.9
57.5°	1403.9	1387.9	1346.0	1307.5	1294.5
60°	1278.5	1265.9	1220.8	1185.4	1175.9
62.5°	1156.4	1133.9	1101.9	1069.9	1056.9
65°	1031.4	1011.9	979.9	950.9	934.9
67.5°	902.9	886.6	857.8	835.4	822.4
70°	783.9	770.9	742.0	719.5	706.9
72.5°	661.9	648.9	632.9	610.5	600.9
75°	539.6	533.4	517.1	498.0	504.5
77.5°	430.4	417.6	411.1	401.5	392.0
80°	321.4	318.0	311.5	301.9	295.5
82.5°	218.5	218.5	215.4	202.4	202.4
85°	131.6	128.5	125.5	115.5	112.5
87.5°	57.9	51.4	45.0	35.5	32.1
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4



TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P925624

CATALOG NUMBER: DFN2DIP-SQ3F0-090D060US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.00	13.98	13.84	14.85	15.92	12.55	13.54	13.39	14.40	15.48
	3H	14.66	15.55	15.51	16.42	17.53	14.17	15.06	15.02	15.93	17.04
	4H	15.25	16.09	16.12	16.97	18.08	14.76	15.60	15.63	16.47	17.59
	6H	15.65	16.43	16.54	17.31	18.44	15.15	15.93	16.04	16.81	17.94
	8H	15.76	16.50	16.65	17.40	18.53	15.26	16.00	16.15	16.90	18.03
	12H	15.81	16.51	16.71	17.41	18.57	15.30	16.00	16.20	16.90	18.06
4H	2H	13.47	14.31	14.34	15.19	16.30	13.11	13.95	13.99	14.83	15.95
	3H	15.34	16.04	16.23	16.95	18.08	14.93	15.63	15.82	16.54	17.67
	4H	16.06	16.69	16.95	17.60	18.76	15.63	16.27	16.53	17.18	18.33
	6H	16.57	17.13	17.49	18.06	19.21	16.14	16.69	17.05	17.62	18.78
	8H	16.72	17.24	17.64	18.16	19.34	16.29	16.80	17.20	17.73	18.90
	12H	16.80	17.27	17.74	18.21	19.39	16.35	16.82	17.29	17.76	18.94
8H	4H	16.26	16.77	17.17	17.70	18.87	15.88	16.40	16.80	17.32	18.49
	6H	16.89	17.32	17.83	18.28	19.45	16.51	16.93	17.45	17.90	19.07
	8H	17.11	17.49	18.06	18.44	19.63	16.71	17.09	17.67	18.05	19.24
	12H	17.24	17.57	18.20	18.53	19.76	16.83	17.16	17.78	18.11	19.35
12H	4H	16.25	16.71	17.18	17.66	18.83	15.88	16.35	16.81	17.29	18.47
	6H	16.92	17.30	17.87	18.25	19.44	16.55	16.92	17.50	17.88	19.07
	8H	17.16	17.50	18.12	18.45	19.68	16.78	17.11	17.74	18.06	19.30