

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925714

Luminaire Tested: DFN2DIP-SQ3F0-110D100US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925714
REPORT IS A COMBINATION OF REPORTS P899984 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D100US950-RLLFLL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17362.8 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 189.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLLFLL

Luminous Intensity Polar Plot

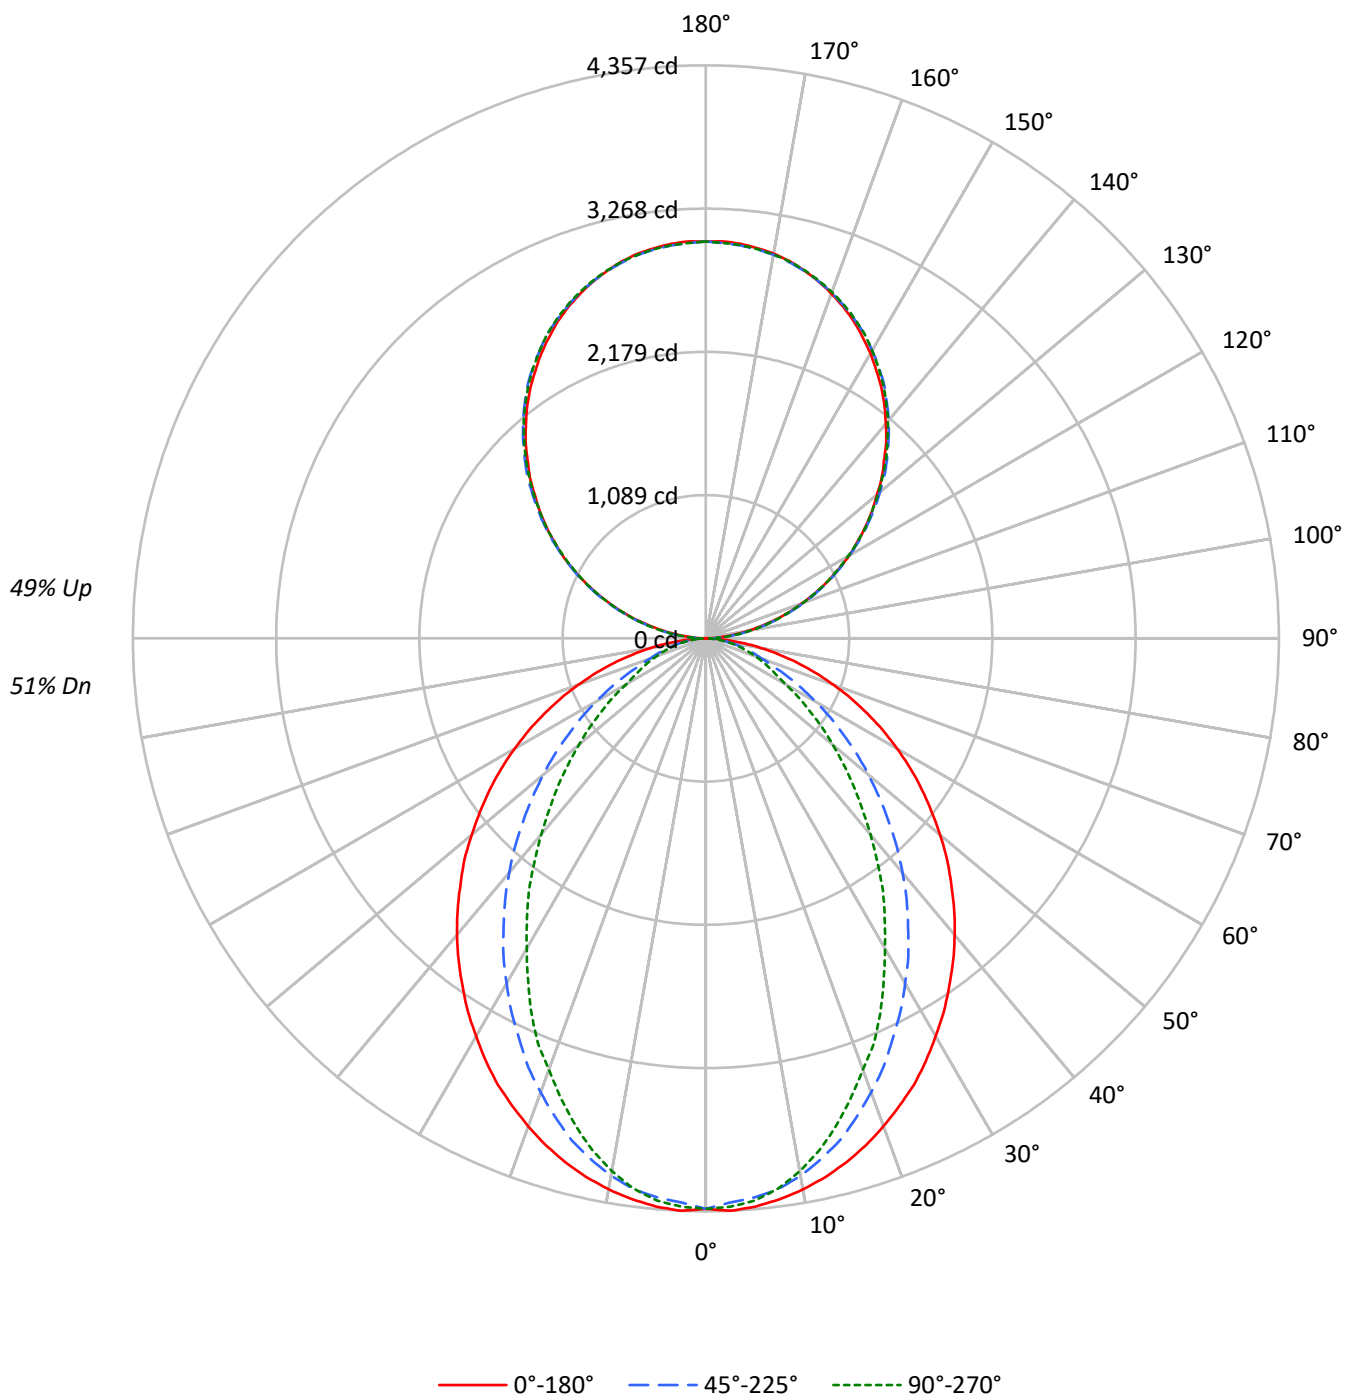

TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84		70	70	70		57
1	99	94	91	87	91	87	84	81	74	72	70		63	61	59		52
2	90	83	77	72	83	77	72	68	66	62	59		56	53	50		46
3	83	73	66	61	76	68	62	57	59	54	50		50	46	43		41
4	76	65	58	52	70	61	54	49	52	47	43		44	41	37		37
5	70	58	51	45	64	55	48	42	47	42	38		40	36	33		34
6	64	53	45	39	59	49	42	37	43	37	33		36	32	29		31
7	60	48	40	34	55	45	38	33	39	33	29		33	29	26		28
8	55	43	36	31	51	41	34	29	36	30	26		31	26	23		26
9	52	40	32	27	48	37	31	26	33	27	24		28	24	21		24
10	48	37	29	25	45	34	28	24	30	25	21		26	22	19		22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4970	4970	4970
5°	4974	4887	4920
10°	4922	4788	4759
15°	4851	4627	4510
20°	4758	4406	4205
25°	4663	4158	3910
30°	4537	3905	3537
35°	4412	3633	3210
40°	4286	3352	2834
45°	4139	3040	2494
50°	3987	2726	2162
55°	3828	2390	1843
60°	3644	2040	1516
65°	3431	1685	1362
70°	3174	1353	1230
75°	2850	1186	1116
80°	2381	984	963
85°	1615	641	713

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4139 cd/sqm

TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.5	2.3
10°-20°	1115.9	6.4
20°-30°	1566.7	9.0
30°-40°	1707.7	9.8
40°-50°	1569.6	9.0
50°-60°	1232.7	7.1
60°-70°	802.4	4.6
70°-80°	413.0	2.4
80°-90°	114.0	0.7
90°-100°	186.7	1.1
100°-110°	593.2	3.4
110°-120°	1015.2	5.8
120°-130°	1335.1	7.7
130°-140°	1498.6	8.6
140°-150°	1469.5	8.5
150°-160°	1232.7	7.1
160°-170°	817.5	4.7
170°-180°	285.7	1.6
0°-30°	3089.0	17.8
0°-40°	4796.8	27.6
0°-60°	7599.1	43.8
0°-90°	8928.5	51.4
90°-120°	1795.1	10.3
90°-150°	6098.3	35.1
90°-180°	8434.0	48.6
0°-180°	17362.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4337	4337	4337	4337	4337	
5°	4337	4318	4266	4302	4290	411
15°	4125	4082	3949	3874	3835	1162
25°	3744	3619	3360	3199	3140	1722
35°	3226	3026	2681	2434	2347	2019
45°	2638	2374	1963	1684	1590	2037
55°	2006	1700	1276	1040	966	1792
65°	1354	1036	683	550	538	1343
75°	722	447	314	286	283	764
85°	169	86	74	74	74	194
90°	3	33	89	84	86	17
95°	133	158	163	163	158	148
105°	548	555	560	565	565	578
115°	1019	1033	1029	1026	1019	1008
125°	1482	1504	1497	1489	1486	1324
135°	1916	1945	1950	1948	1940	1481
145°	2327	2345	2360	2362	2352	1454
155°	2661	2668	2676	2689	2680	1225
165°	2894	2892	2892	2910	2897	817
175°	3012	3004	2999	3017	3002	286
180°	3017	3017	3017	3017	3017	



TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4337.2	4337.2	4337.2	4337.2	4337.2
2.5°	4356.7	4337.2	4293.9	4333.4	4325.5
5°	4337.2	4317.6	4266.4	4301.8	4290.1
7.5°	4301.8	4278.4	4223.5	4238.9	4219.3
10°	4254.7	4227.2	4148.9	4136.8	4113.6
12.5°	4196.0	4160.6	4054.4	4031.0	3987.7
15°	4125.2	4081.9	3948.6	3874.1	3834.9
17.5°	4042.8	3979.9	3815.0	3728.7	3665.8
20°	3948.6	3869.9	3673.8	3575.9	3489.3
22.5°	3846.6	3756.2	3528.5	3395.2	3336.4
25°	3744.5	3618.8	3359.8	3199.0	3139.9
27.5°	3623.0	3489.3	3202.8	3018.3	2927.9
30°	3493.5	3344.0	3030.0	2830.0	2723.9
32.5°	3367.7	3186.9	2865.4	2629.8	2531.5
35°	3226.5	3026.2	2681.0	2433.7	2347.0
37.5°	3089.1	2873.0	2508.2	2237.0	2139.2
40°	2943.8	2708.5	2327.5	2048.8	1946.8
42.5°	2794.6	2543.6	2147.2	1856.5	1758.6
45°	2637.7	2374.5	1962.7	1683.6	1589.6
47.5°	2488.6	2210.0	1786.1	1507.0	1420.9
50°	2323.7	2045.1	1613.3	1342.2	1260.1
52.5°	2162.5	1868.1	1448.4	1189.4	1114.7
55°	2005.5	1699.5	1275.5	1040.2	965.7
57.5°	1844.8	1530.8	1122.7	902.9	839.9
60°	1679.9	1365.9	961.5	761.7	698.8
62.5°	1519.1	1205.2	824.2	635.9	604.6
65°	1354.2	1036.0	683.0	549.7	537.6
67.5°	1197.3	879.1	549.7	482.6	471.0
70°	1032.3	726.3	455.2	416.0	400.2
72.5°	875.3	584.7	380.6	349.4	341.4
75°	722.1	447.2	314.0	286.5	282.8
77.5°	569.3	317.8	247.4	231.5	223.6
80°	427.7	227.8	188.2	172.9	172.9
82.5°	298.1	153.2	129.6	121.6	121.6
85°	168.7	86.2	74.5	74.5	74.5
87.5°	62.9	31.2	31.2	27.5	27.5
90°	2.8	32.7	89.1	83.7	86.4
92.5°	56.4	76.4	79.2	81.9	81.9
95°	132.8	158.3	162.8	162.8	158.3
97.5°	221.0	244.7	254.7	254.7	254.7
100°	322.9	343.8	351.1	351.1	348.4
102.5°	430.3	445.7	455.7	458.4	455.7
105°	547.6	554.8	560.3	564.9	564.9
107.5°	664.0	675.0	675.0	676.8	664.0
110°	776.8	791.3	791.3	791.3	784.1

TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	898.7	914.1	911.5	904.1	898.7
115°	1018.8	1033.3	1028.8	1026.0	1018.8
117.5°	1137.9	1158.0	1145.2	1137.9	1130.6
120°	1257.9	1278.0	1257.9	1257.9	1249.8
122.5°	1367.1	1392.6	1379.9	1372.6	1367.1
125°	1481.8	1504.5	1497.2	1489.0	1486.3
127.5°	1593.7	1621.8	1611.8	1600.9	1593.7
130°	1698.2	1730.9	1726.5	1720.9	1711.0
132.5°	1815.6	1841.0	1842.8	1830.2	1822.8
135°	1916.5	1944.7	1950.2	1947.5	1940.1
137.5°	2029.3	2052.1	2056.6	2054.8	2043.8
140°	2128.5	2151.2	2164.0	2164.0	2153.9
142.5°	2230.4	2253.1	2260.3	2263.1	2253.1
145°	2326.7	2344.9	2359.5	2362.2	2352.2
147.5°	2413.1	2435.9	2446.8	2451.4	2441.4
150°	2502.3	2517.8	2527.8	2535.9	2527.8
152.5°	2581.4	2596.9	2609.7	2619.7	2609.7
155°	2660.6	2667.9	2676.1	2688.8	2680.5
157.5°	2728.8	2734.3	2738.8	2757.0	2744.3
160°	2789.8	2795.2	2797.9	2813.3	2802.5
162.5°	2846.2	2846.2	2848.8	2866.1	2853.4
165°	2894.3	2891.6	2891.6	2909.8	2897.1
167.5°	2938.0	2929.8	2929.8	2948.1	2935.3
170°	2970.8	2963.5	2960.7	2979.0	2963.5
172.5°	2993.5	2986.2	2983.4	3001.7	2986.2
175°	3011.7	3004.4	2999.0	3017.1	3001.7
177.5°	3021.7	3014.4	3008.9	3024.4	3008.9
180°	3017.1	3017.1	3017.1	3017.1	3017.1

TEST NUMBER: P925714

CATALOG NUMBER: DFN2DIP-SQ3F0-110D100US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.81	13.66	13.77	14.62	15.87	8.78	9.62	9.73	10.58	11.83
	3H	14.49	15.24	15.45	16.21	17.49	9.96	10.71	10.92	11.68	12.96
	4H	15.09	15.81	16.07	16.78	18.07	10.40	11.12	11.38	12.09	13.38
	6H	15.51	16.17	16.50	17.15	18.45	10.72	11.38	11.71	12.36	13.65
	8H	15.64	16.26	16.63	17.26	18.55	10.81	11.43	11.80	12.43	13.72
	12H	15.70	16.29	16.70	17.28	18.60	10.85	11.44	11.85	12.43	13.75
4H	2H	12.83	13.54	13.82	14.52	15.81	9.37	10.08	10.35	11.06	12.34
	3H	14.66	15.25	15.65	16.25	17.55	10.71	11.31	11.71	12.31	13.61
	4H	15.35	15.89	16.35	16.88	18.21	11.26	11.80	12.26	12.80	14.12
	6H	15.86	16.32	16.87	17.34	18.66	11.67	12.13	12.68	13.16	14.48
	8H	16.03	16.46	17.04	17.48	18.81	11.80	12.23	12.81	13.24	14.58
	12H	16.12	16.51	17.15	17.54	18.88	11.86	12.25	12.89	13.28	14.62
8H	4H	15.31	15.75	16.33	16.76	18.10	11.53	11.97	12.55	12.98	14.32
	6H	15.87	16.23	16.91	17.29	18.62	12.05	12.40	13.08	13.46	14.79
	8H	16.09	16.40	17.13	17.45	18.80	12.23	12.55	13.28	13.59	14.94
	12H	16.22	16.50	17.27	17.54	18.93	12.35	12.62	13.39	13.66	15.05
12H	4H	15.27	15.66	16.30	16.69	18.03	11.54	11.93	12.57	12.96	14.30
	6H	15.85	16.16	16.89	17.21	18.56	12.09	12.41	13.14	13.45	14.80
	8H	16.07	16.34	17.11	17.38	18.78	12.30	12.58	13.35	13.61	15.01

END OF REPORT