

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925716

Luminaire Tested: DFN2DIP-SQ3F0-110D110US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925716
REPORT IS A COMBINATION OF REPORTS P900001 AND P896733
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-110D110US950-FLLFLL
Description: 3 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19676.3 lumens
Efficiency: N/A
Efficacy: 99.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 197.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFLL

Luminous Intensity Polar Plot

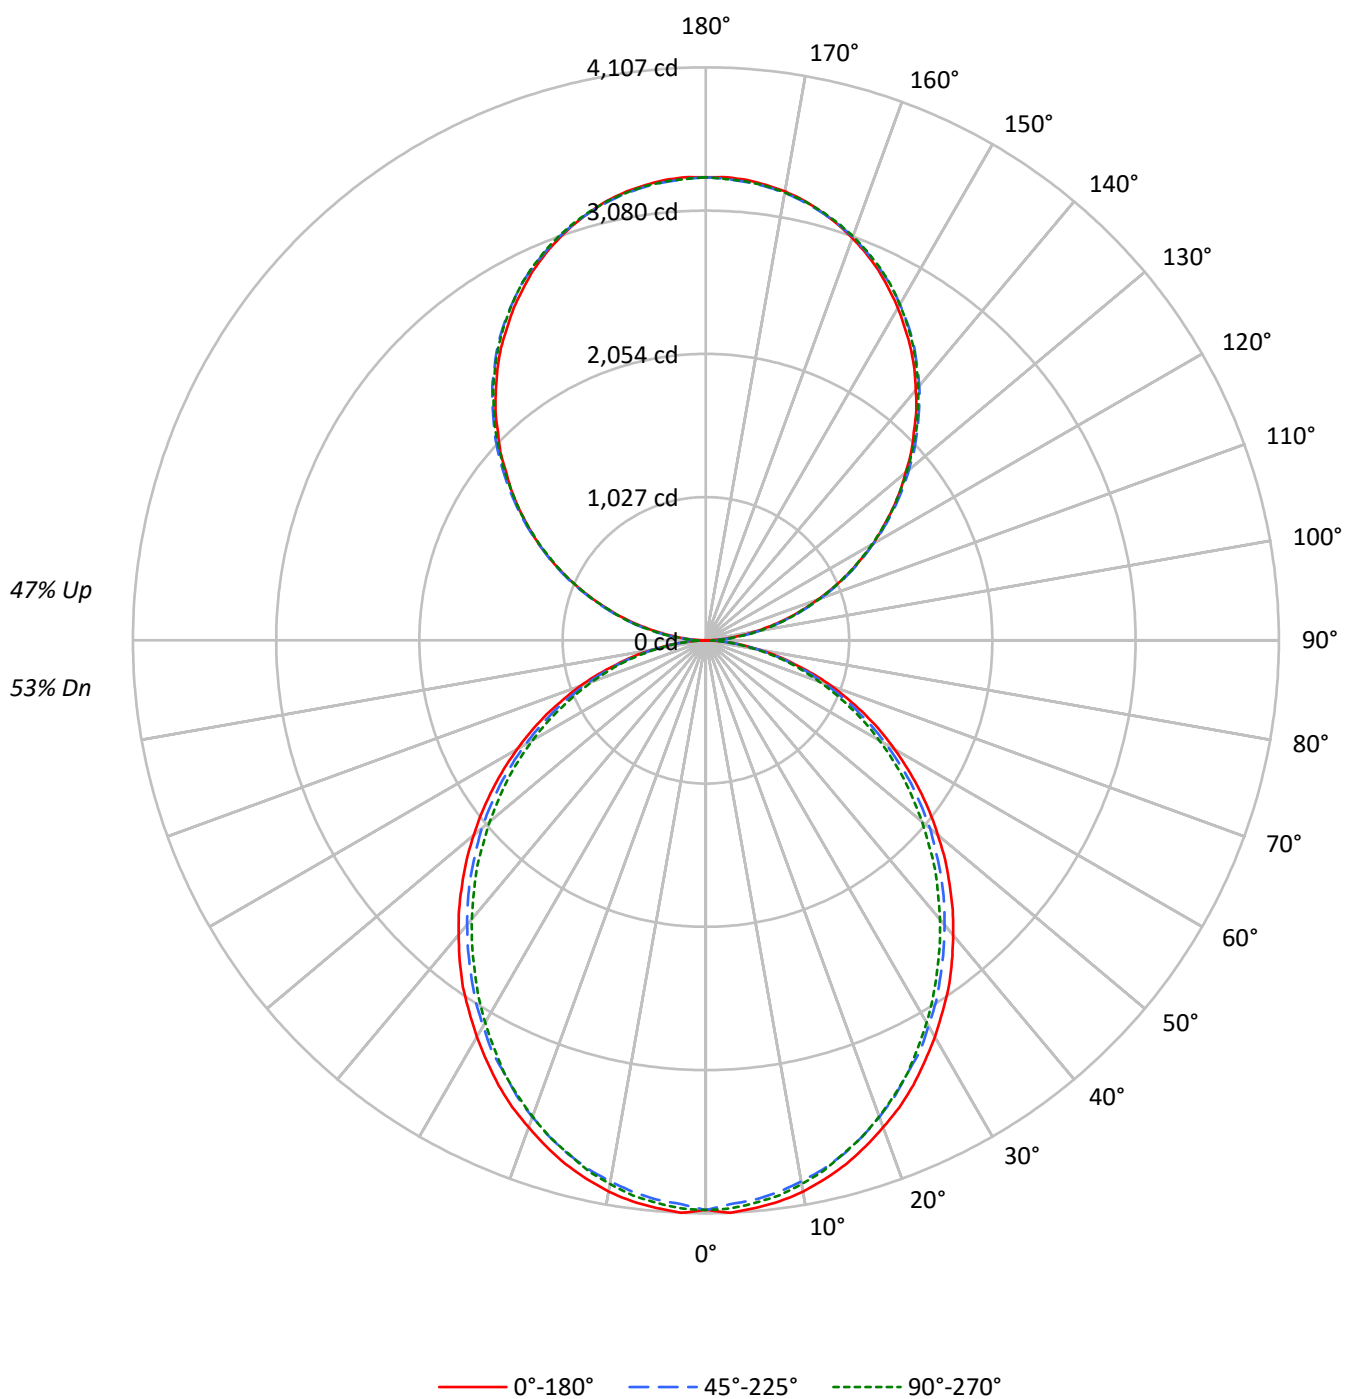

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4679	4679	4679
5°	4683	4610	4643
10°	4642	4545	4579
15°	4571	4467	4479
20°	4476	4360	4377
25°	4381	4233	4259
30°	4263	4114	4110
35°	4151	3974	3952
40°	4013	3833	3801
45°	3876	3691	3648
50°	3725	3542	3470
55°	3568	3370	3305
60°	3389	3166	3117
65°	3194	2955	2895
70°	2946	2696	2656
75°	2602	2386	2433
80°	2188	1991	2011
85°	1540	1319	1317

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3876 cd/sqm

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	384.3	2.0
10°-20°	1081.3	5.5
20°-30°	1589.1	8.1
30°-40°	1845.7	9.4
40°-50°	1843.4	9.4
50°-60°	1607.4	8.2
60°-70°	1188.2	6.0
70°-80°	672.3	3.4
80°-90°	186.9	0.9
90°-100°	205.4	1.0
100°-110°	652.5	3.3
110°-120°	1116.7	5.7
120°-130°	1468.6	7.5
130°-140°	1648.4	8.4
140°-150°	1616.5	8.2
150°-160°	1356.0	6.9
160°-170°	899.3	4.6
170°-180°	314.3	1.6
0°-30°	3054.8	15.5
0°-40°	4900.4	24.9
0°-60°	8351.2	42.4
0°-90°	10398.5	52.8
90°-120°	1974.6	10.0
90°-150°	6708.2	34.1
90°-180°	9278.0	47.2
0°-180°	19676.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4083	4083	4083	4083	4083	
5°	4083	4068	4024	4056	4048	388
15°	3887	3864	3812	3828	3809	1095
25°	3518	3487	3420	3428	3420	1619
35°	3035	2996	2933	2909	2890	1895
45°	2470	2442	2383	2340	2324	1906
55°	1869	1845	1798	1751	1732	1671
65°	1260	1237	1198	1162	1143	1246
75°	659	652	632	609	617	704
85°	161	157	153	141	138	179
90°	3	36	98	92	95	19
95°	146	174	179	179	174	163
105°	602	610	616	621	621	636
115°	1121	1137	1132	1129	1121	1108
125°	1630	1655	1647	1638	1635	1457
135°	2108	2139	2145	2142	2134	1630
145°	2559	2579	2596	2598	2587	1599
155°	2927	2935	2944	2958	2949	1347
165°	3184	3181	3181	3201	3187	898
175°	3313	3305	3299	3319	3302	315
180°	3319	3319	3319	3319	3319	

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4083.3	4083.3	4083.3	4083.3	4083.3
2.5°	4107.0	4087.4	4044.1	4083.3	4075.8
5°	4083.3	4067.9	4024.5	4055.7	4048.3
7.5°	4055.7	4032.5	3989.2	4020.8	4012.9
10°	4012.9	3985.3	3938.3	3969.5	3957.9
12.5°	3953.8	3930.4	3883.4	3902.9	3895.0
15°	3887.1	3863.7	3812.5	3828.3	3808.7
17.5°	3804.6	3781.3	3730.0	3749.6	3730.0
20°	3714.2	3690.8	3635.9	3647.5	3632.2
22.5°	3624.2	3588.8	3537.5	3537.5	3529.6
25°	3518.0	3486.8	3420.1	3427.6	3420.1
27.5°	3400.1	3372.6	3321.7	3310.1	3290.5
30°	3282.6	3250.9	3192.2	3180.5	3164.7
32.5°	3156.8	3133.5	3070.5	3046.8	3031.0
35°	3035.2	2996.0	2933.1	2909.3	2889.8
37.5°	2897.7	2862.3	2799.4	2771.8	2752.3
40°	2756.5	2724.8	2661.9	2626.9	2611.1
42.5°	2619.0	2587.3	2524.9	2485.3	2462.0
45°	2469.9	2442.3	2383.2	2340.4	2324.5
47.5°	2324.5	2297.0	2234.1	2190.8	2167.4
50°	2171.2	2151.7	2096.6	2041.7	2022.1
52.5°	2022.1	1994.5	1943.8	1900.4	1872.9
55°	1869.2	1845.4	1798.4	1751.3	1731.7
57.5°	1715.9	1696.3	1645.1	1597.9	1582.1
60°	1562.6	1547.2	1492.2	1448.8	1437.2
62.5°	1413.4	1386.0	1346.8	1307.6	1291.8
65°	1260.5	1236.8	1197.7	1162.3	1142.7
67.5°	1103.5	1083.6	1048.5	1021.1	1005.2
70°	958.1	942.3	906.9	879.4	863.9
72.5°	809.0	793.2	773.6	746.1	734.4
75°	659.4	652.0	631.9	608.7	616.6
77.5°	526.1	510.3	502.4	490.7	479.1
80°	392.9	388.7	380.7	369.1	361.2
82.5°	267.0	267.0	263.3	247.5	247.5
85°	160.8	157.0	153.3	141.2	137.5
87.5°	70.8	62.9	55.0	43.3	39.1
90°	3.0	36.1	98.1	92.1	95.0
92.5°	62.0	84.0	87.0	90.1	90.1
95°	146.1	174.1	179.1	179.1	174.1
97.5°	243.2	269.1	280.2	280.2	280.2
100°	355.2	378.2	386.2	386.2	383.2
102.5°	473.3	490.3	501.3	504.3	501.3
105°	602.4	610.4	616.4	621.3	621.3
107.5°	730.4	742.4	742.4	744.4	730.4
110°	854.5	870.5	870.5	870.5	862.5

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	988.5	1005.5	1002.6	994.5	988.5
115°	1120.7	1136.6	1131.6	1128.7	1120.7
117.5°	1251.7	1273.7	1259.7	1251.7	1243.7
120°	1383.8	1405.8	1383.8	1383.8	1374.8
122.5°	1503.9	1531.8	1517.8	1509.8	1503.9
125°	1629.9	1654.9	1646.9	1637.9	1634.9
127.5°	1753.0	1784.0	1773.0	1761.0	1753.0
130°	1868.0	1904.1	1899.0	1893.0	1882.1
132.5°	1997.1	2025.2	2027.2	2013.1	2005.1
135°	2108.1	2139.2	2145.2	2142.2	2134.2
137.5°	2232.3	2257.3	2262.2	2260.2	2248.3
140°	2341.3	2366.3	2380.3	2380.3	2369.4
142.5°	2453.4	2478.4	2486.4	2489.4	2478.4
145°	2559.4	2579.4	2595.5	2598.4	2587.4
147.5°	2654.5	2679.5	2691.5	2696.5	2685.5
150°	2752.6	2769.6	2780.5	2789.6	2780.5
152.5°	2839.6	2856.6	2870.6	2881.7	2870.6
155°	2926.7	2934.6	2943.7	2957.7	2948.6
157.5°	3001.7	3007.7	3012.6	3032.7	3018.6
160°	3068.7	3074.7	3077.7	3094.8	3082.8
162.5°	3130.7	3130.7	3133.8	3152.8	3138.8
165°	3183.8	3180.7	3180.7	3200.8	3186.7
167.5°	3231.8	3222.8	3222.8	3242.8	3228.8
170°	3267.8	3259.8	3256.9	3276.8	3259.8
172.5°	3292.8	3284.8	3281.9	3301.9	3284.8
175°	3312.9	3304.8	3298.8	3318.9	3301.9
177.5°	3323.8	3315.8	3309.8	3326.9	3309.8
180°	3318.9	3318.9	3318.9	3318.9	3318.9

TEST NUMBER: P925716

CATALOG NUMBER: DFN2DIP-SQ3F0-110D110US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.86	13.74	13.79	14.69	15.92	12.41	13.30	13.34	14.25	15.48
	3H	14.52	15.31	15.46	16.27	17.52	14.02	14.82	14.97	15.78	17.03
	4H	15.10	15.85	16.06	16.82	18.08	14.61	15.36	15.56	16.32	17.59
	6H	15.50	16.19	16.47	17.16	18.44	15.00	15.69	15.97	16.66	17.94
	8H	15.60	16.26	16.58	17.25	18.52	15.10	15.76	16.08	16.75	18.02
	12H	15.65	16.28	16.63	17.26	18.56	15.14	15.77	16.12	16.75	18.05
4H	2H	13.32	14.07	14.28	15.03	16.30	12.96	13.72	13.93	14.68	15.94
	3H	15.18	15.81	16.15	16.80	18.08	14.77	15.40	15.75	16.39	17.67
	4H	15.89	16.47	16.87	17.45	18.75	15.47	16.04	16.45	17.03	18.33
	6H	16.40	16.90	17.40	17.91	19.21	15.97	16.47	16.97	17.48	18.78
	8H	16.55	17.01	17.55	18.02	19.33	16.11	16.58	17.11	17.58	18.89
	12H	16.62	17.04	17.64	18.06	19.38	16.18	16.59	17.19	17.61	18.93
8H	4H	16.09	16.55	17.08	17.55	18.87	15.71	16.17	16.71	17.18	18.49
	6H	16.71	17.10	17.73	18.14	19.45	16.33	16.71	17.35	17.76	19.07
	8H	16.93	17.27	17.96	18.30	19.63	16.54	16.88	17.57	17.91	19.24
	12H	17.06	17.36	18.09	18.38	19.76	16.65	16.95	17.68	17.97	19.35
12H	4H	16.07	16.49	17.09	17.51	18.83	15.70	16.12	16.72	17.14	18.46
	6H	16.74	17.08	17.77	18.11	19.44	16.37	16.71	17.40	17.74	19.07
	8H	16.98	17.28	18.01	18.30	19.68	16.60	16.90	17.63	17.92	19.30

END OF REPORT