

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P925727

Luminaire Tested: DFN2DIP-SQ3F0-120D040US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P925727
REPORT IS A COMBINATION OF REPORTS P901398 AND P898289
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ3F0-120D040US950-RLLONL
Description: 3 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13508.6 lumens
Efficiency: N/A
Efficacy: 86.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.06' x L: 3.06' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 156.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLLONL

Luminous Intensity Polar Plot

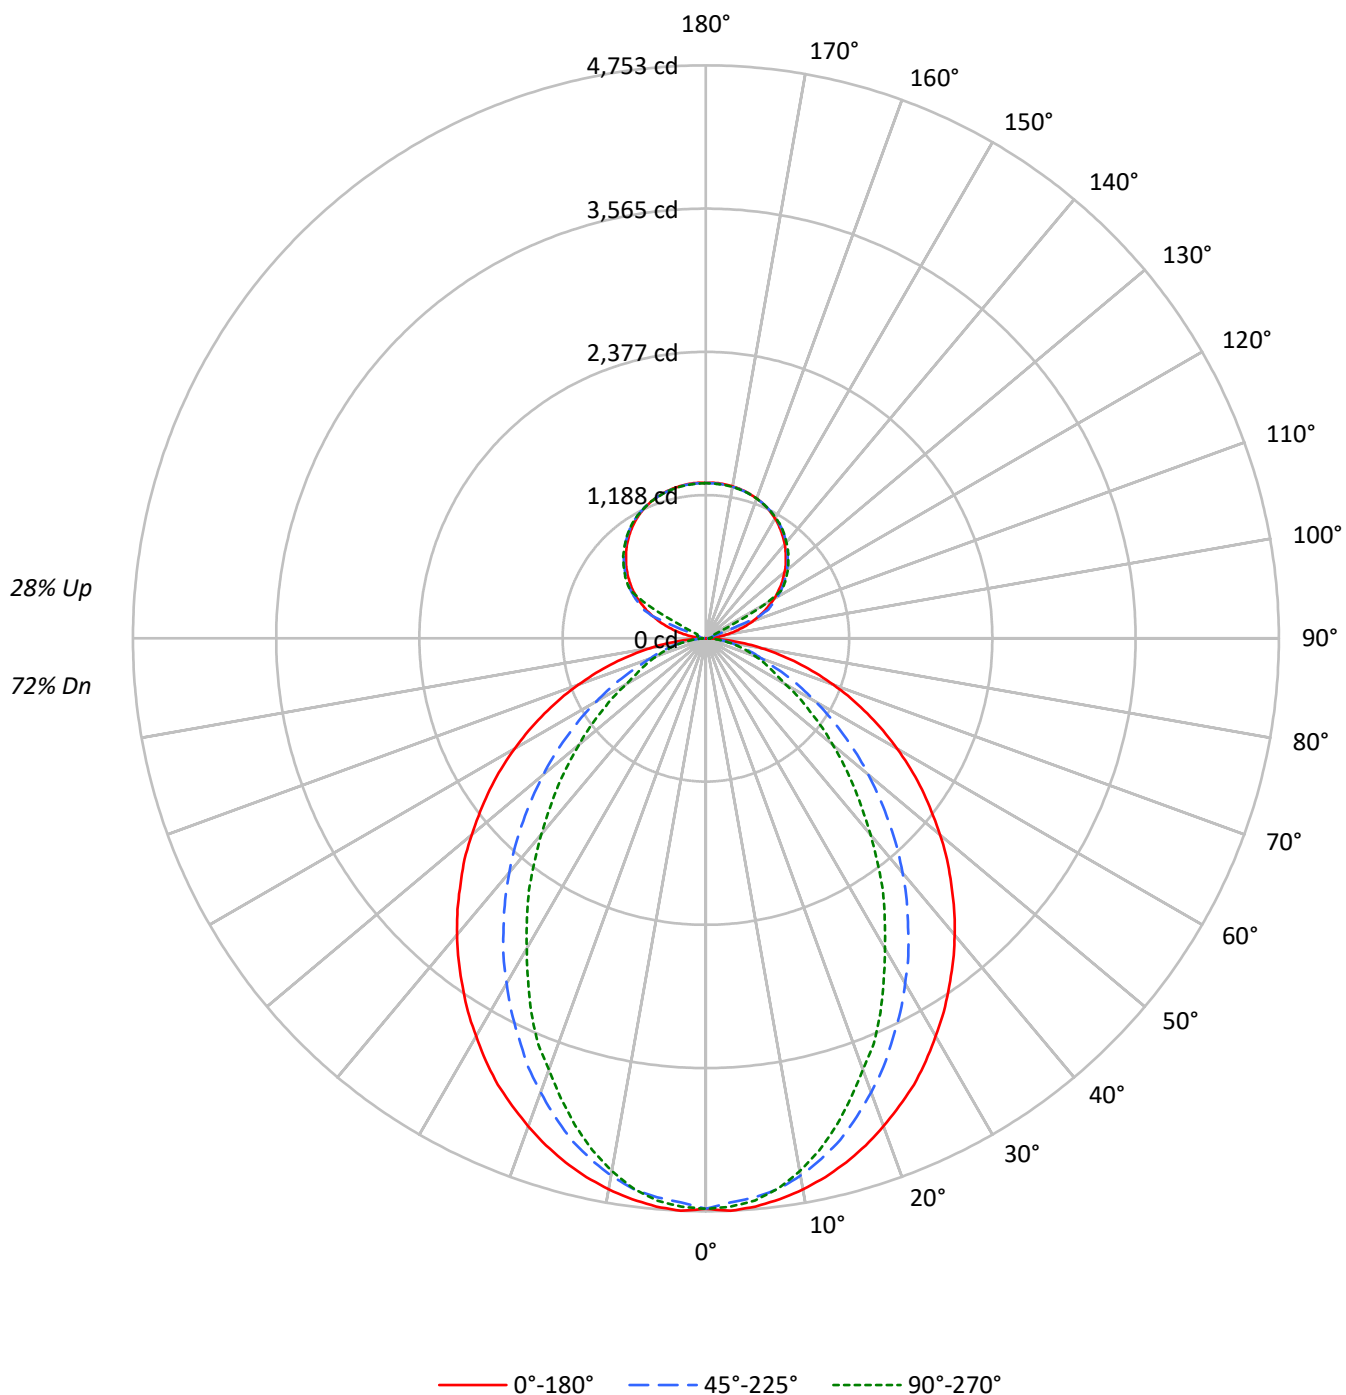

TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	107	107	107	107	96	96	96	86	86	86	76	76	76
1	103	99	95	92	98	94	91	88	85	82	80	76	75	73	69	67	66
2	95	87	81	76	90	83	78	73	75	71	68	68	65	62	61	59	57
3	87	78	70	65	82	74	67	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	54	60	54	50	55	50	46	50	46	43
5	74	62	54	48	70	59	52	47	54	48	44	50	45	41	45	41	38
6	68	56	48	42	65	54	46	41	49	43	39	45	40	36	41	37	34
7	63	51	43	38	60	49	42	36	45	39	34	41	36	32	38	34	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	27
9	55	43	35	30	52	41	34	30	38	32	28	35	30	26	32	28	25
10	52	40	32	28	49	38	31	27	35	29	25	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5421	5421	5421
5°	5427	5332	5368
10°	5369	5224	5191
15°	5292	5047	4920
20°	5191	4806	4587
25°	5087	4536	4266
30°	4949	4260	3859
35°	4814	3963	3501
40°	4675	3656	3092
45°	4515	3316	2721
50°	4350	2974	2359
55°	4176	2608	2011
60°	3975	2226	1653
65°	3744	1838	1486
70°	3463	1476	1342
75°	3109	1294	1217
80°	2598	1074	1050
85°	1762	700	778

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4515 cd/sqm

TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	443.4	3.3
10°-20°	1217.3	9.0
20°-30°	1709.1	12.7
30°-40°	1863.0	13.8
40°-50°	1712.3	12.7
50°-60°	1344.7	10.0
60°-70°	875.3	6.5
70°-80°	450.6	3.3
80°-90°	117.3	0.9
90°-100°	42.5	0.3
100°-110°	158.3	1.2
110°-120°	419.9	3.1
120°-130°	696.4	5.2
130°-140°	739.7	5.5
140°-150°	687.5	5.1
150°-160°	552.7	4.1
160°-170°	356.1	2.6
170°-180°	122.6	0.9
0°-30°	3369.8	24.9
0°-40°	5232.8	38.7
0°-60°	8289.9	61.4
0°-90°	9733.1	72.1
90°-120°	620.6	4.6
90°-150°	2744.1	20.3
90°-180°	3776.0	28.0
0°-180°	13508.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4732	4732	4732	4732	4732	
5°	4732	4710	4654	4693	4680	449
15°	4500	4453	4308	4226	4184	1268
25°	4085	3948	3665	3490	3425	1879
35°	3520	3301	2925	2655	2560	2203
45°	2878	2590	2141	1837	1734	2222
55°	2188	1854	1392	1135	1054	1955
65°	1477	1130	745	600	586	1465
75°	788	488	343	312	308	833
85°	184	94	81	81	81	211
90°	1	11	19	23	25	13
95°	60	30	36	41	40	72
105°	283	311	57	67	71	303
115°	536	552	575	144	76	527
125°	758	770	787	794	797	676
135°	938	952	961	970	968	724
145°	1088	1087	1102	1109	1104	680
155°	1198	1189	1200	1206	1198	552
165°	1262	1256	1259	1266	1259	356
175°	1291	1284	1286	1292	1283	123
180°	1288	1288	1288	1288	1288	

TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4731.5	4731.5	4731.5	4731.5	4731.5
2.5°	4752.8	4731.5	4684.2	4727.4	4718.7
5°	4731.5	4710.1	4654.2	4692.8	4680.1
7.5°	4692.8	4667.3	4607.4	4624.2	4602.9
10°	4641.5	4611.5	4526.1	4512.9	4487.5
12.5°	4577.4	4538.8	4422.9	4397.6	4350.3
15°	4500.2	4453.0	4307.6	4226.2	4183.6
17.5°	4410.2	4341.7	4161.7	4067.8	3999.2
20°	4307.6	4221.7	4007.8	3901.0	3806.5
22.5°	4196.3	4097.7	3849.2	3703.8	3639.8
25°	4085.0	3947.7	3665.2	3489.8	3425.3
27.5°	3952.3	3806.5	3493.9	3292.7	3194.1
30°	3811.0	3648.0	3305.4	3087.3	2971.5
32.5°	3673.9	3476.7	3126.0	2868.9	2761.6
35°	3519.9	3301.3	2924.7	2654.9	2560.3
37.5°	3369.9	3134.2	2736.2	2440.4	2333.7
40°	3211.4	2954.7	2539.1	2235.1	2123.8
42.5°	3048.7	2774.8	2342.4	2025.2	1918.5
45°	2877.5	2590.4	2141.1	1836.7	1734.0
47.5°	2714.8	2410.9	1948.4	1644.1	1550.1
50°	2535.0	2231.0	1759.9	1464.2	1374.7
52.5°	2359.1	2037.9	1580.0	1297.4	1216.2
55°	2187.9	1854.0	1391.5	1134.8	1053.5
57.5°	2012.5	1670.0	1224.7	984.9	916.3
60°	1832.6	1490.1	1048.9	830.9	762.3
62.5°	1657.3	1314.7	899.0	693.7	659.6
65°	1477.4	1130.3	745.1	599.7	586.5
67.5°	1306.1	959.0	599.7	526.5	513.8
70°	1126.2	792.3	496.6	453.8	436.6
72.5°	955.0	637.8	415.2	381.1	372.5
75°	787.7	487.9	342.6	312.5	308.4
77.5°	621.1	346.6	269.9	252.6	243.9
80°	466.6	248.5	205.3	188.5	188.5
82.5°	325.3	167.1	141.3	132.6	132.6
85°	184.0	94.1	81.3	81.3	81.3
87.5°	68.6	34.1	34.1	30.0	30.0
90°	0.9	11.2	18.6	23.4	25.1
92.5°	23.4	19.6	22.3	24.2	25.1
95°	60.5	29.8	36.3	41.0	40.1
97.5°	109.0	32.6	47.5	50.4	51.2
100°	164.9	37.3	53.1	60.5	62.4
102.5°	226.4	224.7	55.0	65.2	68.0
105°	283.2	311.3	56.9	67.1	70.8
107.5°	349.5	372.7	58.8	69.0	72.7
110°	412.9	432.4	163.1	69.9	73.6



TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	472.5	489.2	473.4	71.7	74.6
115°	535.8	551.6	575.0	143.5	76.5
117.5°	590.8	609.4	625.3	492.0	247.8
120°	652.3	666.3	683.1	694.3	568.5
122.5°	704.4	719.4	738.1	743.6	744.6
125°	757.6	769.8	787.4	794.0	796.8
127.5°	806.0	819.1	833.1	842.5	843.3
130°	851.7	866.7	876.8	887.1	886.3
132.5°	898.3	910.5	920.7	929.1	928.2
135°	937.5	952.5	960.8	970.1	968.3
137.5°	978.4	989.6	999.0	1008.3	1005.5
140°	1018.5	1026.0	1036.2	1044.6	1040.0
142.5°	1052.2	1058.7	1070.8	1078.1	1073.5
145°	1087.6	1086.6	1102.3	1108.9	1104.3
147.5°	1118.2	1115.4	1131.3	1135.9	1132.3
150°	1148.0	1141.6	1156.5	1162.1	1157.4
152.5°	1173.2	1165.8	1179.7	1185.3	1178.9
155°	1197.5	1189.2	1200.3	1205.9	1198.4
157.5°	1217.0	1209.6	1218.1	1224.6	1217.0
160°	1233.8	1228.2	1233.8	1239.3	1232.9
162.5°	1248.7	1243.2	1247.8	1254.3	1245.9
165°	1261.8	1256.2	1259.0	1265.5	1259.0
167.5°	1272.1	1266.3	1269.3	1275.8	1267.4
170°	1280.5	1274.8	1276.6	1283.2	1274.8
172.5°	1286.0	1280.5	1282.4	1288.9	1280.5
175°	1290.6	1284.1	1286.0	1292.5	1283.2
177.5°	1292.5	1286.0	1286.9	1293.5	1285.1
180°	1287.9	1287.9	1287.9	1287.9	1287.9

TEST NUMBER: P925727

CATALOG NUMBER: DFN2DIP-SQ3F0-120D040US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.84	15.89	15.59	16.65	17.57	10.80	11.85	11.55	12.61	13.53
	3H	16.53	17.47	17.29	18.24	19.19	12.00	12.94	12.76	13.71	14.66
	4H	17.14	18.03	17.92	18.81	19.77	12.45	13.34	13.23	14.12	15.08
	6H	17.57	18.39	18.36	19.18	20.16	12.78	13.59	13.57	14.39	15.36
	8H	17.70	18.48	18.50	19.29	20.27	12.87	13.65	13.67	14.46	15.44
	12H	17.77	18.51	18.58	19.31	20.32	12.92	13.66	13.73	14.46	15.47
4H	2H	14.88	15.77	15.66	16.55	17.51	11.42	12.30	12.20	13.09	14.05
	3H	16.72	17.46	17.52	18.28	19.26	12.78	13.51	13.58	14.33	15.31
	4H	17.42	18.09	18.23	18.91	19.91	13.33	14.00	14.14	14.82	15.82
	6H	17.94	18.52	18.77	19.36	20.38	13.75	14.33	14.58	15.17	16.19
	8H	18.12	18.66	18.95	19.50	20.52	13.88	14.42	14.72	15.26	16.29
	12H	18.22	18.70	19.07	19.56	20.59	13.96	14.44	14.81	15.30	16.33
8H	4H	17.40	17.94	18.23	18.78	19.80	13.62	14.16	14.46	15.00	16.03
	6H	17.97	18.42	18.83	19.30	20.32	14.14	14.59	15.00	15.47	16.49
	8H	18.19	18.58	19.06	19.46	20.50	14.33	14.72	15.20	15.60	16.64
	12H	18.33	18.68	19.20	19.54	20.64	14.45	14.80	15.32	15.67	16.76
12H	4H	17.36	17.85	18.21	18.71	19.74	13.64	14.12	14.49	14.98	16.01
	6H	17.95	18.34	18.82	19.22	20.26	14.19	14.58	15.06	15.46	16.50
	8H	18.17	18.52	19.05	19.39	20.49	14.40	14.75	15.28	15.62	16.72

END OF REPORT