

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903940

Luminaire Tested: DFN2DIP-SQ4F0-060D070US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903940
REPORT IS A COMBINATION OF REPORTS P900077 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D070US830-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11437.8 lumens
Efficiency: N/A
Efficacy: 111.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903940
CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

Luminous Intensity Polar Plot

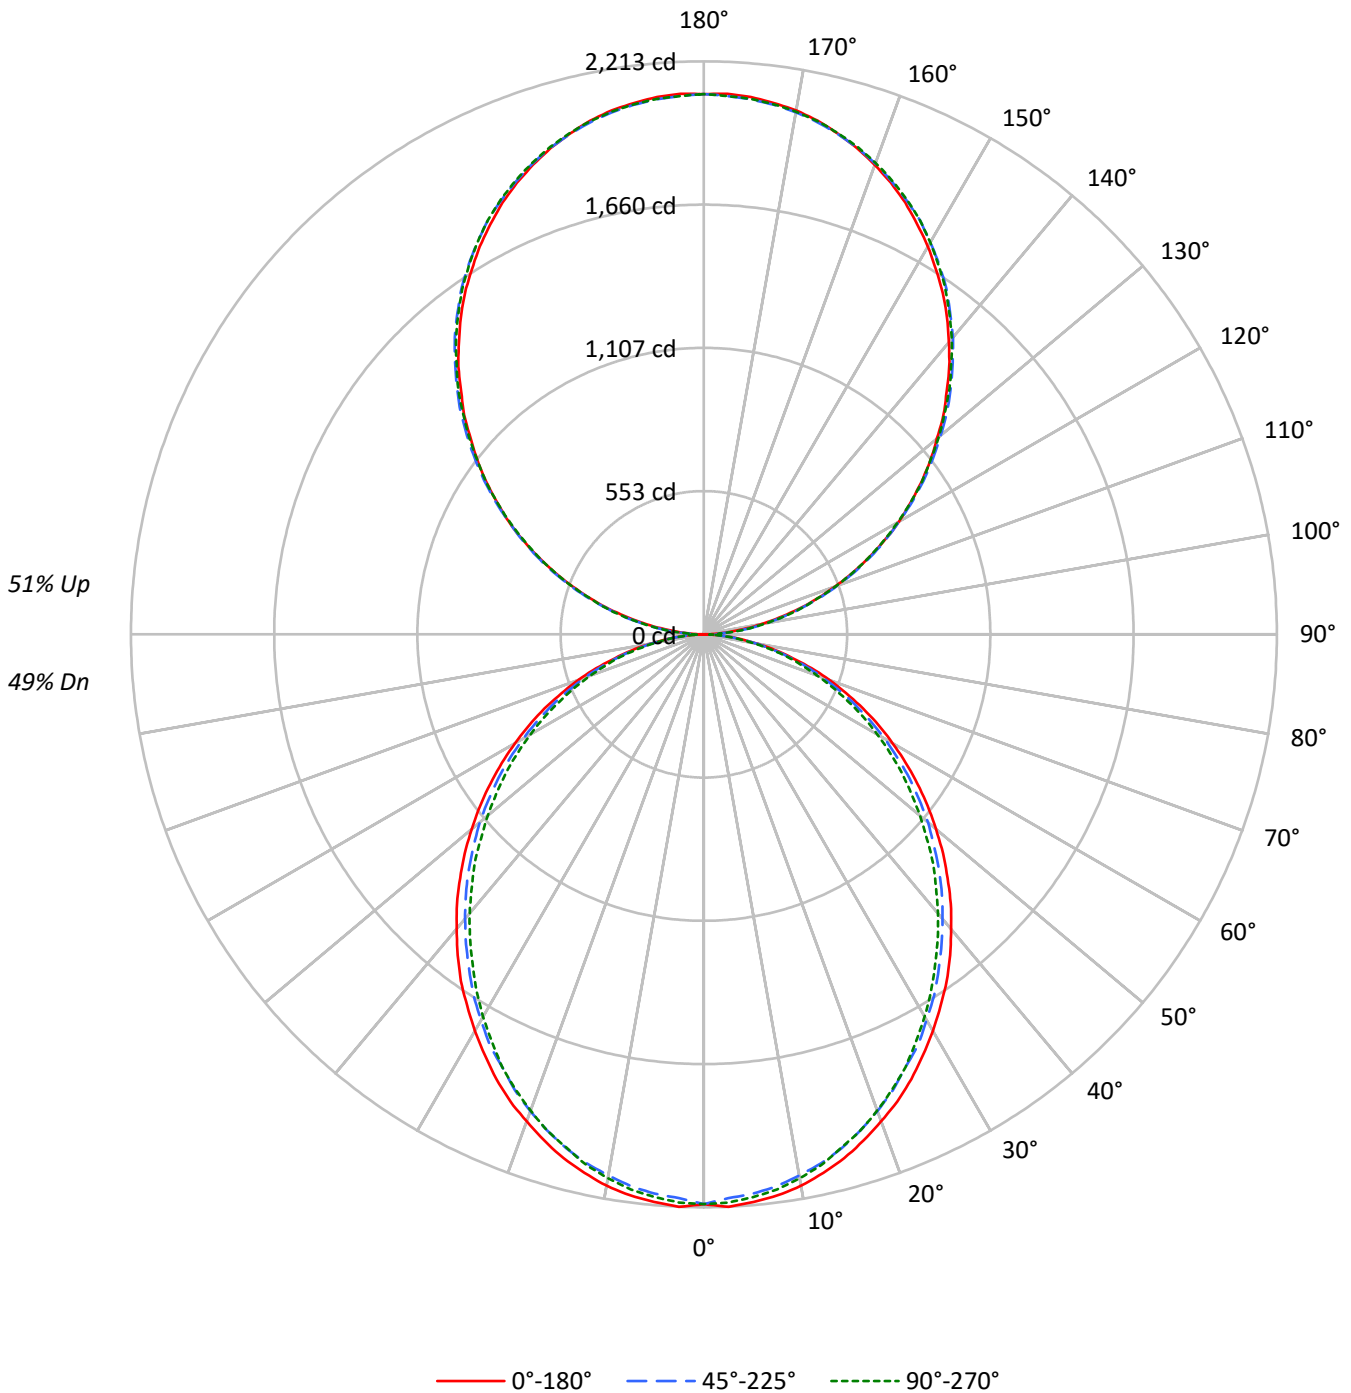



TEST NUMBER: P903940

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55	49				49
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47	41				41
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39	35				35
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33	29				29
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29	25				25
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25	22				22
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22	19				19
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20	17				17
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18	15				15
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16	14				14
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14	12				12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1544	1544	1544
5°	1546	1523	1533
10°	1534	1503	1513
15°	1511	1478	1481
20°	1481	1444	1448
25°	1450	1403	1410
30°	1413	1365	1362
35°	1377	1321	1311
40°	1332	1275	1262
45°	1288	1230	1212
50°	1240	1183	1154
55°	1189	1127	1101
60°	1132	1062	1041
65°	1069	995	969
70°	990	912	893
75°	879	813	822
80°	747	688	687
85°	540	471	462

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 1643 cd/sqm



TEST NUMBER: P903940

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	1.8
10°-20°	582.7	5.1
20°-30°	856.4	7.5
30°-40°	994.6	8.7
40°-50°	993.4	8.7
50°-60°	866.2	7.6
60°-70°	640.3	5.6
70°-80°	362.3	3.2
80°-90°	101.5	0.9
90°-100°	129.1	1.1
100°-110°	410.3	3.6
110°-120°	702.1	6.1
120°-130°	923.3	8.1
130°-140°	1036.4	9.1
140°-150°	1016.3	8.9
150°-160°	852.6	7.5
160°-170°	565.4	4.9
170°-180°	197.6	1.7
0°-30°	1646.2	14.4
0°-40°	2640.9	23.1
0°-60°	4500.5	39.3
0°-90°	5604.6	49.0
90°-120°	1241.5	10.9
90°-150°	4217.6	36.9
90°-180°	5833.0	51.0
0°-180°	11437.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	2	23	62	58	60	11
95°	92	109	113	113	109	102
105°	379	384	388	391	391	400
115°	705	715	712	710	705	697
125°	1025	1040	1036	1030	1028	916
135°	1326	1345	1349	1347	1342	1025
145°	1609	1622	1632	1634	1627	1005
155°	1840	1845	1851	1860	1854	847
165°	2002	2000	2000	2012	2004	565
175°	2083	2078	2074	2087	2076	198
180°	2087	2087	2087	2087	2087	



TEST NUMBER: P903940

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.9	22.6	61.6	57.9	59.8
92.5°	39.0	52.9	54.8	56.6	56.6
95°	91.8	109.4	112.6	112.6	109.4
97.5°	152.9	169.2	176.2	176.2	176.2
100°	223.3	237.8	242.8	242.8	240.9
102.5°	297.6	308.2	315.2	317.1	315.2
105°	378.7	383.7	387.5	390.7	390.7
107.5°	459.2	466.7	466.7	468.1	459.2
110°	537.2	547.3	547.3	547.3	542.2



TEST NUMBER: P903940

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	621.5	632.3	630.4	625.3	621.5
115°	704.6	714.6	711.5	709.6	704.6
117.5°	786.9	800.8	792.0	786.9	781.9
120°	870.0	883.8	870.0	870.0	864.3
122.5°	945.5	963.1	954.3	949.2	945.5
125°	1024.7	1040.5	1035.5	1029.8	1027.9
127.5°	1102.1	1121.6	1114.7	1107.2	1102.1
130°	1174.5	1197.1	1194.0	1190.2	1183.3
132.5°	1255.7	1273.3	1274.5	1265.7	1260.7
135°	1325.5	1344.9	1348.8	1346.8	1341.8
137.5°	1403.4	1419.2	1422.3	1421.1	1413.5
140°	1472.1	1487.8	1496.6	1496.6	1489.7
142.5°	1542.5	1558.2	1563.2	1565.1	1558.2
145°	1609.2	1621.7	1631.8	1633.7	1626.8
147.5°	1669.0	1684.7	1692.2	1695.4	1688.5
150°	1730.6	1741.3	1748.2	1753.9	1748.2
152.5°	1785.3	1796.0	1804.8	1811.8	1804.8
155°	1840.0	1845.0	1850.8	1859.5	1853.9
157.5°	1887.3	1891.0	1894.1	1906.8	1897.9
160°	1929.4	1933.2	1935.0	1945.7	1938.1
162.5°	1968.4	1968.4	1970.3	1982.2	1973.4
165°	2001.7	1999.8	1999.8	2012.4	2003.6
167.5°	2031.9	2026.3	2026.3	2038.8	2030.0
170°	2054.6	2049.6	2047.7	2060.2	2049.6
172.5°	2070.3	2065.2	2063.3	2075.9	2065.2
175°	2082.8	2077.8	2074.1	2086.6	2075.9
177.5°	2089.8	2084.7	2080.9	2091.7	2080.9
180°	2086.6	2086.6	2086.6	2086.6	2086.6



TEST NUMBER: P903940
 CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.70	9.55	9.66	10.53	11.82	8.25	9.11	9.22	10.09	11.37
	3H	10.36	11.13	11.34	12.12	13.42	9.87	10.64	10.85	11.63	12.93
	4H	10.95	11.68	11.94	12.67	13.99	10.46	11.18	11.45	12.18	13.49
	6H	11.36	12.02	12.36	13.02	14.35	10.86	11.52	11.86	12.52	13.85
	8H	11.46	12.10	12.47	13.11	14.44	10.96	11.60	11.97	12.61	13.94
	12H	11.51	12.12	12.52	13.12	14.47	11.00	11.61	12.01	12.61	13.96
4H	2H	9.16	9.88	10.16	10.88	12.19	8.80	9.53	9.80	10.52	11.84
	3H	11.03	11.63	12.03	12.66	13.98	10.62	11.23	11.63	12.25	13.58
	4H	11.75	12.30	12.76	13.31	14.67	11.32	11.88	12.34	12.89	14.24
	6H	12.27	12.74	13.29	13.78	15.13	11.83	12.31	12.86	13.35	14.70
	8H	12.42	12.86	13.44	13.89	15.26	11.98	12.42	13.01	13.46	14.82
	12H	12.49	12.89	13.54	13.94	15.31	12.04	12.44	13.09	13.49	14.86
8H	4H	11.94	12.39	12.97	13.42	14.78	11.57	12.01	12.59	13.04	14.41
	6H	12.58	12.95	13.63	14.02	15.38	12.20	12.56	13.24	13.64	15.00
	8H	12.80	13.13	13.86	14.18	15.56	12.41	12.73	13.47	13.79	15.17
	12H	12.94	13.22	14.00	14.27	15.70	12.53	12.81	13.59	13.86	15.29
12H	4H	11.93	12.33	12.97	13.38	14.75	11.56	11.96	12.60	13.01	14.38
	6H	12.61	12.93	13.67	13.99	15.37	12.24	12.56	13.29	13.62	15.00
	8H	12.85	13.14	13.91	14.19	15.61	12.47	12.76	13.53	13.81	15.23