

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903953

Luminaire Tested: DFN2DIP-SQ4F0-060D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903953
REPORT IS A COMBINATION OF REPORTS P901651 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D100US830-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14929.9 lumens
Efficiency: N/A
Efficacy: 119.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 124.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLLONL

Luminous Intensity Polar Plot

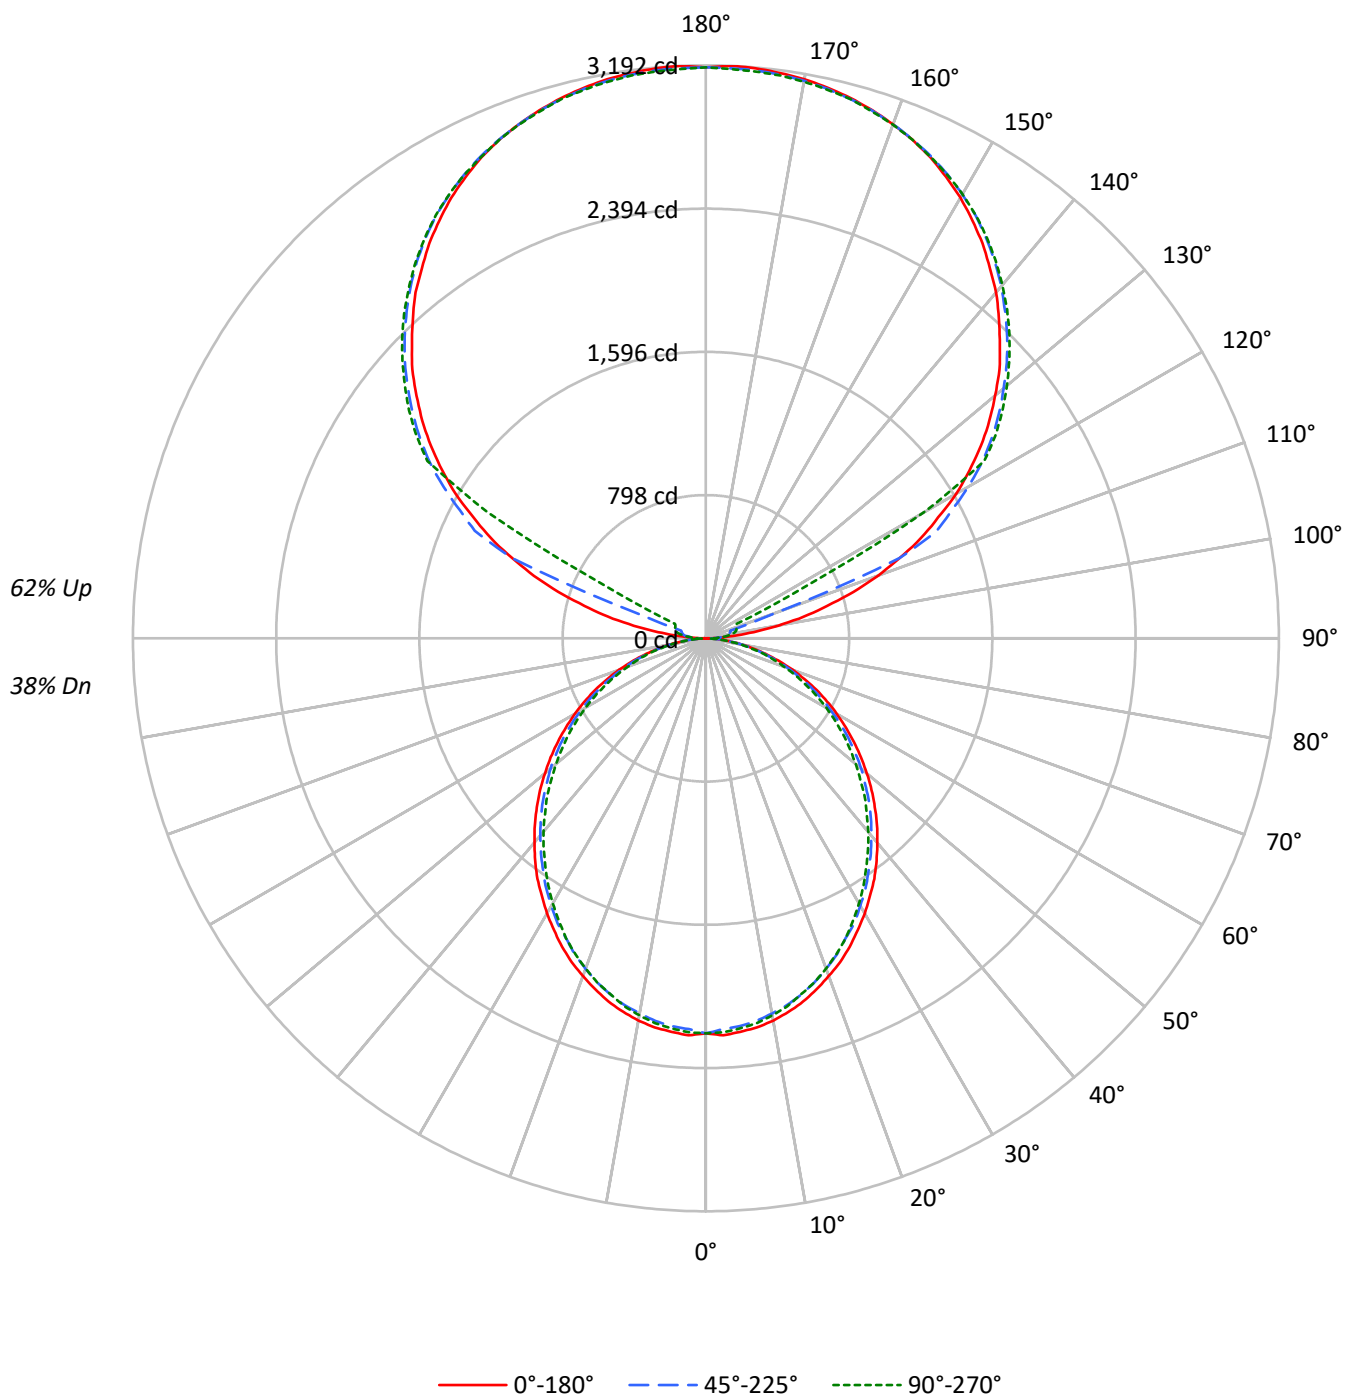

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	60	60	60	45	45	45
1	95	91	87	83	86	82	79	76	67	65	63	53	51	50	39	39	38
2	86	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	36	33	30	27	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	29	26	23	22	20	18
7	56	44	36	31	51	40	34	29	33	28	24	27	23	20	20	18	16
8	52	40	32	27	47	37	30	25	30	25	22	24	21	18	19	16	14
9	48	36	29	24	44	33	27	23	28	23	19	22	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1544	1544	1544
5°	1546	1523	1533
10°	1534	1503	1513
15°	1511	1478	1481
20°	1481	1444	1448
25°	1450	1403	1410
30°	1413	1365	1362
35°	1377	1321	1311
40°	1332	1275	1262
45°	1288	1230	1212
50°	1240	1183	1154
55°	1189	1127	1101
60°	1132	1062	1041
65°	1069	995	969
70°	990	912	893
75°	879	813	822
80°	747	688	687
85°	540	471	462

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1704 cd/sqm

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	1.4
10°-20°	582.7	3.9
20°-30°	856.4	5.7
30°-40°	994.6	6.7
40°-50°	993.4	6.7
50°-60°	866.2	5.8
60°-70°	640.3	4.3
70°-80°	362.3	2.4
80°-90°	101.2	0.7
90°-100°	104.9	0.7
100°-110°	391.0	2.6
110°-120°	1037.0	6.9
120°-130°	1720.0	11.5
130°-140°	1827.0	12.2
140°-150°	1698.0	11.4
150°-160°	1365.2	9.1
160°-170°	879.7	5.9
170°-180°	302.8	2.0
0°-30°	1646.2	11.0
0°-40°	2640.9	17.7
0°-60°	4500.5	30.1
0°-90°	5604.3	37.5
90°-120°	1532.9	10.3
90°-150°	6778.0	45.4
90°-180°	9326.0	62.5
0°-180°	14929.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	2	28	46	58	62	14
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P903953

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.52	8.28	8.58	9.34	10.78	7.07	7.83	8.13	8.89	10.33
	3H	9.18	9.86	10.24	10.93	12.38	8.69	9.37	9.75	10.44	11.89
	4H	9.76	10.41	10.84	11.48	12.94	9.27	9.91	10.34	10.98	12.45
	6H	10.16	10.75	11.25	11.83	13.30	9.66	10.25	10.75	11.33	12.80
	8H	10.26	10.83	11.35	11.92	13.39	9.76	10.33	10.85	11.42	12.89
	12H	10.31	10.85	11.41	11.93	13.42	9.80	10.34	10.90	11.42	12.92
4H	2H	7.97	8.61	9.05	9.68	11.15	7.61	8.26	8.70	9.33	10.79
	3H	9.83	10.37	10.92	11.47	12.94	9.42	9.96	10.51	11.06	12.53
	4H	10.54	11.04	11.64	12.13	13.62	10.12	10.61	11.22	11.70	13.20
	6H	11.06	11.48	12.16	12.59	14.08	10.62	11.05	11.73	12.16	13.65
	8H	11.21	11.60	12.31	12.71	14.21	10.77	11.16	11.87	12.27	13.77
	12H	11.28	11.63	12.40	12.75	14.26	10.83	11.19	11.95	12.30	13.81
8H	4H	10.73	11.13	11.84	12.23	13.74	10.35	10.75	11.46	11.85	13.36
	6H	11.36	11.69	12.49	12.84	14.34	10.98	11.31	12.11	12.45	13.96
	8H	11.59	11.87	12.72	13.00	14.52	11.19	11.48	12.33	12.61	14.13
	12H	11.71	11.97	12.85	13.09	14.65	11.30	11.56	12.44	12.68	14.24
12H	4H	10.71	11.07	11.83	12.19	13.70	10.34	10.70	11.47	11.82	13.33
	6H	11.39	11.68	12.53	12.81	14.33	11.02	11.31	12.15	12.43	13.96
	8H	11.63	11.88	12.77	13.01	14.57	11.25	11.50	12.39	12.63	14.19