

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P903957

Luminaire Tested: DFN2DIP-SQ4F0-060D110US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P903957
REPORT IS A COMBINATION OF REPORTS P901669 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D110US830-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15863.0 lumens
Efficiency: N/A
Efficacy: 119.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 132.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLLONL

Luminous Intensity Polar Plot

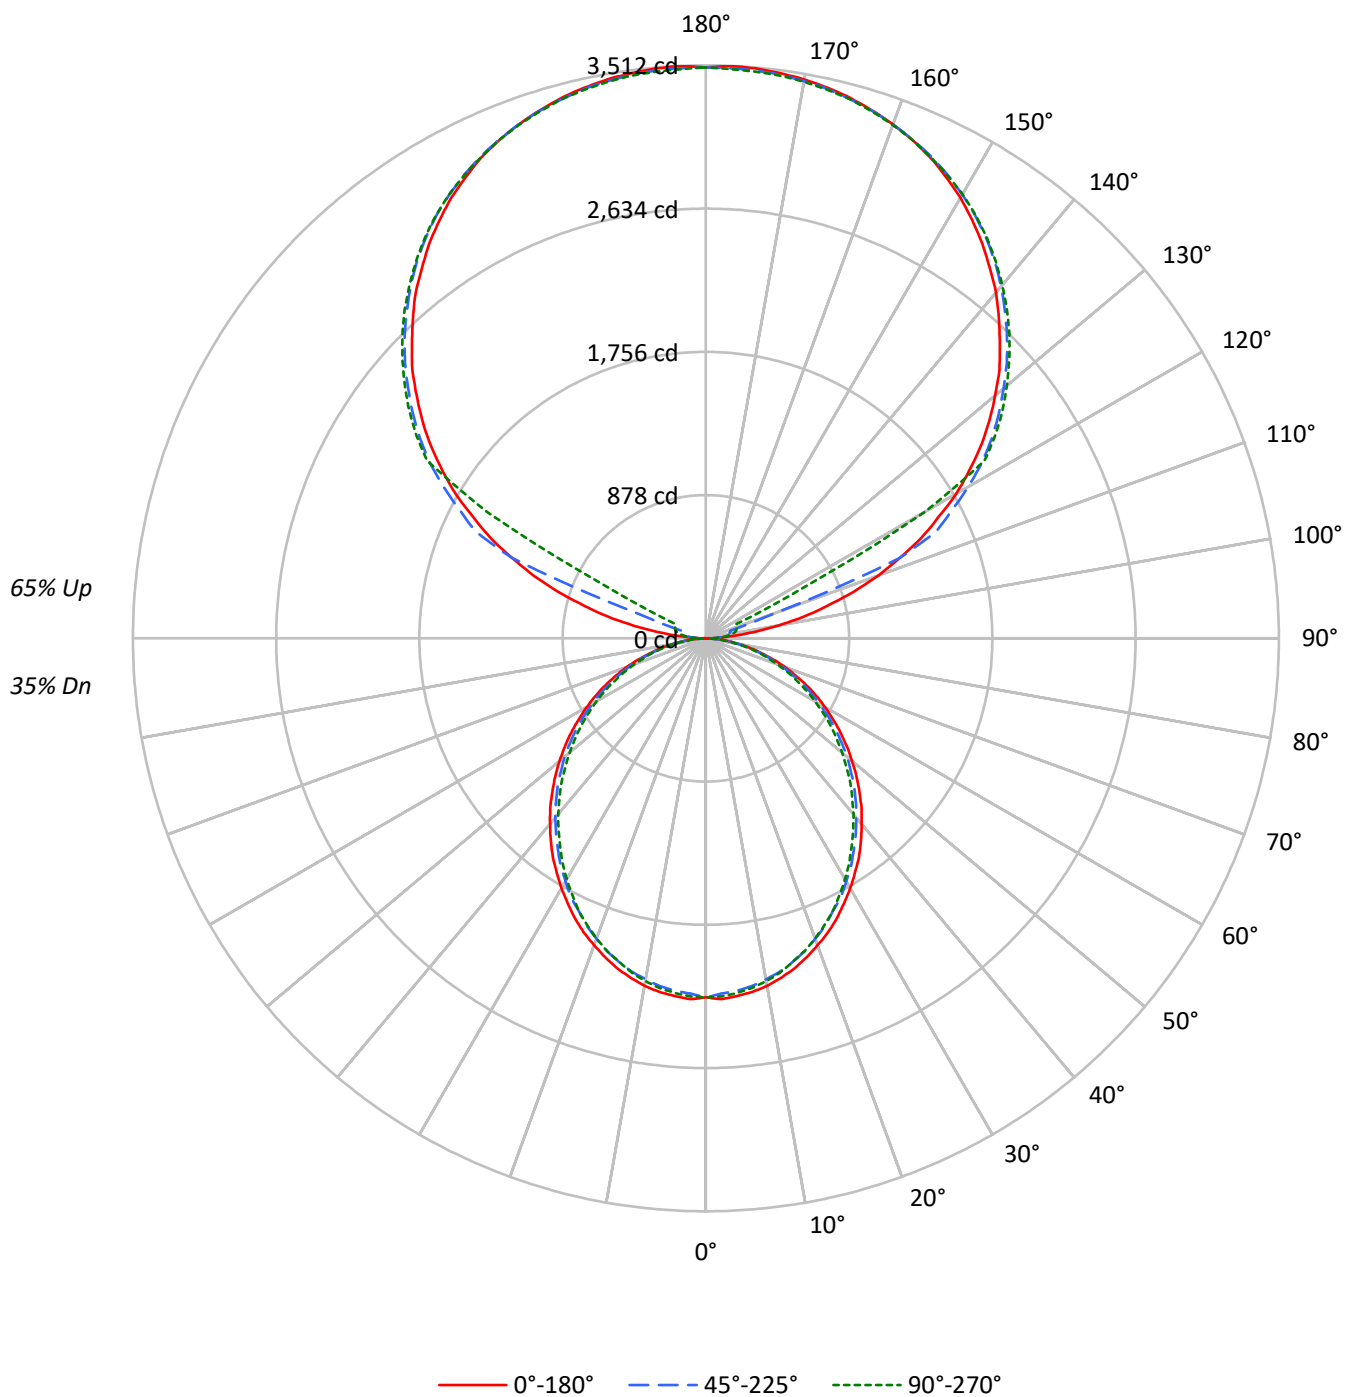

TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	90	86	83	85	82	79	76	66	64	62	51	50	48	38	37	36
2	86	79	73	68	78	71	66	62	58	54	51	45	43	40	33	32	30
3	78	69	62	56	71	63	57	52	51	46	43	40	37	34	29	27	26
4	72	61	53	48	65	56	49	44	45	40	36	35	32	29	26	24	22
5	66	54	46	41	59	50	43	38	40	35	31	32	28	25	24	21	19
6	60	49	41	35	54	44	37	32	36	31	27	29	25	22	21	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	19	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	15	13
9	48	36	29	24	43	33	27	22	27	22	19	22	18	15	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	16	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1544	1544	1544
5°	1546	1523	1533
10°	1534	1503	1513
15°	1511	1478	1481
20°	1481	1444	1448
25°	1450	1403	1410
30°	1413	1365	1362
35°	1377	1321	1311
40°	1332	1275	1262
45°	1288	1230	1212
50°	1240	1183	1154
55°	1189	1127	1101
60°	1132	1062	1041
65°	1069	995	969
70°	990	912	893
75°	879	813	822
80°	747	688	687
85°	540	471	462

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1874 cd/sqm

TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	1.3
10°-20°	582.7	3.7
20°-30°	856.4	5.4
30°-40°	994.6	6.3
40°-50°	993.4	6.3
50°-60°	866.2	5.5
60°-70°	640.3	4.0
70°-80°	362.3	2.3
80°-90°	101.8	0.6
90°-100°	115.4	0.7
100°-110°	430.1	2.7
110°-120°	1140.7	7.2
120°-130°	1892.0	11.9
130°-140°	2009.7	12.7
140°-150°	1867.8	11.8
150°-160°	1501.7	9.5
160°-170°	967.6	6.1
170°-180°	333.0	2.1
0°-30°	1646.2	10.4
0°-40°	2640.9	16.6
0°-60°	4500.5	28.4
0°-90°	5604.9	35.3
90°-120°	1686.2	10.6
90°-150°	7455.8	47.0
90°-180°	10258.0	64.7
0°-180°	15863.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	2	30	50	63	68	15
95°	164	81	99	112	109	195
105°	770	846	155	182	192	822
115°	1456	1499	1562	390	208	1433
125°	2058	2091	2140	2157	2165	1836
135°	2547	2588	2610	2636	2631	1968
145°	2955	2952	2995	3013	3000	1848
155°	3254	3231	3261	3276	3256	1499
165°	3428	3413	3421	3438	3421	969
175°	3506	3489	3494	3512	3486	334
180°	3499	3499	3499	3499	3499	

TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	2.5	30.3	50.5	63.4	68.2
92.5°	63.4	53.3	60.7	65.9	68.2
95°	164.5	80.9	98.6	111.5	108.9
97.5°	296.1	88.7	128.9	136.8	139.2
100°	448.3	101.3	144.3	164.5	169.6
102.5°	615.1	610.3	149.4	177.1	184.9
105°	769.7	845.7	154.6	182.2	192.5
107.5°	949.5	1012.6	159.7	187.3	197.6
110°	1121.7	1174.7	443.2	190.0	199.9

TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1283.8	1329.2	1286.2	194.8	202.6
115°	1455.8	1498.7	1562.3	389.9	207.7
117.5°	1605.2	1655.8	1699.0	1336.7	673.4
120°	1772.4	1810.2	1856.0	1886.3	1544.4
122.5°	1914.0	1954.5	2005.4	2020.4	2023.2
125°	2058.3	2091.4	2139.5	2157.2	2164.7
127.5°	2190.0	2225.4	2263.6	2288.9	2291.3
130°	2314.1	2354.8	2382.4	2410.4	2408.0
132.5°	2440.7	2473.8	2501.5	2524.3	2522.0
135°	2547.2	2587.7	2610.3	2635.9	2630.7
137.5°	2658.4	2688.8	2714.3	2739.6	2732.1
140°	2767.3	2787.7	2815.4	2838.2	2825.6
142.5°	2858.6	2876.4	2909.2	2929.3	2916.7
145°	2954.9	2952.1	2995.1	3012.9	3000.3
147.5°	3038.2	3030.7	3073.6	3086.3	3076.4
150°	3119.3	3101.6	3142.2	3157.2	3144.6
152.5°	3187.6	3167.4	3205.3	3220.7	3202.9
155°	3253.5	3230.8	3261.2	3276.3	3256.1
157.5°	3306.6	3286.5	3309.4	3327.1	3306.6
160°	3352.3	3337.0	3352.3	3367.3	3349.6
162.5°	3392.6	3377.6	3390.2	3408.0	3385.1
165°	3428.1	3413.0	3420.6	3438.3	3420.6
167.5°	3456.0	3440.8	3448.6	3466.3	3443.5
170°	3478.9	3463.6	3468.6	3486.5	3463.6
172.5°	3493.9	3478.9	3484.0	3501.7	3478.9
175°	3506.5	3488.8	3493.9	3511.7	3486.5
177.5°	3511.7	3493.9	3496.6	3514.4	3491.6
180°	3499.1	3499.1	3499.1	3499.1	3499.1



TEST NUMBER: P903957

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.26	8.00	8.33	9.08	10.55	6.82	7.56	7.89	8.63	10.10
	3H	8.92	9.58	10.00	10.67	12.15	8.43	9.09	9.51	10.18	11.66
	4H	9.50	10.13	10.59	11.22	12.71	9.01	9.64	10.10	10.72	12.21
	6H	9.90	10.48	11.00	11.57	13.07	9.40	9.98	10.50	11.07	12.57
	8H	10.00	10.56	11.11	11.66	13.16	9.50	10.05	10.61	11.16	12.65
	12H	10.05	10.57	11.16	11.67	13.19	9.54	10.06	10.65	11.16	12.68
4H	2H	7.71	8.34	8.81	9.42	10.92	7.35	7.99	8.45	9.07	10.56
	3H	9.57	10.09	10.68	11.21	12.71	9.16	9.69	10.27	10.80	12.30
	4H	10.28	10.76	11.39	11.87	13.39	9.86	10.34	10.97	11.44	12.97
	6H	10.79	11.21	11.91	12.33	13.85	10.36	10.78	11.48	11.90	13.42
	8H	10.94	11.33	12.06	12.45	13.98	10.51	10.89	11.62	12.01	13.54
	12H	11.01	11.36	12.15	12.49	14.03	10.56	10.91	11.70	12.04	13.58
8H	4H	10.47	10.86	11.59	11.97	13.50	10.09	10.48	11.21	11.60	13.13
	6H	11.10	11.42	12.24	12.58	14.11	10.72	11.04	11.86	12.19	13.72
	8H	11.32	11.60	12.47	12.74	14.29	10.93	11.21	12.08	12.35	13.90
	12H	11.45	11.70	12.60	12.83	14.42	11.04	11.29	12.19	12.42	14.01
12H	4H	10.45	10.80	11.58	11.93	13.47	10.08	10.43	11.22	11.56	13.10
	6H	11.13	11.41	12.27	12.55	14.10	10.76	11.04	11.90	12.18	13.72
	8H	11.37	11.61	12.52	12.75	14.33	10.99	11.23	12.14	12.37	13.95

END OF REPORT