

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904063

Luminaire Tested: DFN2DIP-SQ4F0-090D100US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904063
REPORT IS A COMBINATION OF REPORTS P901658 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D100US830-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16541.6 lumens
Efficiency: N/A
Efficacy: 105.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 157.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLLONL

Luminous Intensity Polar Plot

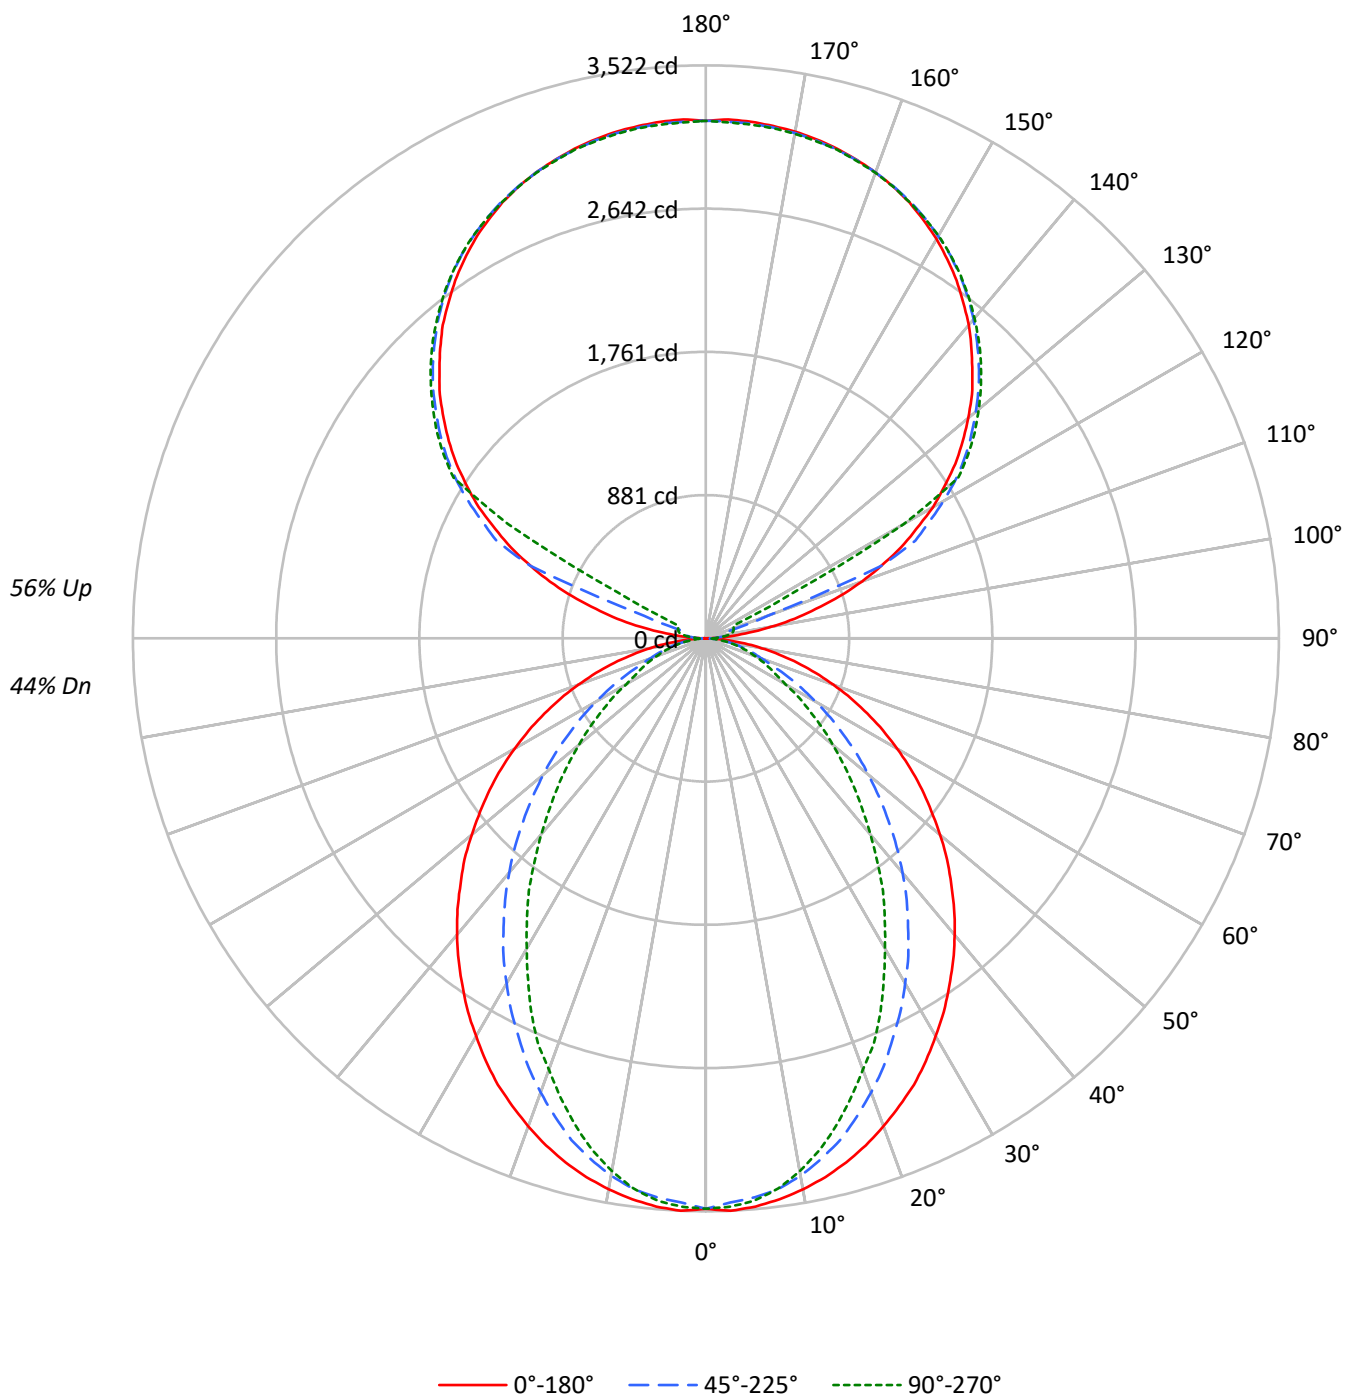

TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	71	68	66	57	56	54	45	44	43
2	88	81	76	71	81	75	70	65	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	41	41	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	37	33	30	29	27	25
6	63	51	43	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	25	22	20
8	54	42	35	30	50	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2460	2460	2460
5°	2464	2422	2437
10°	2440	2374	2359
15°	2406	2296	2237
20°	2361	2189	2087
25°	2316	2068	1942
30°	2255	1944	1758
35°	2195	1811	1597
40°	2134	1673	1411
45°	2063	1519	1243
50°	1990	1365	1079
55°	1913	1199	921
60°	1825	1027	759
65°	1723	851	684
70°	1600	687	620
75°	1445	606	566
80°	1220	510	493
85°	849	343	375

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2063 cd/sqm

TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.6	2.0
10°-20°	902.0	5.5
20°-30°	1266.4	7.7
30°-40°	1380.5	8.3
40°-50°	1268.8	7.7
50°-60°	996.5	6.0
60°-70°	648.6	3.9
70°-80°	333.9	2.0
80°-90°	90.8	0.5
90°-100°	104.9	0.6
100°-110°	391.0	2.4
110°-120°	1037.0	6.3
120°-130°	1720.0	10.4
130°-140°	1827.0	11.0
140°-150°	1698.0	10.3
150°-160°	1365.2	8.3
160°-170°	879.7	5.3
170°-180°	302.8	1.8
0°-30°	2497.0	15.1
0°-40°	3877.5	23.4
0°-60°	6142.8	37.1
0°-90°	7216.1	43.6
90°-120°	1532.9	9.3
90°-150°	6778.0	41.0
90°-180°	9326.0	56.4
0°-180°	16541.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3506	3506	3506	3506	3506	
5°	3506	3490	3449	3477	3468	332
15°	3335	3300	3192	3132	3100	940
25°	3027	2925	2716	2586	2538	1392
35°	2608	2446	2167	1967	1897	1632
45°	2132	1920	1586	1361	1285	1647
55°	1621	1374	1031	841	781	1449
65°	1095	838	552	444	435	1085
75°	584	362	254	232	229	617
85°	136	70	60	60	60	156
90°	2	28	46	58	62	15
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3506.0	3506.0	3506.0	3506.0	3506.0
2.5°	3521.8	3506.0	3470.9	3503.0	3496.5
5°	3506.0	3490.1	3448.8	3477.3	3467.9
7.5°	3477.3	3458.5	3414.1	3426.5	3410.7
10°	3439.3	3417.1	3353.8	3344.0	3325.2
12.5°	3391.8	3363.3	3277.4	3258.6	3223.5
15°	3334.6	3299.7	3191.9	3131.6	3100.0
17.5°	3268.0	3217.2	3083.8	3014.2	2963.4
20°	3191.9	3128.3	2969.7	2890.6	2820.6
22.5°	3109.4	3036.4	2852.2	2744.5	2697.1
25°	3027.0	2925.3	2715.9	2586.0	2538.2
27.5°	2928.7	2820.6	2589.0	2439.9	2366.8
30°	2824.0	2703.1	2449.3	2287.7	2201.9
32.5°	2722.3	2576.2	2316.3	2125.8	2046.4
35°	2608.2	2446.3	2167.2	1967.3	1897.2
37.5°	2497.1	2322.4	2027.5	1808.4	1729.3
40°	2379.6	2189.4	1881.4	1656.2	1573.8
42.5°	2259.1	2056.2	1735.6	1500.7	1421.5
45°	2132.2	1919.5	1586.5	1360.9	1284.9
47.5°	2011.7	1786.5	1443.8	1218.2	1148.6
50°	1878.4	1653.1	1304.1	1085.0	1018.6
52.5°	1748.1	1510.1	1170.8	961.4	901.2
55°	1621.2	1373.8	1031.0	840.9	780.6
57.5°	1491.3	1237.5	907.6	729.8	679.0
60°	1357.9	1104.1	777.3	615.7	564.9
62.5°	1228.0	974.2	666.2	514.1	488.8
65°	1094.7	837.5	552.0	444.3	434.6
67.5°	967.8	710.6	444.3	390.1	380.7
70°	834.5	587.1	368.0	336.3	323.5
72.5°	707.6	472.6	307.6	282.4	276.1
75°	583.7	361.6	253.8	231.6	228.6
77.5°	460.1	256.8	199.9	187.2	180.8
80°	345.7	184.2	152.1	139.7	139.7
82.5°	241.0	123.9	104.7	98.3	98.3
85°	136.3	69.7	60.2	60.2	60.2
87.5°	50.8	25.3	25.3	22.2	22.2
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7



TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904063

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.66	10.44	10.68	11.46	12.83	5.62	6.40	6.64	7.42	8.79
	3H	11.34	12.04	12.37	13.07	14.45	6.81	7.51	7.83	8.54	9.92
	4H	11.95	12.61	12.99	13.64	15.03	7.26	7.92	8.29	8.95	10.34
	6H	12.37	12.98	13.42	14.02	15.42	7.58	8.18	8.62	9.22	10.62
	8H	12.50	13.08	13.55	14.13	15.53	7.66	8.24	8.72	9.30	10.69
	12H	12.56	13.11	13.62	14.16	15.58	7.71	8.26	8.77	9.30	10.72
4H	2H	9.67	10.33	10.72	11.37	12.76	6.21	6.87	7.26	7.91	9.30
	3H	11.50	12.05	12.56	13.11	14.52	7.56	8.11	8.61	9.17	10.57
	4H	12.20	12.70	13.26	13.75	15.18	8.11	8.61	9.17	9.66	11.09
	6H	12.71	13.14	13.78	14.22	15.64	8.52	8.96	9.59	10.03	11.45
	8H	12.89	13.29	13.96	14.36	15.80	8.65	9.06	9.72	10.12	11.56
	12H	12.99	13.35	14.07	14.43	15.87	8.72	9.08	9.80	10.16	11.60
8H	4H	12.16	12.56	13.23	13.63	15.07	8.39	8.79	9.46	9.86	11.29
	6H	12.73	13.06	13.82	14.17	15.60	8.90	9.24	10.00	10.35	11.78
	8H	12.95	13.24	14.05	14.33	15.79	9.10	9.39	10.19	10.48	11.93
	12H	13.09	13.35	14.19	14.43	15.92	9.21	9.47	10.32	10.56	12.05
12H	4H	12.11	12.47	13.20	13.56	15.00	8.39	8.75	9.48	9.83	11.27
	6H	12.71	13.00	13.80	14.09	15.54	8.95	9.25	10.05	10.34	11.79
	8H	12.93	13.18	14.03	14.27	15.76	9.16	9.42	10.27	10.51	12.00

END OF REPORT