

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904083

Luminaire Tested: DFN2DIP-SQ4F0-100D060US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904083
REPORT IS A COMBINATION OF REPORTS P901588 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D060US830-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13610.3 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 137.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLLONL

Luminous Intensity Polar Plot

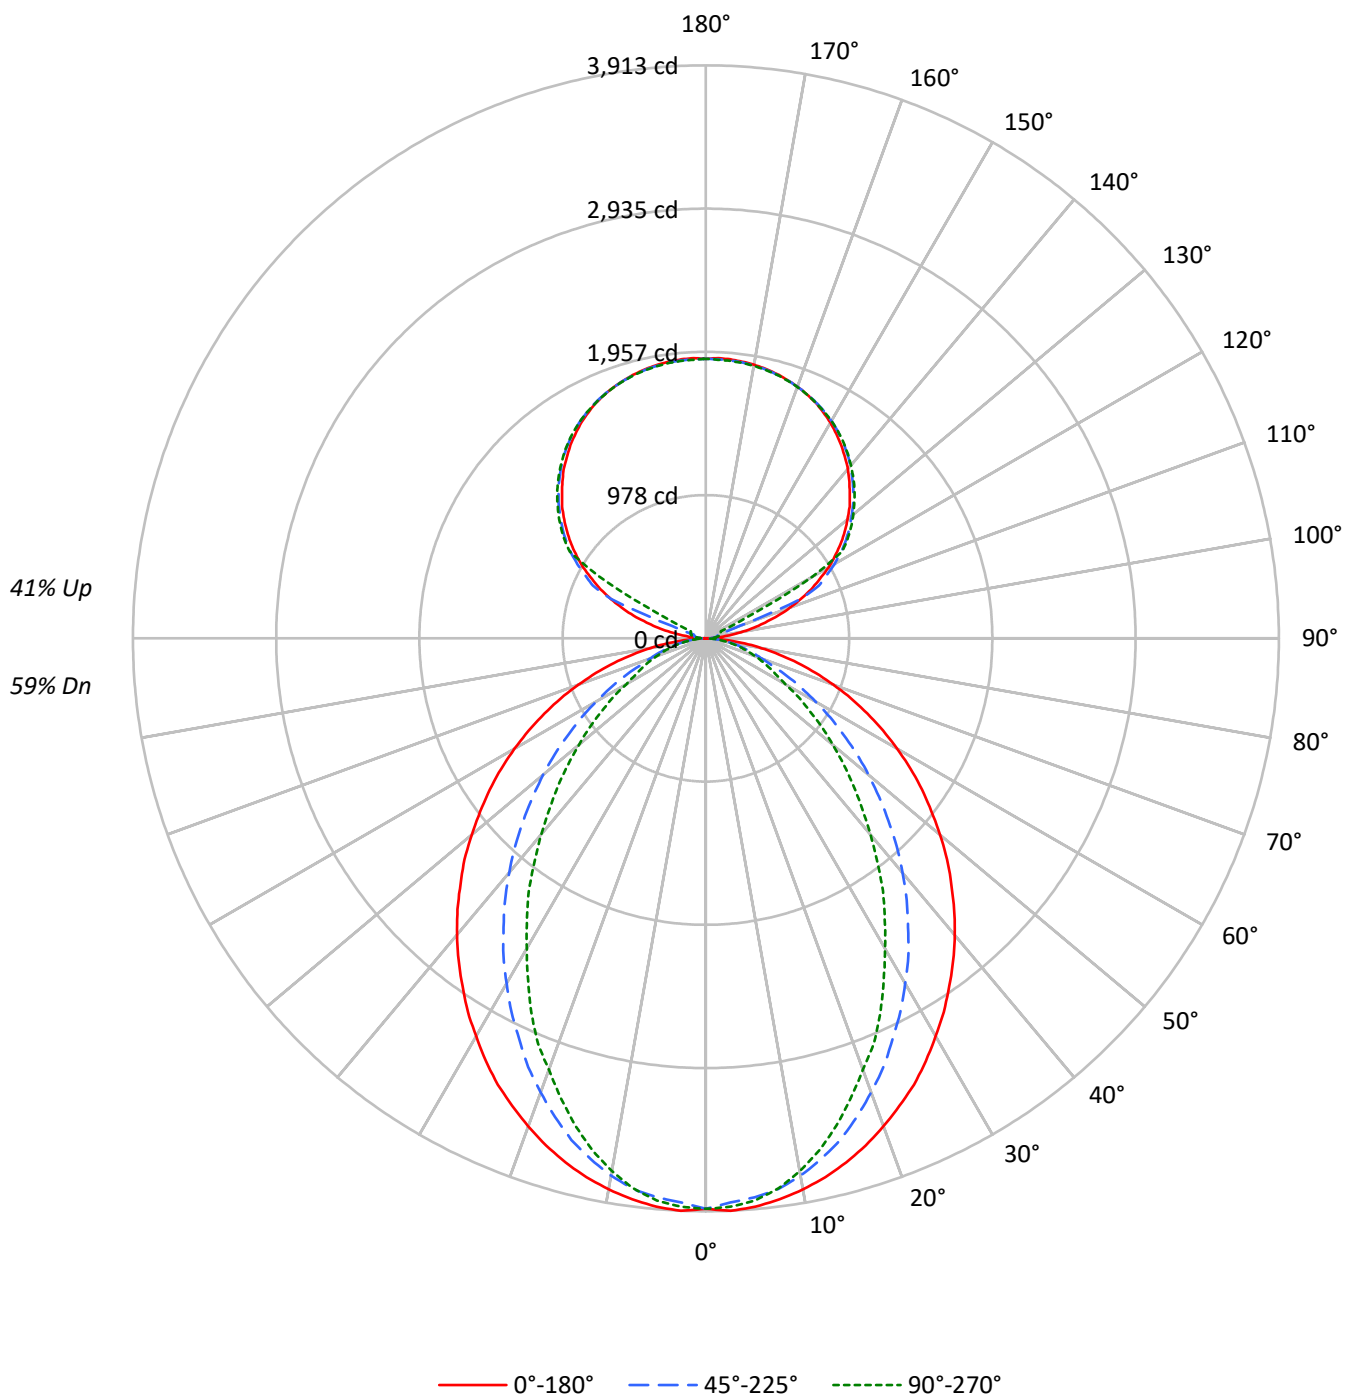

TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	55
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	51	49	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	43	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	38	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	23	21
10	50	38	31	26	46	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2733	2733	2733
5°	2738	2691	2708
10°	2711	2638	2621
15°	2673	2552	2485
20°	2624	2432	2319
25°	2573	2298	2158
30°	2505	2160	1954
35°	2439	2012	1774
40°	2371	1859	1568
45°	2292	1688	1381
50°	2211	1516	1199
55°	2126	1333	1024
60°	2028	1141	843
65°	1915	945	760
70°	1778	763	689
75°	1605	674	628
80°	1356	567	548
85°	944	381	417

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2292 cd/sqm

TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.1	2.7
10°-20°	1002.2	7.4
20°-30°	1407.1	10.3
30°-40°	1533.9	11.3
40°-50°	1409.8	10.4
50°-60°	1107.2	8.1
60°-70°	720.7	5.3
70°-80°	371.0	2.7
80°-90°	98.1	0.7
90°-100°	62.9	0.5
100°-110°	234.6	1.7
110°-120°	622.2	4.6
120°-130°	1032.0	7.6
130°-140°	1096.2	8.1
140°-150°	1018.8	7.5
150°-160°	819.1	6.0
160°-170°	527.8	3.9
170°-180°	181.7	1.3
0°-30°	2774.5	20.4
0°-40°	4308.3	31.7
0°-60°	6825.3	50.1
0°-90°	8014.9	58.9
90°-120°	919.8	6.8
90°-150°	4066.8	29.9
90°-180°	5595.0	41.1
0°-180°	13610.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3896	3896	3896	3896	3896	
5°	3896	3878	3832	3864	3853	369
15°	3705	3666	3546	3480	3444	1044
25°	3363	3250	3018	2873	2820	1547
35°	2898	2718	2408	2186	2108	1814
45°	2369	2133	1763	1512	1428	1830
55°	1801	1526	1146	934	867	1610
65°	1216	931	613	494	483	1206
75°	649	402	282	257	254	686
85°	152	77	67	67	67	174
90°	1	17	28	35	37	13
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3895.5	3895.5	3895.5	3895.5	3895.5
2.5°	3913.1	3895.5	3856.6	3892.1	3885.1
5°	3895.5	3877.9	3831.9	3863.8	3853.2
7.5°	3863.8	3842.7	3793.4	3807.2	3789.7
10°	3821.4	3796.7	3726.4	3715.6	3694.7
12.5°	3768.8	3736.9	3641.5	3620.6	3581.7
15°	3705.1	3666.2	3546.5	3479.6	3444.4
17.5°	3631.0	3574.6	3426.5	3349.0	3292.6
20°	3546.5	3475.8	3299.7	3211.8	3134.0
22.5°	3454.9	3373.7	3169.1	3049.5	2996.7
25°	3363.3	3250.4	3017.6	2873.2	2820.2
27.5°	3254.0	3134.0	2876.6	2710.9	2629.8
30°	3137.7	3003.4	2721.4	2541.9	2446.6
32.5°	3024.8	2862.4	2573.7	2362.0	2273.7
35°	2897.9	2718.1	2408.0	2185.8	2108.0
37.5°	2774.6	2580.4	2252.8	2009.3	1921.4
40°	2644.0	2432.7	2090.5	1840.2	1748.6
42.5°	2510.1	2284.5	1928.5	1667.5	1579.5
45°	2369.1	2132.7	1762.8	1512.2	1427.7
47.5°	2235.2	1985.0	1604.2	1353.6	1276.2
50°	2087.1	1836.8	1449.0	1205.5	1131.8
52.5°	1942.3	1677.9	1300.9	1068.2	1001.3
55°	1801.3	1526.4	1145.7	934.3	867.3
57.5°	1657.0	1374.9	1008.4	810.9	754.4
60°	1508.8	1226.8	863.7	684.1	627.6
62.5°	1364.4	1082.4	740.2	571.2	543.1
65°	1216.4	930.6	613.4	493.7	482.9
67.5°	1075.3	789.6	493.7	433.5	423.0
70°	927.2	652.3	408.8	373.6	359.5
72.5°	786.2	525.1	341.9	313.8	306.7
75°	648.6	401.7	282.0	257.3	253.9
77.5°	511.3	285.4	222.2	207.9	200.9
80°	384.1	204.6	169.1	155.2	155.2
82.5°	267.8	137.6	116.3	109.2	109.2
85°	151.5	77.4	66.9	66.9	66.9
87.5°	56.5	28.1	28.1	24.7	24.7
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1



TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P904083

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.44	12.35	12.33	13.25	14.39	7.41	8.31	8.29	9.21	10.35
	3H	13.13	13.95	14.03	14.85	16.02	8.60	9.41	9.50	10.32	11.49
	4H	13.75	14.51	14.66	15.43	16.61	9.06	9.82	9.97	10.74	11.91
	6H	14.18	14.88	15.10	15.80	16.99	9.38	10.09	10.30	11.01	12.20
	8H	14.31	14.98	15.24	15.92	17.11	9.47	10.15	10.40	11.08	12.27
	12H	14.37	15.01	15.31	15.95	17.16	9.52	10.16	10.46	11.09	12.30
4H	2H	11.47	12.24	12.39	13.15	14.33	8.01	8.78	8.93	9.69	10.87
	3H	13.31	13.95	14.24	14.90	16.09	9.37	10.01	10.30	10.95	12.15
	4H	14.01	14.59	14.95	15.53	16.75	9.92	10.50	10.86	11.44	12.66
	6H	14.54	15.04	15.49	16.00	17.22	10.35	10.85	11.30	11.81	13.03
	8H	14.72	15.18	15.67	16.14	17.37	10.48	10.94	11.43	11.90	13.13
	12H	14.82	15.24	15.79	16.21	17.45	10.55	10.97	11.52	11.94	13.18
8H	4H	13.99	14.45	14.94	15.41	16.64	10.21	10.68	11.16	11.64	12.87
	6H	14.56	14.94	15.54	15.95	17.17	10.73	11.12	11.71	12.12	13.35
	8H	14.78	15.12	15.77	16.11	17.36	10.93	11.27	11.91	12.26	13.50
	12H	14.92	15.22	15.92	16.21	17.50	11.05	11.35	12.04	12.33	13.63
12H	4H	13.94	14.36	14.91	15.34	16.57	10.22	10.64	11.19	11.62	12.85
	6H	14.54	14.88	15.52	15.87	17.11	10.78	11.12	11.77	12.11	13.36
	8H	14.76	15.06	15.75	16.04	17.34	11.00	11.30	11.99	12.28	13.58

END OF REPORT