

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904097

Luminaire Tested: DFN2DIP-SQ4F0-100D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904097
REPORT IS A COMBINATION OF REPORTS P901659 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D100US830-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18662.4 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLLONL

Luminous Intensity Polar Plot

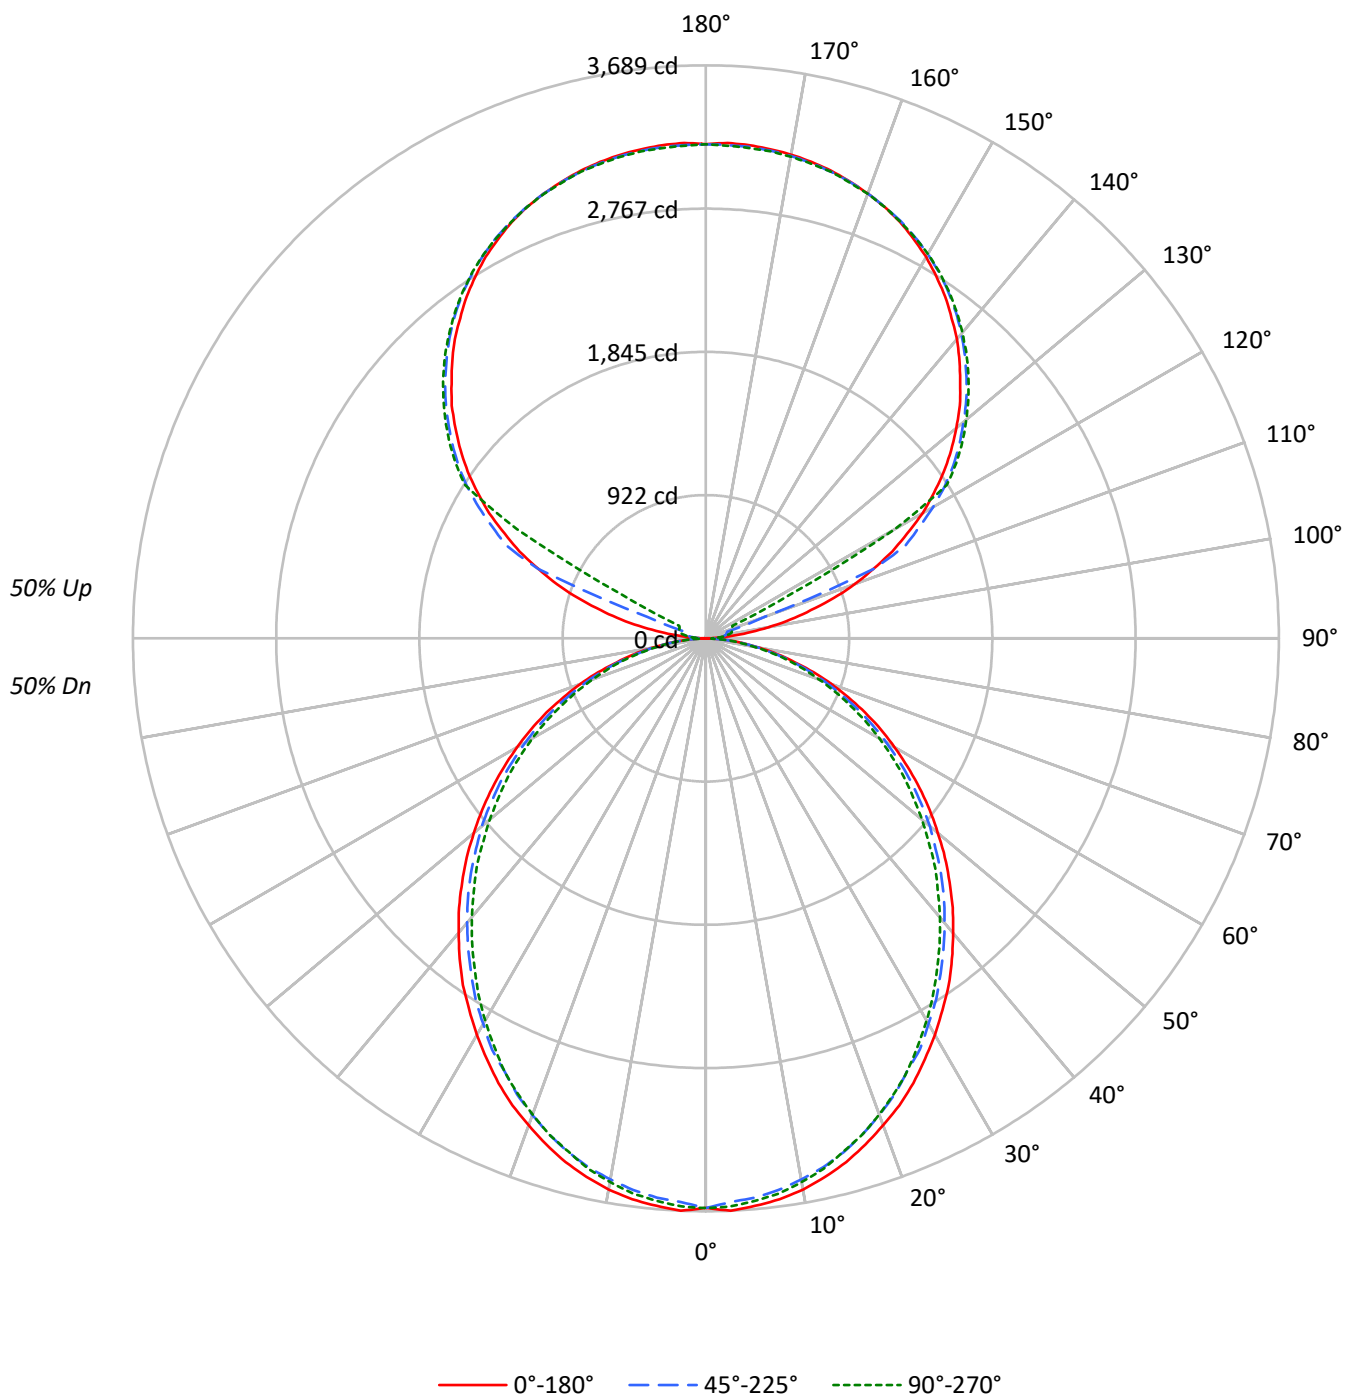

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2573	2573	2573
5°	2577	2538	2555
10°	2557	2504	2522
15°	2519	2464	2468
20°	2468	2407	2413
25°	2418	2339	2350
30°	2354	2276	2270
35°	2294	2201	2184
40°	2220	2126	2103
45°	2147	2050	2020
50°	2066	1971	1924
55°	1982	1879	1836
60°	1886	1770	1735
65°	1782	1658	1616
70°	1650	1520	1488
75°	1466	1356	1371
80°	1245	1147	1145
85°	900	785	770

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2147 cd/sqm

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	345.2	1.8
10°-20°	971.2	5.2
20°-30°	1427.3	7.6
30°-40°	1657.7	8.9
40°-50°	1655.7	8.9
50°-60°	1443.7	7.7
60°-70°	1067.2	5.7
70°-80°	603.8	3.2
80°-90°	165.0	0.9
90°-100°	104.9	0.6
100°-110°	391.0	2.1
110°-120°	1037.0	5.6
120°-130°	1720.0	9.2
130°-140°	1827.0	9.8
140°-150°	1698.0	9.1
150°-160°	1365.2	7.3
160°-170°	879.7	4.7
170°-180°	302.8	1.6
0°-30°	2743.7	14.7
0°-40°	4401.4	23.6
0°-60°	7500.8	40.2
0°-90°	9336.8	50.0
90°-120°	1532.9	8.2
90°-150°	6778.0	36.3
90°-180°	9326.0	50.0
0°-180°	18662.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3668	3668	3668	3668	3668	
5°	3668	3654	3615	3643	3636	348
15°	3491	3470	3424	3438	3421	983
25°	3160	3132	3072	3078	3072	1454
35°	2726	2691	2634	2613	2596	1702
45°	2218	2194	2140	2102	2088	1712
55°	1679	1658	1615	1573	1555	1501
65°	1132	1111	1076	1044	1026	1119
75°	592	586	568	547	554	632
85°	144	141	138	127	124	161
90°	2	28	46	58	62	17
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3667.5	3667.5	3667.5	3667.5	3667.5
2.5°	3688.8	3671.2	3632.3	3667.5	3660.7
5°	3667.5	3653.7	3614.7	3642.8	3636.0
7.5°	3642.8	3621.8	3582.9	3611.4	3604.3
10°	3604.3	3579.6	3537.3	3565.4	3554.9
12.5°	3551.1	3530.2	3487.9	3505.5	3498.3
15°	3491.3	3470.3	3424.3	3438.5	3421.0
17.5°	3417.2	3396.3	3350.2	3367.8	3350.2
20°	3335.9	3315.0	3265.6	3276.1	3262.2
22.5°	3255.2	3223.4	3177.3	3177.3	3170.2
25°	3159.8	3131.7	3071.8	3078.5	3071.8
27.5°	3053.8	3029.1	2983.5	2973.1	2955.4
30°	2948.4	2919.9	2867.1	2856.7	2842.4
32.5°	2835.4	2814.4	2757.9	2736.6	2722.3
35°	2726.1	2691.0	2634.4	2613.1	2595.5
37.5°	2602.6	2570.8	2514.3	2489.6	2472.0
40°	2475.8	2447.3	2390.9	2359.5	2345.2
42.5°	2352.3	2323.8	2267.8	2232.2	2211.3
45°	2218.4	2193.7	2140.5	2102.0	2087.8
47.5°	2087.8	2063.1	2006.6	1967.7	1946.7
50°	1950.1	1932.5	1883.1	1833.7	1816.2
52.5°	1816.2	1791.5	1745.8	1706.9	1682.2
55°	1678.9	1657.6	1615.2	1572.9	1555.4
57.5°	1541.2	1523.5	1477.5	1435.3	1421.1
60°	1403.4	1389.6	1340.2	1301.3	1290.8
62.5°	1269.5	1244.8	1209.7	1174.5	1160.3
65°	1132.2	1110.9	1075.7	1043.9	1026.3
67.5°	991.2	973.2	941.8	917.1	902.9
70°	860.5	846.3	814.5	789.9	776.0
72.5°	726.6	712.4	694.8	670.1	659.6
75°	592.3	585.6	567.6	546.7	553.7
77.5°	472.6	458.4	451.2	440.7	430.3
80°	352.8	349.1	342.0	331.5	324.4
82.5°	239.9	239.9	236.5	222.3	222.3
85°	144.4	141.1	137.7	126.9	123.5
87.5°	63.6	56.5	49.4	38.9	35.2
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904097

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.57	11.43	11.53	12.41	13.68	10.13	10.99	11.08	11.96	13.23
	3H	12.24	13.01	13.20	13.99	15.28	11.75	12.52	12.71	13.50	14.79
	4H	12.83	13.56	13.81	14.54	15.84	12.33	13.06	13.31	14.05	15.35
	6H	13.23	13.90	14.22	14.89	16.21	12.73	13.40	13.72	14.39	15.71
	8H	13.34	13.98	14.34	14.99	16.30	12.84	13.48	13.83	14.48	15.79
	12H	13.39	14.00	14.39	15.00	16.33	12.88	13.49	13.88	14.49	15.82
4H	2H	11.03	11.76	12.02	12.75	14.05	10.68	11.41	11.67	12.40	13.70
	3H	12.90	13.51	13.90	14.53	15.84	12.50	13.11	13.49	14.12	15.44
	4H	13.62	14.18	14.63	15.19	16.53	13.20	13.76	14.20	14.76	16.10
	6H	14.14	14.62	15.16	15.65	16.99	13.71	14.19	14.73	15.22	16.56
	8H	14.29	14.74	15.31	15.77	17.12	13.86	14.30	14.87	15.33	16.68
	12H	14.37	14.77	15.40	15.81	17.17	13.92	14.32	14.96	15.36	16.72
8H	4H	13.82	14.27	14.84	15.29	16.64	13.44	13.89	14.46	14.91	16.27
	6H	14.45	14.83	15.50	15.89	17.24	14.07	14.44	15.11	15.51	16.86
	8H	14.68	15.01	15.73	16.06	17.42	14.29	14.61	15.34	15.66	17.03
	12H	14.81	15.10	15.87	16.15	17.56	14.40	14.69	15.46	15.74	17.15
12H	4H	13.80	14.21	14.84	15.25	16.61	13.44	13.84	14.47	14.88	16.24
	6H	14.48	14.81	15.53	15.86	17.23	14.11	14.44	15.16	15.49	16.86
	8H	14.73	15.02	15.78	16.06	17.47	14.35	14.64	15.40	15.68	17.09

END OF REPORT