

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904136

Luminaire Tested: DFN2DIP-SQ4F0-110D110US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904136
REPORT IS A COMBINATION OF REPORTS P900159 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-110D110US830-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19439.9 lumens
Efficiency: N/A
Efficacy: 103.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 187.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFLL

Luminous Intensity Polar Plot

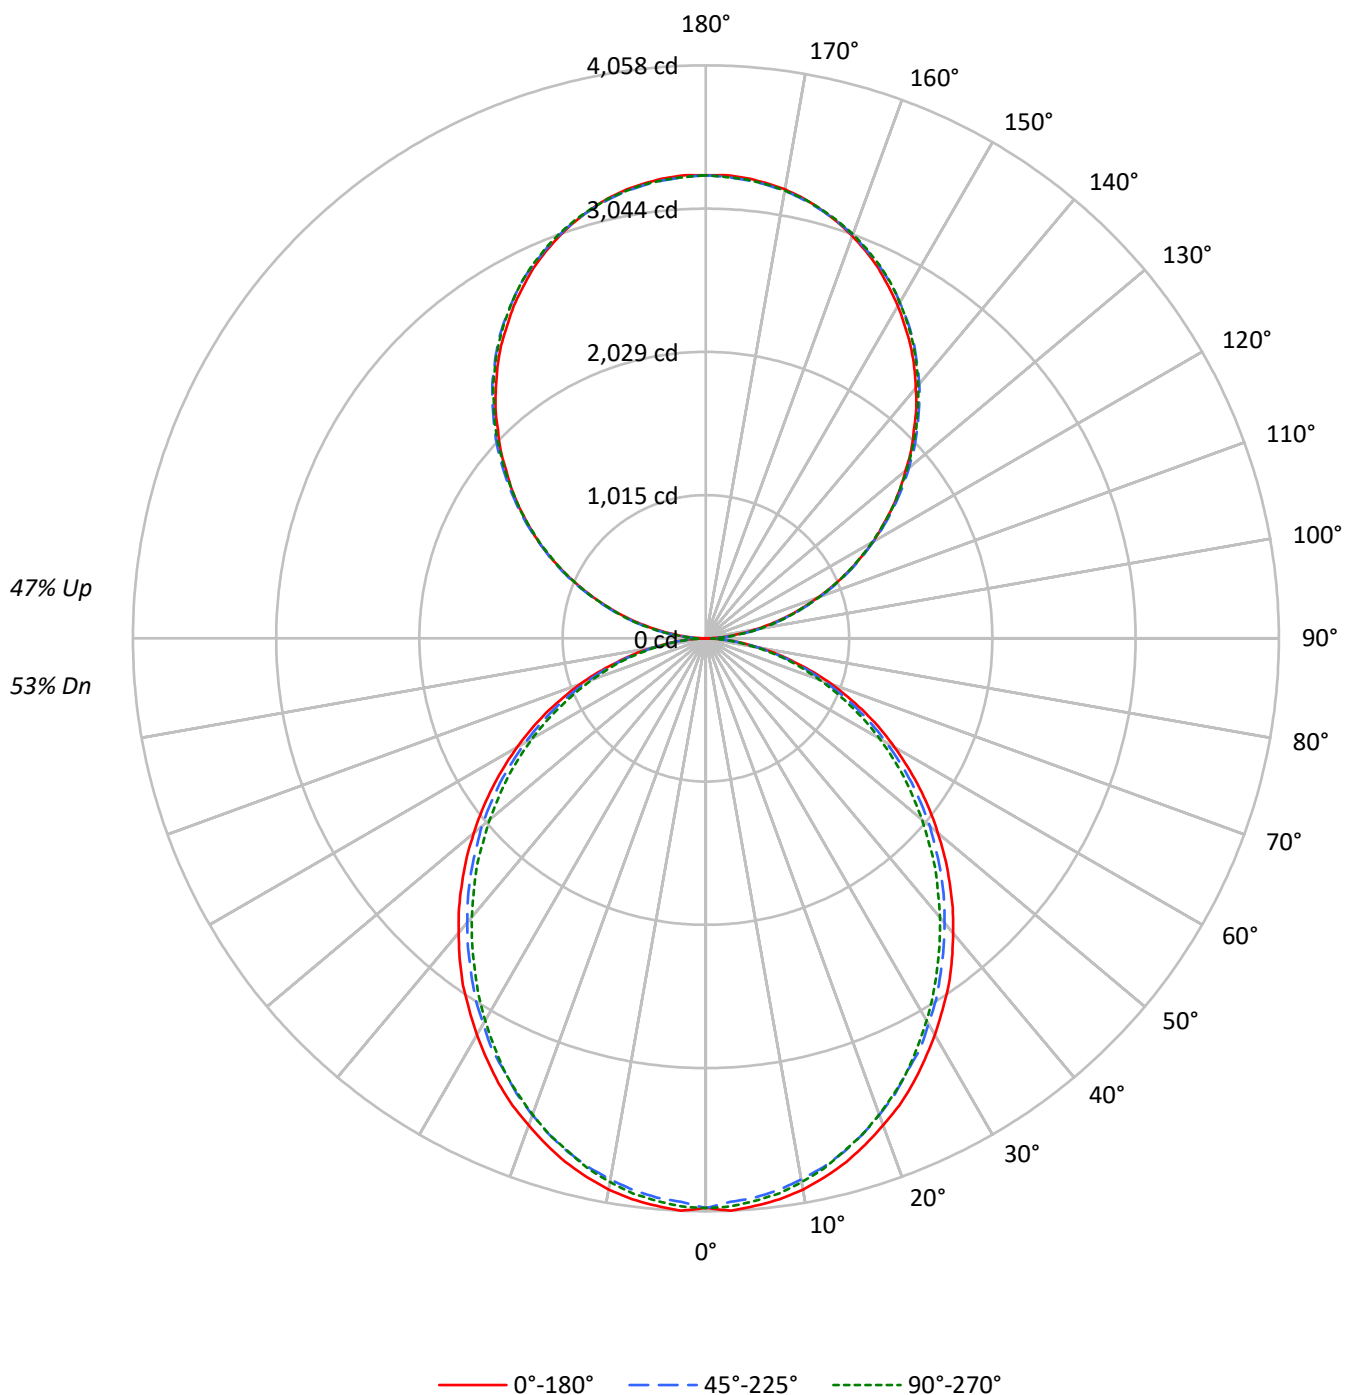

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2831	2831	2831
5°	2835	2792	2811
10°	2812	2755	2774
15°	2771	2710	2715
20°	2715	2648	2655
25°	2659	2573	2585
30°	2590	2503	2497
35°	2524	2421	2403
40°	2442	2338	2313
45°	2361	2255	2222
50°	2272	2168	2116
55°	2180	2067	2019
60°	2075	1947	1908
65°	1960	1823	1777
70°	1815	1672	1636
75°	1613	1492	1508
80°	1370	1262	1259
85°	990	863	846

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2581 cd/sqm

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	379.7	2.0
10°-20°	1068.3	5.5
20°-30°	1570.0	8.1
30°-40°	1823.5	9.4
40°-50°	1821.2	9.4
50°-60°	1588.0	8.2
60°-70°	1173.9	6.0
70°-80°	664.2	3.4
80°-90°	184.6	0.9
90°-100°	202.9	1.0
100°-110°	644.7	3.3
110°-120°	1103.3	5.7
120°-130°	1451.0	7.5
130°-140°	1628.6	8.4
140°-150°	1597.1	8.2
150°-160°	1339.7	6.9
160°-170°	888.5	4.6
170°-180°	310.5	1.6
0°-30°	3018.1	15.5
0°-40°	4841.6	24.9
0°-60°	8250.9	42.4
0°-90°	10273.6	52.8
90°-120°	1950.9	10.0
90°-150°	6627.6	34.1
90°-180°	9166.0	47.2
0°-180°	19439.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4034	4034	4034	4034	4034	
5°	4034	4019	3976	4007	4000	383
15°	3840	3817	3767	3782	3763	1082
25°	3476	3445	3379	3386	3379	1599
35°	2999	2960	2898	2874	2855	1873
45°	2440	2413	2355	2312	2297	1883
55°	1847	1823	1777	1730	1711	1651
65°	1245	1222	1183	1148	1129	1231
75°	652	644	624	601	609	696
85°	159	155	152	140	136	177
90°	3	36	97	91	94	19
95°	144	172	177	177	172	161
105°	595	603	609	614	614	628
115°	1107	1123	1118	1115	1107	1095
125°	1610	1635	1627	1618	1615	1439
135°	2083	2114	2119	2116	2109	1610
145°	2529	2548	2564	2567	2556	1580
155°	2892	2899	2908	2922	2913	1331
165°	3146	3142	3142	3162	3148	887
175°	3273	3265	3259	3279	3262	311
180°	3279	3279	3279	3279	3279	

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4034.3	4034.3	4034.3	4034.3	4034.3
2.5°	4057.6	4038.3	3995.5	4034.3	4026.8
5°	4034.3	4019.0	3976.2	4007.0	3999.7
7.5°	4007.0	3984.0	3941.2	3972.5	3964.7
10°	3964.7	3937.5	3891.0	3921.8	3910.3
12.5°	3906.3	3883.2	3836.7	3856.0	3848.2
15°	3840.4	3817.3	3766.7	3782.3	3763.0
17.5°	3758.9	3735.9	3685.2	3704.6	3685.2
20°	3669.6	3646.5	3592.2	3603.7	3588.5
22.5°	3580.7	3545.7	3495.0	3495.0	3487.2
25°	3475.7	3444.9	3379.0	3386.5	3379.0
27.5°	3359.2	3332.1	3281.8	3270.3	3251.0
30°	3243.2	3211.9	3153.8	3142.3	3126.7
32.5°	3118.9	3095.9	3033.7	3010.2	2994.6
35°	2998.7	2960.1	2897.8	2874.4	2855.1
37.5°	2862.9	2827.9	2765.8	2738.6	2719.2
40°	2723.4	2692.1	2630.0	2595.4	2579.7
42.5°	2587.6	2556.3	2494.5	2455.4	2432.4
45°	2440.2	2413.0	2354.6	2312.2	2296.6
47.5°	2296.6	2269.5	2207.2	2164.5	2141.4
50°	2145.1	2125.8	2071.4	2017.1	1997.8
52.5°	1997.8	1970.6	1920.4	1877.5	1850.4
55°	1846.7	1823.3	1776.8	1730.2	1710.9
57.5°	1695.3	1675.9	1625.3	1578.8	1563.1
60°	1543.8	1528.6	1474.2	1431.4	1419.9
62.5°	1396.5	1369.3	1330.6	1291.9	1276.3
65°	1245.4	1221.9	1183.3	1148.3	1129.0
67.5°	1090.2	1070.5	1035.9	1008.8	993.2
70°	946.6	930.9	896.0	868.8	853.6
72.5°	799.3	783.6	764.3	737.2	725.6
75°	651.5	644.1	624.3	601.3	609.2
77.5°	519.8	504.2	496.3	484.8	473.3
80°	388.1	384.0	376.2	364.7	356.8
82.5°	263.8	263.8	260.1	244.5	244.5
85°	158.9	155.1	151.5	139.5	135.8
87.5°	69.9	62.1	54.3	42.8	38.6
90°	2.9	35.6	96.9	91.0	93.9
92.5°	61.3	83.0	86.0	89.0	89.0
95°	144.3	172.0	176.9	176.9	172.0
97.5°	240.3	265.9	276.8	276.8	276.8
100°	350.9	373.6	381.5	381.5	378.6
102.5°	467.6	484.4	495.3	498.2	495.3
105°	595.1	603.0	609.0	613.9	613.9
107.5°	721.6	733.5	733.5	735.5	721.6
110°	844.2	860.1	860.1	860.1	852.2

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	976.7	993.4	990.5	982.6	976.7
115°	1107.2	1122.9	1118.0	1115.1	1107.2
117.5°	1236.7	1258.4	1244.5	1236.7	1228.8
120°	1367.2	1388.9	1367.2	1367.2	1358.3
122.5°	1485.8	1513.4	1499.6	1491.7	1485.8
125°	1610.3	1635.0	1627.1	1618.3	1615.2
127.5°	1731.9	1762.6	1751.7	1739.8	1731.9
130°	1845.6	1881.2	1876.2	1870.3	1859.4
132.5°	1973.1	2000.8	2002.8	1989.0	1981.0
135°	2082.8	2113.5	2119.4	2116.5	2108.6
137.5°	2205.5	2230.1	2235.1	2233.1	2221.3
140°	2313.2	2337.9	2351.7	2351.7	2340.9
142.5°	2423.9	2448.6	2456.5	2459.5	2448.6
145°	2528.7	2548.4	2564.3	2567.2	2556.4
147.5°	2622.6	2647.3	2659.2	2664.1	2653.3
150°	2719.5	2736.3	2747.1	2756.1	2747.1
152.5°	2805.5	2822.3	2836.1	2847.0	2836.1
155°	2891.5	2899.4	2908.3	2922.2	2913.2
157.5°	2965.6	2971.6	2976.5	2996.2	2982.4
160°	3031.9	3037.8	3040.7	3057.6	3045.7
162.5°	3093.1	3093.1	3096.2	3114.9	3101.1
165°	3145.5	3142.5	3142.5	3162.3	3148.5
167.5°	3193.0	3184.1	3184.1	3203.9	3190.0
170°	3228.6	3220.7	3217.7	3237.4	3220.7
172.5°	3253.3	3245.4	3242.4	3262.2	3245.4
175°	3273.1	3265.2	3259.2	3279.0	3262.2
177.5°	3283.9	3276.0	3270.1	3286.9	3270.1
180°	3279.0	3279.0	3279.0	3279.0	3279.0

TEST NUMBER: P904136

CATALOG NUMBER: DFN2DIP-SQ4F0-110D110US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.16	12.05	12.09	13.00	14.23	10.71	11.60	11.65	12.55	13.78
	3H	12.82	13.62	13.77	14.58	15.83	12.33	13.13	13.28	14.09	15.34
	4H	13.42	14.17	14.37	15.13	16.40	12.92	13.68	13.88	14.64	15.90
	6H	13.82	14.52	14.79	15.48	16.76	13.32	14.02	14.29	14.98	16.26
	8H	13.93	14.59	14.90	15.58	16.85	13.43	14.09	14.40	15.07	16.35
	12H	13.98	14.61	14.96	15.59	16.89	13.47	14.10	14.45	15.08	16.38
4H	2H	11.62	12.38	12.59	13.34	14.60	11.27	12.02	12.23	12.98	14.25
	3H	13.50	14.12	14.47	15.12	16.39	13.09	13.72	14.06	14.71	15.99
	4H	14.21	14.79	15.20	15.78	17.08	13.79	14.37	14.77	15.35	16.65
	6H	14.74	15.23	15.73	16.24	17.54	14.30	14.80	15.30	15.81	17.11
	8H	14.89	15.35	15.88	16.35	17.67	14.45	14.91	15.45	15.92	17.23
	12H	14.96	15.38	15.98	16.40	17.72	14.51	14.93	15.53	15.95	17.27
8H	4H	14.41	14.88	15.41	15.88	17.19	14.04	14.50	15.03	15.50	16.82
	6H	15.05	15.43	16.07	16.48	17.79	14.67	15.05	15.69	16.10	17.41
	8H	15.27	15.61	16.30	16.64	17.97	14.88	15.22	15.91	16.25	17.58
	12H	15.41	15.71	16.44	16.73	18.11	15.00	15.30	16.03	16.32	17.70
12H	4H	14.40	14.82	15.42	15.84	17.16	14.03	14.45	15.05	15.47	16.79
	6H	15.08	15.42	16.11	16.45	17.78	14.71	15.05	15.74	16.08	17.41
	8H	15.33	15.62	16.36	16.65	18.02	14.95	15.24	15.98	16.27	17.64

END OF REPORT