

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904155

Luminaire Tested: DFN2DIP-SQ4F0-120D060US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904155
REPORT IS A COMBINATION OF REPORTS P901592 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-120D060US830-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15212.6 lumens
Efficiency: N/A
Efficacy: 93.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 162.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLLONL

Luminous Intensity Polar Plot

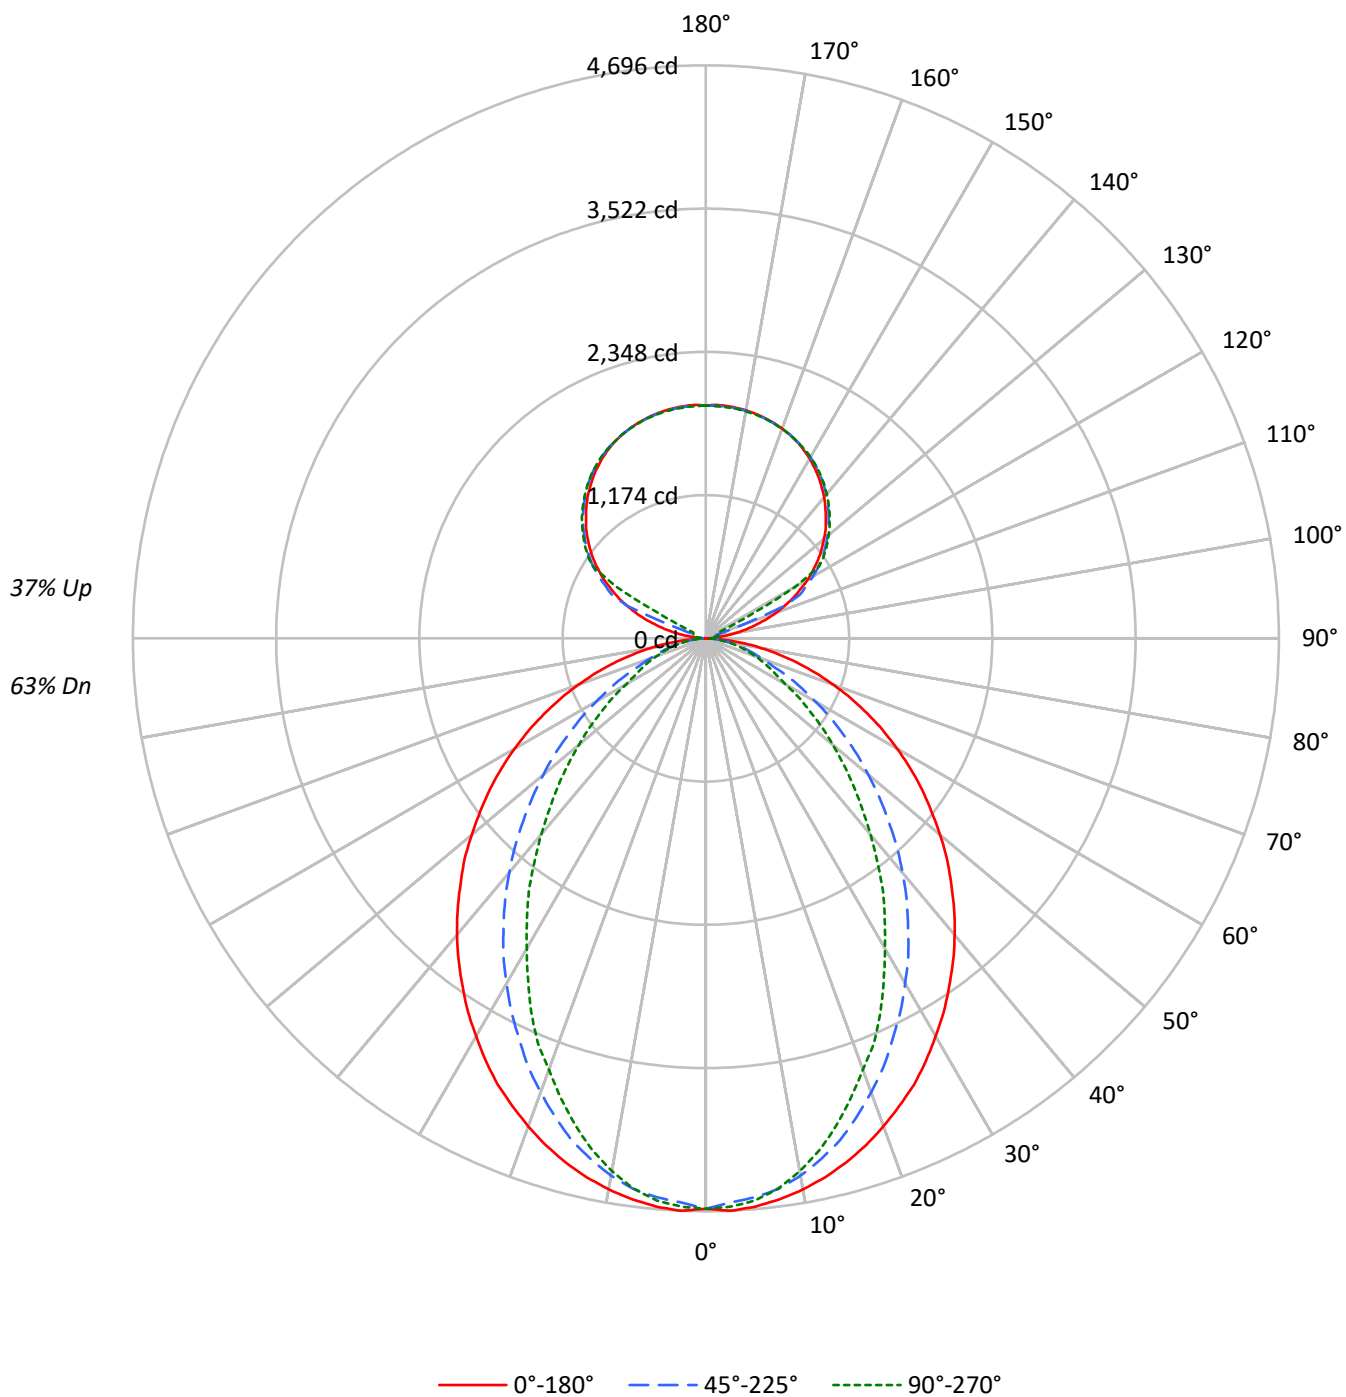

TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	91	91	91	79	79	79	68	68	68
1	101	97	93	90	95	91	88	85	80	78	76	71	69	67	61	60	59
2	93	86	80	75	87	81	75	71	71	67	64	63	60	57	55	52	51
3	85	76	69	63	80	72	65	60	63	58	54	56	52	49	49	46	44
4	78	68	60	54	73	64	57	52	57	51	47	50	46	43	44	41	38
5	72	61	53	47	67	57	50	45	51	45	41	46	41	37	40	37	34
6	67	55	47	41	62	52	45	39	46	41	36	41	37	33	37	33	30
7	62	50	42	36	58	47	40	35	42	36	32	38	33	30	34	30	27
8	58	45	38	32	54	43	36	31	39	33	29	35	30	27	31	27	24
9	54	42	34	29	51	40	33	28	36	30	26	32	27	24	29	25	22
10	50	38	31	26	47	37	30	25	33	28	24	30	25	22	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3280	3280	3280
5°	3285	3229	3250
10°	3253	3166	3145
15°	3208	3062	2982
20°	3149	2918	2782
25°	3088	2757	2589
30°	3006	2592	2344
35°	2927	2414	2129
40°	2845	2230	1882
45°	2751	2026	1658
50°	2653	1820	1439
55°	2551	1599	1228
60°	2433	1369	1012
65°	2298	1134	912
70°	2133	916	827
75°	1926	809	754
80°	1627	680	657
85°	1133	458	500

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2751 cd/sqm

TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	438.1	2.9
10°-20°	1202.7	7.9
20°-30°	1688.5	11.1
30°-40°	1840.6	12.1
40°-50°	1691.7	11.1
50°-60°	1328.6	8.7
60°-70°	864.8	5.7
70°-80°	445.2	2.9
80°-90°	117.0	0.8
90°-100°	62.9	0.4
100°-110°	234.6	1.5
110°-120°	622.2	4.1
120°-130°	1032.0	6.8
130°-140°	1096.2	7.2
140°-150°	1018.8	6.7
150°-160°	819.1	5.4
160°-170°	527.8	3.5
170°-180°	181.7	1.2
0°-30°	3329.4	21.9
0°-40°	5170.0	34.0
0°-60°	8190.3	53.8
0°-90°	9617.3	63.2
90°-120°	919.8	6.0
90°-150°	4066.8	26.7
90°-180°	5595.0	36.8
0°-180°	15212.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4675	4675	4675	4675	4675	
5°	4675	4654	4598	4636	4624	443
15°	4446	4400	4256	4176	4133	1253
25°	4036	3900	3621	3448	3384	1856
35°	3478	3262	2890	2623	2530	2177
45°	2843	2559	2115	1815	1713	2195
55°	2162	1832	1375	1121	1041	1932
65°	1460	1117	736	592	580	1447
75°	778	482	338	309	305	823
85°	182	93	80	80	80	209
90°	1	17	28	35	37	14
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4674.6	4674.6	4674.6	4674.6	4674.6
2.5°	4695.7	4674.6	4628.0	4670.6	4662.0
5°	4674.6	4653.5	4598.3	4636.5	4623.9
7.5°	4636.5	4611.3	4552.1	4568.7	4547.6
10°	4585.8	4556.2	4471.7	4458.7	4433.6
12.5°	4522.4	4484.3	4369.8	4344.7	4298.1
15°	4446.2	4399.5	4255.9	4175.5	4133.3
17.5°	4357.3	4289.5	4111.7	4018.9	3951.1
20°	4255.9	4171.0	3959.6	3854.1	3760.7
22.5°	4145.9	4048.5	3803.0	3659.3	3596.1
25°	4036.0	3900.3	3621.2	3447.9	3384.2
27.5°	3904.9	3760.7	3452.0	3253.2	3155.7
30°	3765.3	3604.2	3265.7	3050.3	2935.8
32.5°	3629.7	3434.9	3088.4	2834.4	2728.5
35°	3477.6	3261.7	2889.6	2623.0	2529.6
37.5°	3329.4	3096.5	2703.3	2411.1	2305.6
40°	3172.8	2919.2	2508.6	2208.3	2098.3
42.5°	3012.1	2741.5	2314.2	2000.9	1895.5
45°	2842.9	2559.3	2115.3	1814.7	1713.2
47.5°	2682.2	2382.0	1925.0	1624.4	1531.4
50°	2504.5	2204.2	1738.8	1446.6	1358.2
52.5°	2330.8	2013.5	1561.0	1281.9	1201.6
55°	2161.6	1831.7	1374.8	1121.2	1040.8
57.5°	1988.3	1649.9	1210.0	973.1	905.3
60°	1810.6	1472.2	1036.3	821.0	753.2
62.5°	1637.4	1298.9	888.3	685.4	651.7
65°	1459.6	1116.7	736.1	592.5	579.5
67.5°	1290.4	947.4	592.5	520.2	507.7
70°	1112.7	782.8	490.6	448.4	431.3
72.5°	943.5	630.2	410.2	376.5	368.1
75°	778.3	482.0	338.5	308.8	304.7
77.5°	613.6	342.4	266.6	249.6	241.0
80°	461.0	245.5	202.8	186.2	186.2
82.5°	321.4	165.1	139.6	131.0	131.0
85°	181.8	92.9	80.3	80.3	80.3
87.5°	67.8	33.6	33.6	29.6	29.6
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1



TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P904155

CATALOG NUMBER: DFN2DIP-SQ4F0-120D060US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.44	13.39	13.28	14.25	15.32	8.40	9.35	9.24	10.21	11.28
	3H	14.13	14.98	14.99	15.85	16.95	9.60	10.45	10.45	11.32	12.42
	4H	14.75	15.55	15.62	16.42	17.53	10.05	10.86	10.93	11.73	12.84
	6H	15.18	15.92	16.06	16.80	17.92	10.38	11.12	11.27	12.00	13.13
	8H	15.31	16.01	16.20	16.91	18.04	10.48	11.18	11.37	12.08	13.20
	12H	15.38	16.05	16.27	16.94	18.09	10.52	11.19	11.42	12.09	13.23
4H	2H	12.47	13.27	13.35	14.15	15.26	9.01	9.82	9.89	10.69	11.80
	3H	14.32	14.98	15.20	15.89	17.02	10.37	11.04	11.26	11.95	13.07
	4H	15.02	15.62	15.92	16.53	17.68	10.93	11.53	11.83	12.44	13.59
	6H	15.54	16.07	16.46	16.99	18.15	11.35	11.88	12.27	12.80	13.96
	8H	15.72	16.21	16.64	17.13	18.30	11.49	11.97	12.40	12.90	14.06
	12H	15.83	16.27	16.76	17.21	18.38	11.56	12.00	12.49	12.94	14.11
8H	4H	14.99	15.48	15.91	16.40	17.57	11.22	11.71	12.14	12.63	13.80
	6H	15.57	15.97	16.51	16.94	18.10	11.74	12.15	12.69	13.11	14.28
	8H	15.79	16.15	16.74	17.10	18.28	11.94	12.29	12.89	13.25	14.43
	12H	15.94	16.25	16.89	17.20	18.43	12.06	12.37	13.01	13.32	14.56
12H	4H	14.95	15.39	15.89	16.33	17.50	11.23	11.67	12.16	12.61	13.78
	6H	15.54	15.90	16.50	16.86	18.04	11.79	12.15	12.75	13.11	14.29
	8H	15.77	16.09	16.73	17.04	18.27	12.01	12.32	12.96	13.27	14.51

END OF REPORT