

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904196

Luminaire Tested: DFN2DIP-SQ4F0-140D080US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904196
REPORT IS A COMBINATION OF REPORTS P900109 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D080US830-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19736.8 lumens
Efficiency: N/A
Efficacy: 97.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 203.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFLL

Luminous Intensity Polar Plot

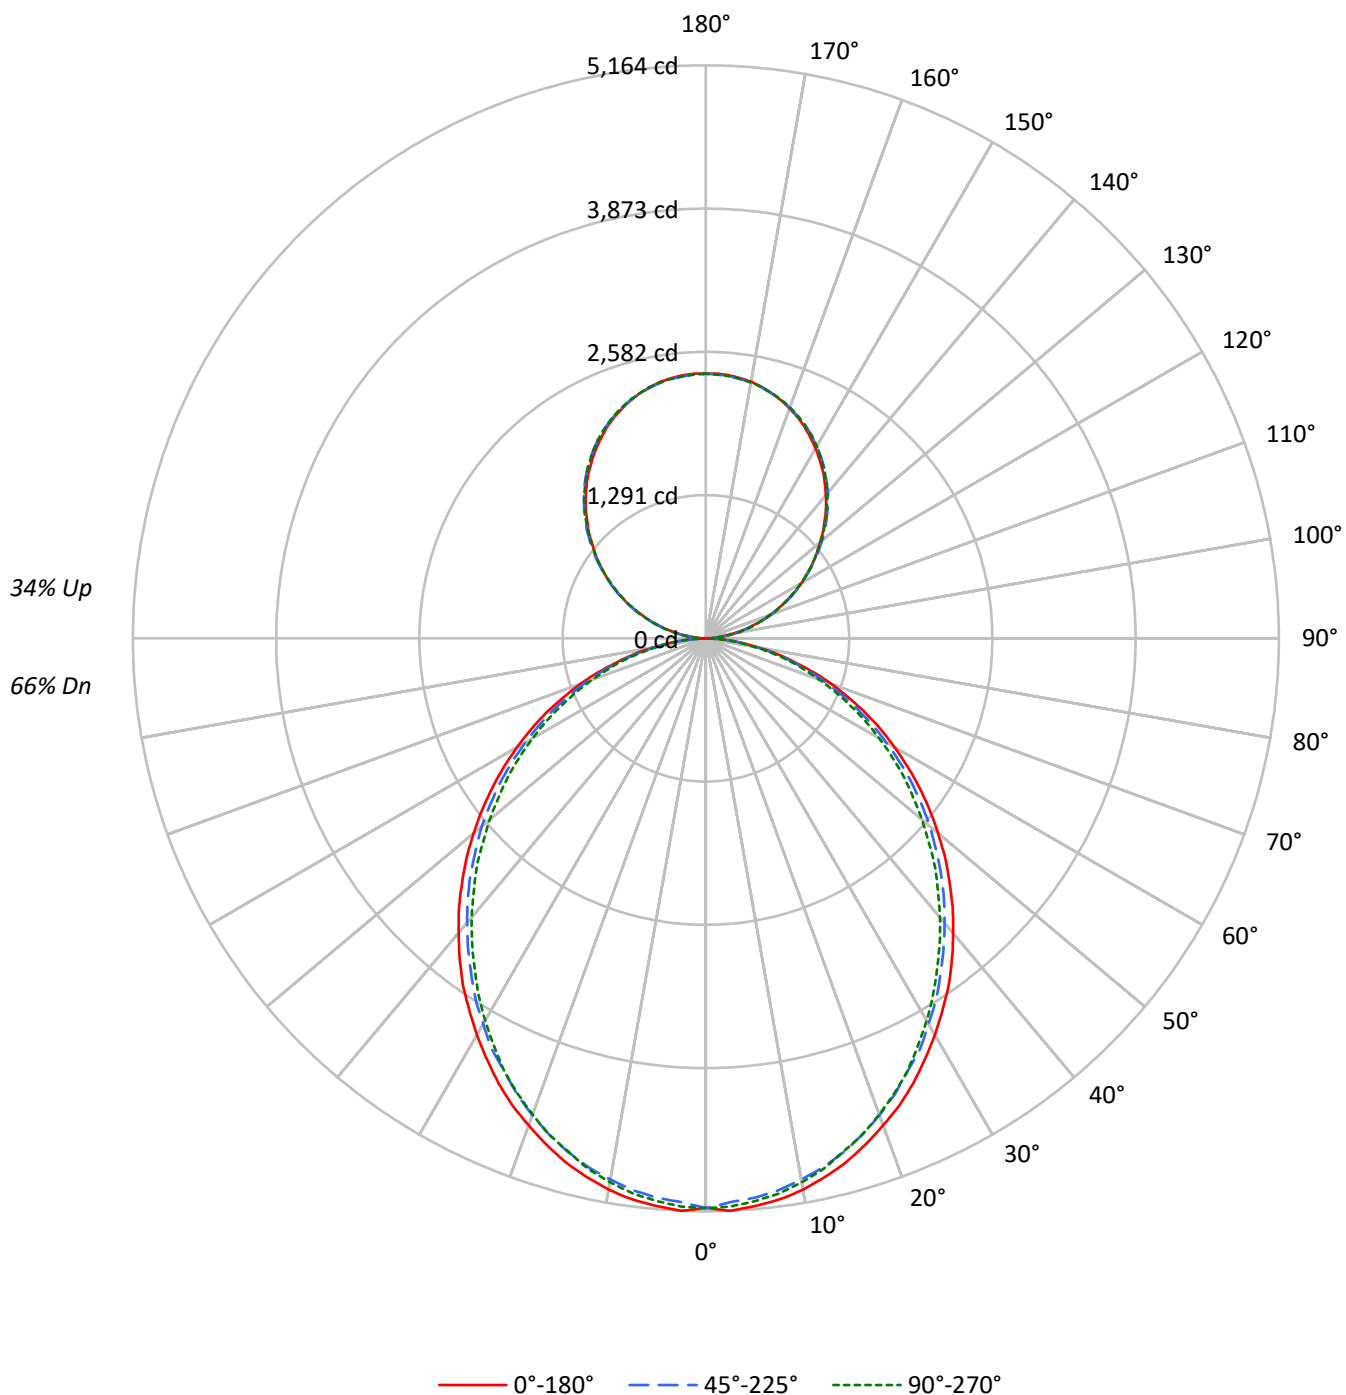

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	72	70	68	63	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	60	57	55	53	51
3	84	75	67	61	79	70	64	58	63	57	53	56	51	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	25
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3603	3603	3603
5°	3608	3553	3578
10°	3579	3506	3530
15°	3526	3449	3455
20°	3455	3370	3379
25°	3385	3274	3290
30°	3296	3186	3177
35°	3212	3081	3058
40°	3108	2976	2944
45°	3005	2870	2828
50°	2892	2759	2694
55°	2774	2631	2570
60°	2641	2478	2429
65°	2495	2321	2262
70°	2310	2128	2083
75°	2052	1899	1919
80°	1744	1606	1603
85°	1260	1098	1078

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3005 cd/sqm

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	483.3	2.4
10°-20°	1359.7	6.9
20°-30°	1998.2	10.1
30°-40°	2320.8	11.8
40°-50°	2318.0	11.7
50°-60°	2021.2	10.2
60°-70°	1494.1	7.6
70°-80°	845.3	4.3
80°-90°	229.9	1.2
90°-100°	147.6	0.7
100°-110°	468.9	2.4
110°-120°	802.4	4.1
120°-130°	1055.3	5.3
130°-140°	1184.5	6.0
140°-150°	1161.5	5.9
150°-160°	974.4	4.9
160°-170°	646.2	3.3
170°-180°	225.9	1.1
0°-30°	3841.2	19.5
0°-40°	6162.0	31.2
0°-60°	10501.1	53.2
0°-90°	13070.4	66.2
90°-120°	1418.8	7.2
90°-150°	4820.1	24.4
90°-180°	6666.0	33.8
0°-180°	19736.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5134	5134	5134	5134	5134	
5°	5134	5115	5061	5100	5090	487
15°	4888	4858	4794	4814	4789	1377
25°	4424	4384	4300	4310	4300	2036
35°	3816	3767	3688	3658	3634	2383
45°	3106	3071	2997	2943	2923	2397
55°	2350	2320	2261	2202	2178	2101
65°	1585	1555	1506	1461	1437	1567
75°	829	820	795	765	775	885
85°	202	198	193	178	173	226
90°	2	26	70	66	68	19
95°	105	125	129	129	125	117
105°	433	439	443	446	446	457
115°	805	817	813	811	805	796
125°	1171	1189	1183	1177	1175	1047
135°	1515	1537	1541	1539	1534	1171
145°	1839	1853	1865	1867	1859	1149
155°	2103	2109	2115	2125	2119	968
165°	2288	2286	2286	2300	2290	645
175°	2380	2375	2370	2385	2372	226
180°	2385	2385	2385	2385	2385	

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5134.5	5134.5	5134.5	5134.5	5134.5
2.5°	5164.3	5139.7	5085.2	5134.5	5125.1
5°	5134.5	5115.1	5060.6	5099.9	5090.5
7.5°	5099.9	5070.6	5016.1	5055.9	5045.9
10°	5045.9	5011.4	4952.2	4991.5	4976.8
12.5°	4971.5	4942.2	4883.0	4907.6	4897.7
15°	4887.7	4858.4	4794.0	4813.9	4789.2
17.5°	4784.1	4754.7	4690.3	4714.9	4690.3
20°	4670.4	4641.1	4571.9	4586.6	4567.2
22.5°	4557.2	4512.7	4448.2	4448.2	4438.3
25°	4423.6	4384.3	4300.5	4310.0	4300.5
27.5°	4275.4	4240.9	4177.0	4162.3	4137.7
30°	4127.7	4087.9	4014.0	3999.4	3979.4
32.5°	3969.5	3940.2	3861.0	3831.2	3811.3
35°	3816.5	3767.3	3688.2	3658.4	3633.7
37.5°	3643.7	3599.2	3520.0	3485.5	3460.8
40°	3466.1	3426.3	3347.2	3303.2	3283.3
42.5°	3293.2	3253.5	3174.9	3125.1	3095.8
45°	3105.7	3071.2	2996.8	2942.8	2922.9
47.5°	2922.9	2888.3	2809.2	2754.8	2725.5
50°	2730.2	2705.6	2636.4	2567.2	2542.6
52.5°	2542.6	2508.0	2444.1	2389.6	2355.1
55°	2350.4	2320.5	2261.3	2202.2	2177.6
57.5°	2157.6	2133.0	2068.6	2009.4	1989.4
60°	1964.8	1945.5	1876.3	1821.8	1807.1
62.5°	1777.4	1742.8	1693.5	1644.3	1624.4
65°	1585.1	1555.2	1506.0	1461.4	1436.8
67.5°	1387.6	1362.4	1318.4	1283.8	1263.9
70°	1204.8	1184.9	1140.4	1105.8	1086.4
72.5°	1017.3	997.3	972.7	938.2	923.5
75°	829.2	819.8	794.7	765.3	775.2
77.5°	661.6	641.7	631.7	617.1	602.4
80°	494.0	488.7	478.8	464.1	454.1
82.5°	335.7	335.7	331.0	311.1	311.1
85°	202.2	197.5	192.7	177.6	172.9
87.5°	89.1	79.1	69.2	54.5	49.2
90°	2.2	25.9	70.5	66.2	68.3
92.5°	44.6	60.4	62.6	64.7	64.7
95°	105.0	125.1	128.7	128.7	125.1
97.5°	174.7	193.4	201.3	201.3	201.3
100°	255.2	271.7	277.5	277.5	275.3
102.5°	340.1	352.3	360.1	362.3	360.1
105°	432.8	438.6	442.9	446.5	446.5
107.5°	524.8	533.5	533.5	534.9	524.8
110°	614.0	625.5	625.5	625.5	619.7

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	710.3	722.6	720.4	714.6	710.3
115°	805.2	816.7	813.1	811.0	805.2
117.5°	899.4	915.2	905.1	899.4	893.6
120°	994.3	1010.1	994.3	994.3	987.8
122.5°	1080.5	1100.7	1090.6	1084.9	1080.5
125°	1171.1	1189.1	1183.4	1176.9	1174.8
127.5°	1259.6	1281.9	1273.9	1265.4	1259.6
130°	1342.3	1368.1	1364.5	1360.3	1352.4
132.5°	1435.0	1455.1	1456.6	1446.5	1440.8
135°	1514.8	1537.1	1541.4	1539.3	1533.5
137.5°	1603.9	1621.9	1625.5	1624.1	1615.4
140°	1682.3	1700.3	1710.3	1710.3	1702.4
142.5°	1762.8	1780.8	1786.6	1788.8	1780.8
145°	1839.1	1853.4	1864.9	1867.1	1859.2
147.5°	1907.3	1925.3	1933.9	1937.6	1929.7
150°	1977.8	1990.0	1997.9	2004.4	1997.9
152.5°	2040.3	2052.6	2062.7	2070.6	2062.7
155°	2102.9	2108.7	2115.2	2125.2	2118.7
157.5°	2156.8	2161.2	2164.7	2179.1	2169.1
160°	2205.0	2209.3	2211.5	2223.6	2215.1
162.5°	2249.6	2249.6	2251.7	2265.4	2255.3
165°	2287.6	2285.5	2285.5	2299.9	2289.8
167.5°	2322.1	2315.7	2315.7	2330.1	2320.0
170°	2348.1	2342.3	2340.1	2354.6	2342.3
172.5°	2366.1	2360.3	2358.1	2372.5	2360.3
175°	2380.4	2374.6	2370.3	2384.7	2372.5
177.5°	2388.3	2382.6	2378.2	2390.5	2378.2
180°	2384.7	2384.7	2384.7	2384.7	2384.7

TEST NUMBER: P904196

CATALOG NUMBER: DFN2DIP-SQ4F0-140D080US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.11	14.14	13.92	14.97	15.99	12.67	13.70	13.47	14.52	15.54
	3H	14.79	15.71	15.61	16.55	17.60	14.30	15.22	15.12	16.06	17.11
	4H	15.39	16.26	16.22	17.11	18.16	14.89	15.77	15.73	16.61	17.67
	6H	15.80	16.61	16.65	17.46	18.53	15.30	16.11	16.15	16.96	18.03
	8H	15.91	16.68	16.77	17.55	18.62	15.41	16.18	16.27	17.05	18.12
	12H	15.97	16.70	16.83	17.56	18.66	15.46	16.19	16.32	17.05	18.15
4H	2H	13.59	14.47	14.43	15.31	16.37	13.24	14.11	14.08	14.96	16.02
	3H	15.48	16.21	16.33	17.09	18.16	15.07	15.80	15.92	16.68	17.75
	4H	16.20	16.87	17.07	17.74	18.84	15.78	16.44	16.64	17.32	18.42
	6H	16.73	17.31	17.61	18.21	19.31	16.30	16.88	17.18	17.77	18.88
	8H	16.89	17.43	17.77	18.32	19.44	16.45	16.99	17.33	17.88	19.00
	12H	16.97	17.46	17.87	18.37	19.49	16.52	17.01	17.42	17.92	19.04
8H	4H	16.42	16.95	17.30	17.85	18.96	16.04	16.58	16.92	17.47	18.59
	6H	17.06	17.50	17.97	18.44	19.56	16.67	17.12	17.58	18.05	19.17
	8H	17.28	17.68	18.20	18.61	19.74	16.89	17.29	17.81	18.21	19.35
	12H	17.43	17.77	18.35	18.69	19.88	17.01	17.36	17.94	18.28	19.47
12H	4H	16.41	16.89	17.31	17.81	18.93	16.04	16.52	16.94	17.44	18.56
	6H	17.09	17.48	18.01	18.41	19.55	16.72	17.11	17.64	18.04	19.17
	8H	17.34	17.69	18.27	18.61	19.80	16.96	17.31	17.89	18.23	19.42