

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904211

Luminaire Tested: DFN2DIP-SQ4F0-140D110US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904211
REPORT IS A COMBINATION OF REPORTS P901684 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D110US830-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21480.5 lumens
Efficiency: N/A
Efficacy: 94.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 226.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLLONL

Luminous Intensity Polar Plot

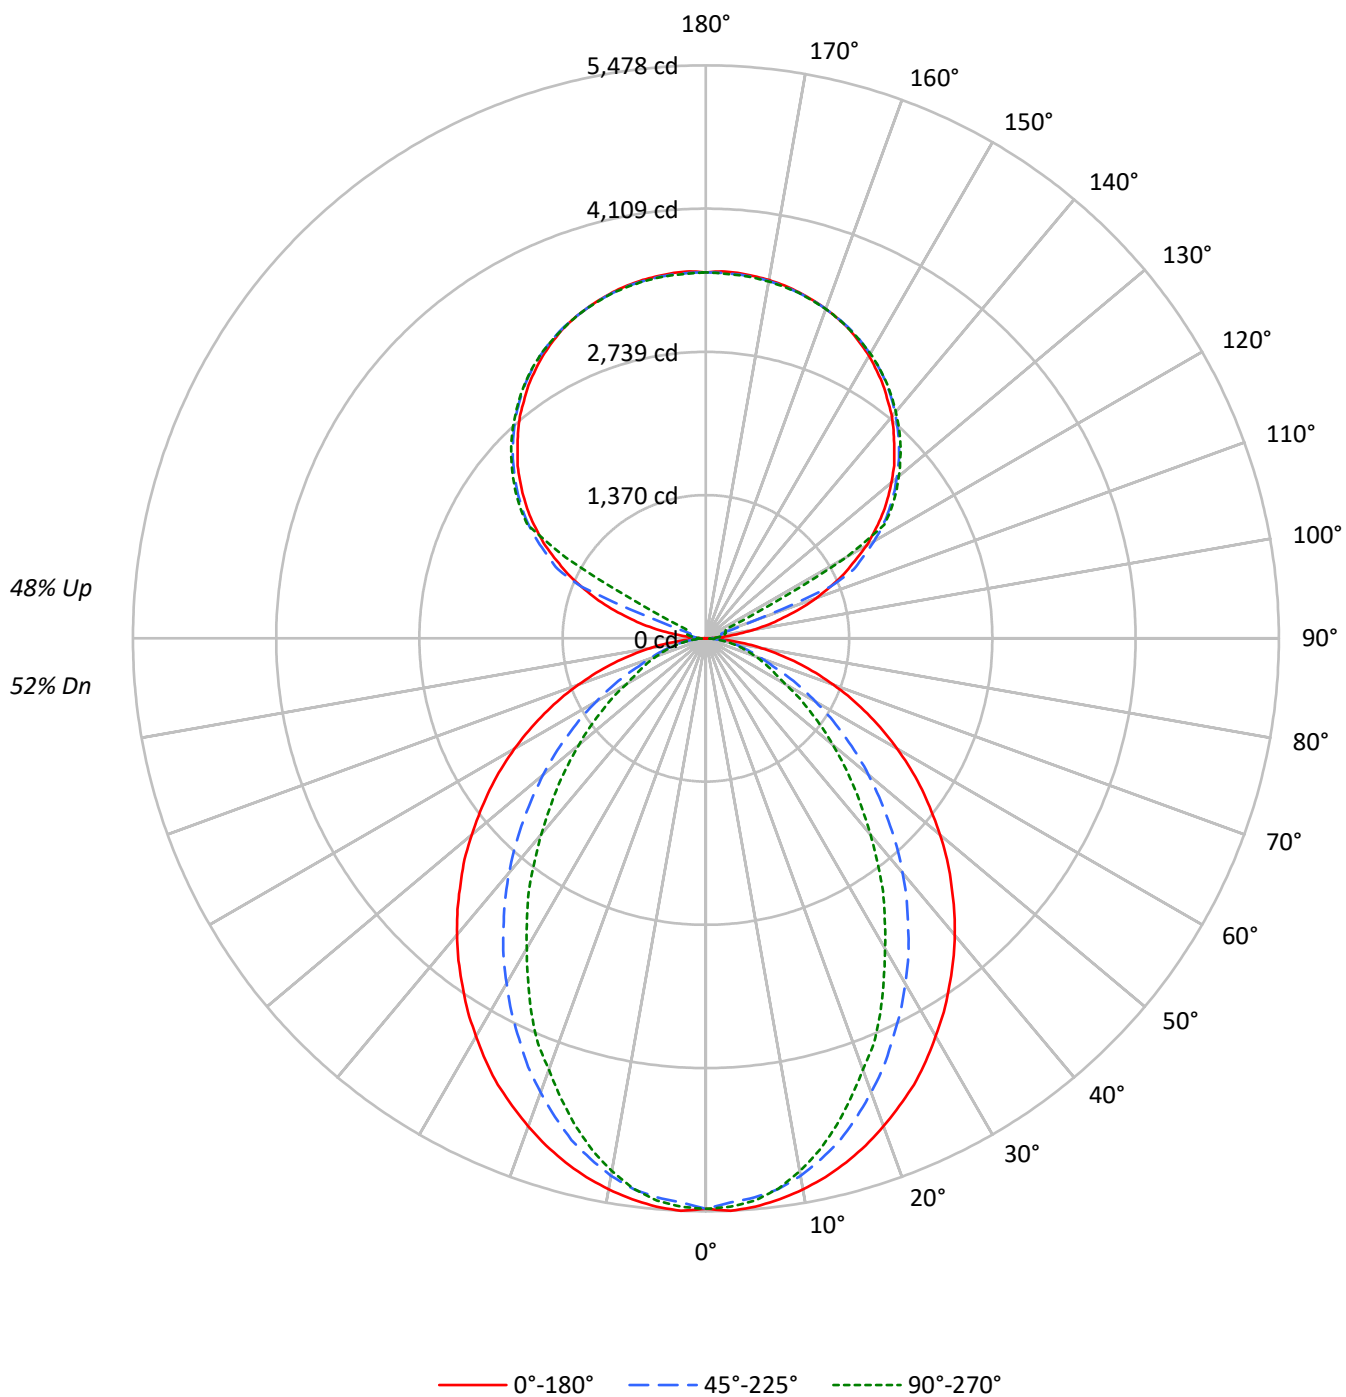

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	65	58	52	70	61	54	49	53	47	43	45	41	38	38	35	32
5	70	59	51	45	65	55	48	42	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	25
7	60	48	40	35	55	45	38	33	39	34	29	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	37	31	26	33	28	24	29	24	21	24	21	19
10	49	37	30	25	45	35	28	24	30	25	22	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3827	3827	3827
5°	3833	3767	3791
10°	3795	3694	3669
15°	3743	3572	3479
20°	3673	3405	3246
25°	3603	3217	3021
30°	3507	3024	2735
35°	3414	2817	2484
40°	3319	2602	2195
45°	3209	2364	1934
50°	3095	2123	1679
55°	2977	1866	1433
60°	2839	1597	1181
65°	2681	1323	1064
70°	2489	1068	965
75°	2247	943	880
80°	1898	794	767
85°	1322	534	584

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3209 cd/sqm

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	511.1	2.4
10°-20°	1403.2	6.5
20°-30°	1970.0	9.2
30°-40°	2147.4	10.0
40°-50°	1973.7	9.2
50°-60°	1550.0	7.2
60°-70°	1008.9	4.7
70°-80°	519.3	2.4
80°-90°	138.8	0.6
90°-100°	115.4	0.5
100°-110°	430.1	2.0
110°-120°	1140.7	5.3
120°-130°	1892.0	8.8
130°-140°	2009.7	9.4
140°-150°	1867.8	8.7
150°-160°	1501.7	7.0
160°-170°	967.6	4.5
170°-180°	333.0	1.6
0°-30°	3884.3	18.1
0°-40°	6031.7	28.1
0°-60°	9555.4	44.5
0°-90°	11222.4	52.2
90°-120°	1686.2	7.8
90°-150°	7455.8	34.7
90°-180°	10258.0	47.8
0°-180°	21480.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5454	5454	5454	5454	5454	
5°	5454	5429	5365	5409	5394	517
15°	5187	5133	4965	4871	4822	1462
25°	4709	4550	4225	4023	3948	2165
35°	4057	3805	3371	3060	2951	2539
45°	3317	2986	2468	2117	1999	2561
55°	2522	2137	1604	1308	1214	2253
65°	1703	1303	859	691	676	1688
75°	908	562	395	360	356	960
85°	212	108	94	94	94	243
90°	2	30	50	63	68	20
95°	164	81	99	112	109	195
105°	770	846	155	182	192	822
115°	1456	1499	1562	390	208	1433
125°	2058	2091	2140	2157	2165	1836
135°	2547	2588	2610	2636	2631	1968
145°	2955	2952	2995	3013	3000	1848
155°	3254	3231	3261	3276	3256	1499
165°	3428	3413	3421	3438	3421	969
175°	3506	3489	3494	3512	3486	334
180°	3499	3499	3499	3499	3499	

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5453.7	5453.7	5453.7	5453.7	5453.7
2.5°	5478.3	5453.7	5399.3	5449.0	5439.0
5°	5453.7	5429.1	5364.7	5409.3	5394.5
7.5°	5409.3	5379.8	5310.8	5330.2	5305.6
10°	5350.1	5315.5	5217.1	5201.8	5172.5
12.5°	5276.2	5231.7	5098.1	5068.8	5014.4
15°	5187.2	5132.7	4965.1	4871.4	4822.2
17.5°	5083.5	5004.4	4797.1	4688.7	4609.6
20°	4965.1	4866.2	4619.6	4496.5	4387.6
22.5°	4836.8	4723.3	4436.8	4269.2	4195.4
25°	4708.6	4550.4	4224.8	4022.6	3948.2
27.5°	4555.7	4387.6	4027.3	3795.3	3681.8
30°	4392.8	4204.9	3810.0	3558.7	3425.1
32.5°	4234.7	4007.4	3603.2	3306.8	3183.2
35°	4057.2	3805.3	3371.2	3060.2	2951.2
37.5°	3884.4	3612.6	3153.8	2813.0	2689.9
40°	3701.6	3405.8	2926.6	2576.3	2448.1
42.5°	3514.2	3198.4	2699.9	2334.4	2211.3
45°	3316.7	2985.8	2468.0	2117.0	1998.8
47.5°	3129.2	2779.0	2245.9	1895.1	1786.7
50°	2921.9	2571.6	2028.5	1687.7	1584.5
52.5°	2719.2	2349.0	1821.2	1495.5	1401.7
55°	2521.9	2136.9	1603.9	1308.1	1214.3
57.5°	2319.7	1924.9	1411.7	1135.3	1056.2
60°	2112.3	1717.5	1209.1	957.7	878.6
62.5°	1910.3	1515.4	1036.3	799.6	760.3
65°	1702.9	1302.8	858.8	691.2	676.0
67.5°	1505.4	1105.4	691.2	606.9	592.2
70°	1298.1	913.2	572.3	523.1	503.2
72.5°	1100.7	735.2	478.6	439.3	429.4
75°	908.0	562.4	394.8	360.2	355.5
77.5°	715.9	399.5	311.0	291.2	281.2
80°	537.8	286.4	236.7	217.4	217.4
82.5°	374.9	192.7	162.9	152.9	152.9
85°	212.1	108.4	93.7	93.7	93.7
87.5°	79.1	39.3	39.3	34.6	34.6
90°	2.5	30.3	50.5	63.4	68.2
92.5°	63.4	53.3	60.7	65.9	68.2
95°	164.5	80.9	98.6	111.5	108.9
97.5°	296.1	88.7	128.9	136.8	139.2
100°	448.3	101.3	144.3	164.5	169.6
102.5°	615.1	610.3	149.4	177.1	184.9
105°	769.7	845.7	154.6	182.2	192.5
107.5°	949.5	1012.6	159.7	187.3	197.6
110°	1121.7	1174.7	443.2	190.0	199.9

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1283.8	1329.2	1286.2	194.8	202.6
115°	1455.8	1498.7	1562.3	389.9	207.7
117.5°	1605.2	1655.8	1699.0	1336.7	673.4
120°	1772.4	1810.2	1856.0	1886.3	1544.4
122.5°	1914.0	1954.5	2005.4	2020.4	2023.2
125°	2058.3	2091.4	2139.5	2157.2	2164.7
127.5°	2190.0	2225.4	2263.6	2288.9	2291.3
130°	2314.1	2354.8	2382.4	2410.4	2408.0
132.5°	2440.7	2473.8	2501.5	2524.3	2522.0
135°	2547.2	2587.7	2610.3	2635.9	2630.7
137.5°	2658.4	2688.8	2714.3	2739.6	2732.1
140°	2767.3	2787.7	2815.4	2838.2	2825.6
142.5°	2858.6	2876.4	2909.2	2929.3	2916.7
145°	2954.9	2952.1	2995.1	3012.9	3000.3
147.5°	3038.2	3030.7	3073.6	3086.3	3076.4
150°	3119.3	3101.6	3142.2	3157.2	3144.6
152.5°	3187.6	3167.4	3205.3	3220.7	3202.9
155°	3253.5	3230.8	3261.2	3276.3	3256.1
157.5°	3306.6	3286.5	3309.4	3327.1	3306.6
160°	3352.3	3337.0	3352.3	3367.3	3349.6
162.5°	3392.6	3377.6	3390.2	3408.0	3385.1
165°	3428.1	3413.0	3420.6	3438.3	3420.6
167.5°	3456.0	3440.8	3448.6	3466.3	3443.5
170°	3478.9	3463.6	3468.6	3486.5	3463.6
172.5°	3493.9	3478.9	3484.0	3501.7	3478.9
175°	3506.5	3488.8	3493.9	3511.7	3486.5
177.5°	3511.7	3493.9	3496.6	3514.4	3491.6
180°	3499.1	3499.1	3499.1	3499.1	3499.1

TEST NUMBER: P904211

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.03	12.88	12.97	13.83	15.08	7.99	8.84	8.94	9.80	11.04
	3H	13.71	14.47	14.67	15.44	16.70	9.18	9.94	10.14	10.91	12.17
	4H	14.33	15.04	15.30	16.01	17.29	9.63	10.35	10.60	11.32	12.59
	6H	14.75	15.41	15.73	16.39	17.67	9.96	10.62	10.94	11.59	12.88
	8H	14.88	15.51	15.87	16.50	17.78	10.05	10.68	11.03	11.67	12.95
	12H	14.95	15.54	15.94	16.53	17.84	10.09	10.69	11.08	11.67	12.98
4H	2H	12.05	12.77	13.03	13.74	15.01	8.59	9.31	9.57	10.28	11.55
	3H	13.89	14.48	14.87	15.48	16.77	9.94	10.54	10.93	11.54	12.83
	4H	14.58	15.13	15.58	16.12	17.43	10.49	11.04	11.49	12.03	13.34
	6H	15.10	15.57	16.11	16.59	17.90	10.91	11.38	11.92	12.40	13.71
	8H	15.28	15.72	16.29	16.73	18.05	11.04	11.48	12.05	12.49	13.81
	12H	15.38	15.77	16.40	16.80	18.13	11.11	11.50	12.14	12.53	13.86
8H	4H	14.55	14.99	15.56	16.00	17.32	10.78	11.21	11.78	12.22	13.55
	6H	15.12	15.48	16.15	16.53	17.86	11.30	11.66	12.33	12.71	14.03
	8H	15.34	15.66	16.38	16.70	18.04	11.49	11.81	12.53	12.84	14.18
	12H	15.49	15.76	16.53	16.80	18.18	11.61	11.89	12.65	12.92	14.31
12H	4H	14.50	14.90	15.53	15.92	17.25	10.78	11.18	11.81	12.20	13.53
	6H	15.10	15.42	16.14	16.45	17.79	11.35	11.67	12.39	12.70	14.04
	8H	15.32	15.60	16.37	16.63	18.02	11.56	11.84	12.60	12.87	14.26

END OF REPORT