

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904222

Luminaire Tested: DFN2DIP-SQ4F0-140D160US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904222
REPORT IS A COMBINATION OF REPORTS P900218 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D160US830-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 24563.6 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 265.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLLFLL

Luminous Intensity Polar Plot

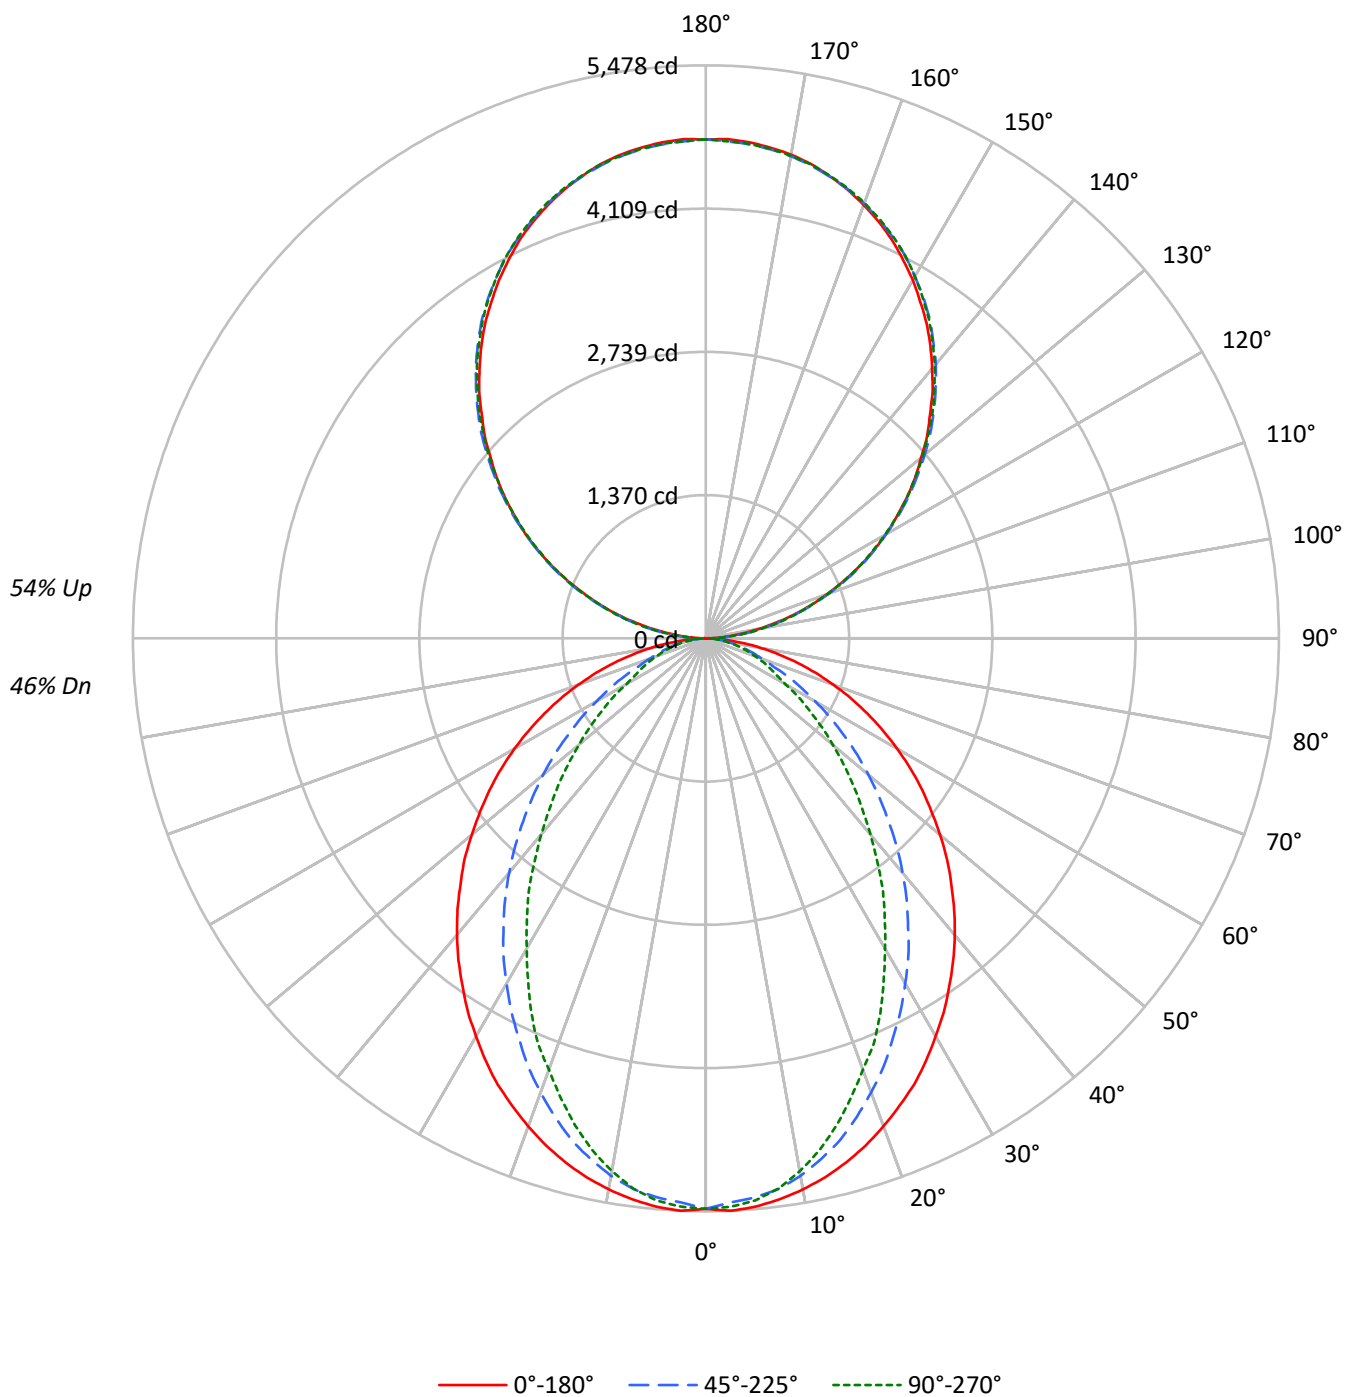

TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	86	82	80	72	69	67	59	57	56	47	46	45
2	89	82	76	71	81	75	70	66	63	60	56	52	49	47	42	40	38
3	81	72	65	60	74	67	61	56	56	52	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	57	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	37	32	37	32	28	31	27	24	26	23	20
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3827	3827	3827
5°	3833	3767	3791
10°	3795	3694	3669
15°	3743	3572	3479
20°	3673	3405	3246
25°	3603	3217	3021
30°	3507	3024	2735
35°	3414	2817	2484
40°	3319	2602	2195
45°	3209	2364	1934
50°	3095	2123	1679
55°	2977	1866	1433
60°	2839	1597	1181
65°	2681	1323	1064
70°	2489	1068	965
75°	2247	943	880
80°	1898	794	767
85°	1322	534	584

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3754 cd/sqm

TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	511.1	2.1
10°-20°	1403.2	5.7
20°-30°	1970.0	8.0
30°-40°	2147.4	8.7
40°-50°	1973.7	8.0
50°-60°	1550.0	6.3
60°-70°	1008.9	4.1
70°-80°	519.3	2.1
80°-90°	146.1	0.6
90°-100°	295.1	1.2
100°-110°	937.8	3.8
110°-120°	1604.9	6.5
120°-130°	2110.7	8.6
130°-140°	2369.1	9.6
140°-150°	2323.2	9.5
150°-160°	1948.8	7.9
160°-170°	1292.4	5.3
170°-180°	451.7	1.8
0°-30°	3884.3	15.8
0°-40°	6031.7	24.6
0°-60°	9555.4	38.9
0°-90°	11229.8	45.7
90°-120°	2837.8	11.6
90°-150°	9640.8	39.2
90°-180°	13334.0	54.3
0°-180°	24563.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5454	5454	5454	5454	5454	
5°	5454	5429	5365	5409	5394	517
15°	5187	5133	4965	4871	4822	1462
25°	4709	4550	4225	4023	3948	2165
35°	4057	3805	3371	3060	2951	2539
45°	3317	2986	2468	2117	1999	2561
55°	2522	2137	1604	1308	1214	2253
65°	1703	1303	859	691	676	1688
75°	908	562	395	360	356	960
85°	212	108	94	94	94	243
90°	4	52	141	132	137	24
95°	210	250	257	257	250	234
105°	866	877	886	893	893	914
115°	1610	1634	1626	1622	1610	1593
125°	2342	2378	2367	2354	2350	2093
135°	3030	3074	3083	3079	3067	2342
145°	3678	3707	3730	3734	3719	2298
155°	4206	4218	4230	4251	4238	1936
165°	4576	4571	4571	4600	4580	1291
175°	4761	4750	4741	4770	4745	452
180°	4770	4770	4770	4770	4770	

TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5453.7	5453.7	5453.7	5453.7	5453.7
2.5°	5478.3	5453.7	5399.3	5449.0	5439.0
5°	5453.7	5429.1	5364.7	5409.3	5394.5
7.5°	5409.3	5379.8	5310.8	5330.2	5305.6
10°	5350.1	5315.5	5217.1	5201.8	5172.5
12.5°	5276.2	5231.7	5098.1	5068.8	5014.4
15°	5187.2	5132.7	4965.1	4871.4	4822.2
17.5°	5083.5	5004.4	4797.1	4688.7	4609.6
20°	4965.1	4866.2	4619.6	4496.5	4387.6
22.5°	4836.8	4723.3	4436.8	4269.2	4195.4
25°	4708.6	4550.4	4224.8	4022.6	3948.2
27.5°	4555.7	4387.6	4027.3	3795.3	3681.8
30°	4392.8	4204.9	3810.0	3558.7	3425.1
32.5°	4234.7	4007.4	3603.2	3306.8	3183.2
35°	4057.2	3805.3	3371.2	3060.2	2951.2
37.5°	3884.4	3612.6	3153.8	2813.0	2689.9
40°	3701.6	3405.8	2926.6	2576.3	2448.1
42.5°	3514.2	3198.4	2699.9	2334.4	2211.3
45°	3316.7	2985.8	2468.0	2117.0	1998.8
47.5°	3129.2	2779.0	2245.9	1895.1	1786.7
50°	2921.9	2571.6	2028.5	1687.7	1584.5
52.5°	2719.2	2349.0	1821.2	1495.5	1401.7
55°	2521.9	2136.9	1603.9	1308.1	1214.3
57.5°	2319.7	1924.9	1411.7	1135.3	1056.2
60°	2112.3	1717.5	1209.1	957.7	878.6
62.5°	1910.3	1515.4	1036.3	799.6	760.3
65°	1702.9	1302.8	858.8	691.2	676.0
67.5°	1505.4	1105.4	691.2	606.9	592.2
70°	1298.1	913.2	572.3	523.1	503.2
72.5°	1100.7	735.2	478.6	439.3	429.4
75°	908.0	562.4	394.8	360.2	355.5
77.5°	715.9	399.5	311.0	291.2	281.2
80°	537.8	286.4	236.7	217.4	217.4
82.5°	374.9	192.7	162.9	152.9	152.9
85°	212.1	108.4	93.7	93.7	93.7
87.5°	79.1	39.3	39.3	34.6	34.6
90°	4.3	51.7	140.9	132.3	136.6
92.5°	89.2	120.8	125.1	129.4	129.4
95°	209.9	250.2	257.4	257.4	250.2
97.5°	349.4	386.8	402.7	402.7	402.7
100°	510.5	543.6	555.1	555.1	550.7
102.5°	680.1	704.6	720.4	724.7	720.4
105°	865.6	877.1	885.8	893.0	893.0
107.5°	1049.7	1067.0	1067.0	1069.9	1049.7
110°	1228.0	1251.0	1251.0	1251.0	1239.5



TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1420.7	1445.2	1440.9	1429.4	1420.7
115°	1610.5	1633.5	1626.4	1622.0	1610.5
117.5°	1798.9	1830.5	1810.4	1798.9	1787.4
120°	1988.8	2020.3	1988.8	1988.8	1975.8
122.5°	2161.2	2201.6	2181.4	2169.9	2161.2
125°	2342.5	2378.4	2366.9	2354.0	2349.7
127.5°	2519.3	2563.9	2548.1	2530.8	2519.3
130°	2684.7	2736.5	2729.3	2720.6	2704.8
132.5°	2870.2	2910.5	2913.3	2893.2	2881.7
135°	3029.8	3074.4	3083.1	3078.7	3067.2
137.5°	3208.1	3244.0	3251.3	3248.4	3231.1
140°	3364.9	3400.8	3421.0	3421.0	3405.1
142.5°	3526.0	3561.9	3573.4	3577.7	3561.9
145°	3678.4	3707.1	3730.1	3734.4	3718.6
147.5°	3814.9	3850.9	3868.2	3875.4	3859.5
150°	3955.8	3980.4	3996.2	4009.1	3996.2
152.5°	4081.0	4105.4	4125.6	4141.3	4125.6
155°	4206.1	4217.6	4230.5	4250.7	4237.8
157.5°	4313.9	4322.6	4329.8	4358.5	4338.4
160°	4410.2	4418.9	4423.3	4447.7	4430.4
162.5°	4499.4	4499.4	4503.7	4531.1	4510.9
165°	4575.7	4571.3	4571.3	4600.1	4580.0
167.5°	4644.7	4631.7	4631.7	4660.5	4640.3
170°	4696.4	4684.9	4680.7	4709.4	4684.9
172.5°	4732.4	4720.9	4716.6	4745.3	4720.9
175°	4761.2	4749.7	4741.0	4769.8	4745.3
177.5°	4777.0	4765.5	4756.8	4781.3	4756.8
180°	4769.8	4769.8	4769.8	4769.8	4769.8

TEST NUMBER: P904222

CATALOG NUMBER: DFN2DIP-SQ4F0-140D160US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.41	12.20	12.41	13.21	14.54	7.37	8.16	8.37	9.17	10.50
	3H	13.09	13.80	14.10	14.81	16.17	8.55	9.27	9.56	10.28	11.64
	4H	13.70	14.37	14.72	15.39	16.75	9.00	9.68	10.03	10.70	12.06
	6H	14.12	14.74	15.15	15.76	17.14	9.32	9.94	10.36	10.97	12.34
	8H	14.25	14.84	15.29	15.88	17.25	9.41	10.00	10.45	11.04	12.41
	12H	14.31	14.87	15.35	15.90	17.30	9.46	10.02	10.50	11.05	12.44
4H	2H	11.42	12.09	12.45	13.11	14.48	7.96	8.63	8.99	9.65	11.02
	3H	13.25	13.81	14.29	14.86	16.23	9.31	9.87	10.35	10.92	12.29
	4H	13.95	14.46	14.99	15.50	16.89	9.86	10.37	10.90	11.41	12.81
	6H	14.46	14.90	15.52	15.96	17.36	10.27	10.71	11.33	11.78	13.17
	8H	14.64	15.05	15.69	16.11	17.51	10.40	10.81	11.46	11.87	13.28
	12H	14.74	15.11	15.81	16.18	17.59	10.47	10.84	11.54	11.91	13.32
8H	4H	13.91	14.32	14.97	15.38	16.78	10.14	10.55	11.19	11.60	13.01
	6H	14.48	14.82	15.56	15.92	17.32	10.66	10.99	11.73	12.09	13.50
	8H	14.70	15.00	15.78	16.08	17.50	10.85	11.14	11.93	12.22	13.65
	12H	14.84	15.10	15.93	16.18	17.64	10.97	11.23	12.05	12.30	13.77
12H	4H	13.86	14.23	14.93	15.30	16.71	10.14	10.51	11.21	11.58	12.99
	6H	14.46	14.75	15.54	15.83	17.26	10.71	11.00	11.79	12.08	13.51
	8H	14.68	14.94	15.77	16.02	17.48	10.92	11.18	12.00	12.25	13.72

END OF REPORT