

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904241

Luminaire Tested: DFN2DIP-SQ4F0-160D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904241
REPORT IS A COMBINATION OF REPORTS P901667 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D100US830-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 24261.0 lumens
Efficiency: N/A
Efficacy: 100.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 241.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLLONL

Luminous Intensity Polar Plot

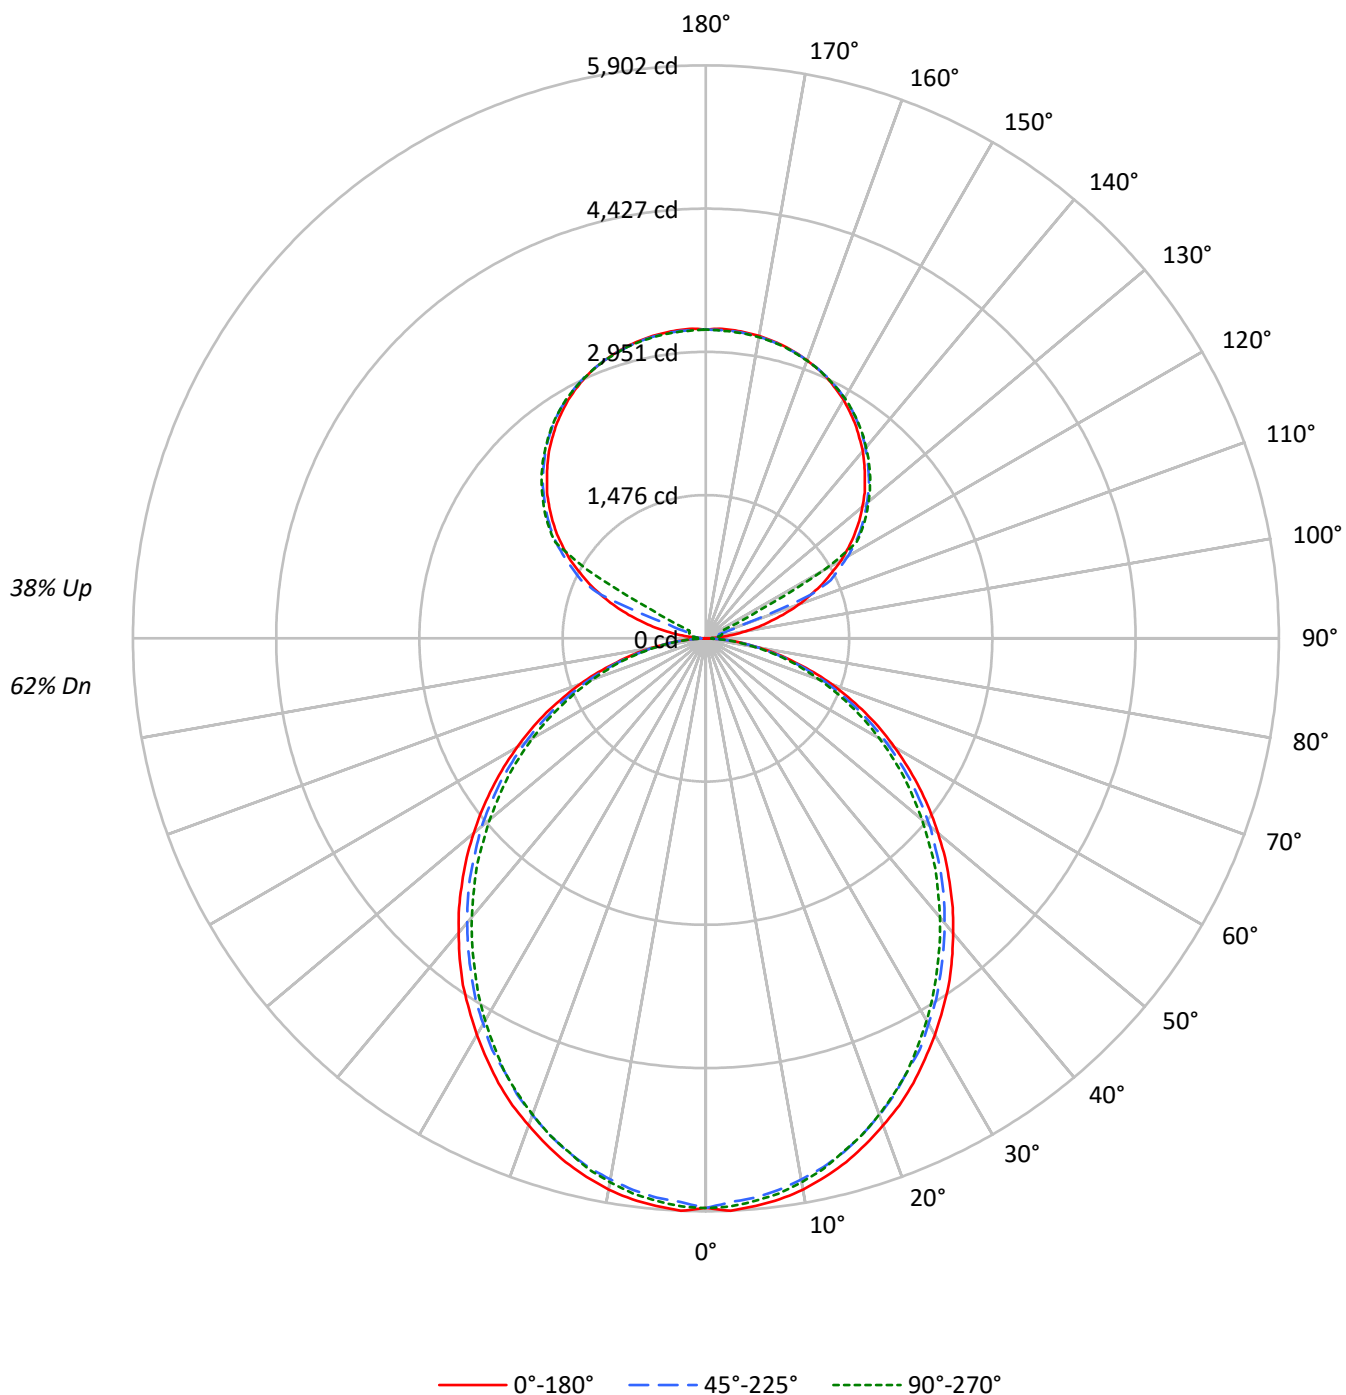

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	100	96	92	88	94	90	87	83	79	76	74	69	67	65	59	58	56
2	91	84	78	72	85	79	73	69	69	65	61	60	57	54	52	50	48
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	49	43	38	43	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	37	32	40	34	29	35	30	27	31	27	24
8	56	43	35	30	52	41	34	29	36	30	26	32	27	24	28	24	21
9	52	39	32	27	49	37	30	26	33	28	23	30	25	21	26	22	19
10	49	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4117	4117	4117
5°	4124	4061	4089
10°	4090	4007	4034
15°	4030	3942	3949
20°	3949	3851	3862
25°	3868	3742	3760
30°	3767	3641	3631
35°	3671	3521	3495
40°	3552	3401	3365
45°	3434	3280	3232
50°	3305	3153	3078
55°	3171	3007	2937
60°	3018	2832	2776
65°	2852	2652	2585
70°	2640	2432	2380
75°	2346	2170	2193
80°	1993	1835	1832
85°	1440	1255	1231

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3434 cd/sqm

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	552.3	2.3
10°-20°	1553.9	6.4
20°-30°	2283.7	9.4
30°-40°	2652.4	10.9
40°-50°	2649.1	10.9
50°-60°	2309.9	9.5
60°-70°	1707.5	7.0
70°-80°	966.1	4.0
80°-90°	260.6	1.1
90°-100°	104.9	0.4
100°-110°	391.0	1.6
110°-120°	1037.0	4.3
120°-130°	1720.0	7.1
130°-140°	1827.0	7.5
140°-150°	1698.0	7.0
150°-160°	1365.2	5.6
160°-170°	879.7	3.6
170°-180°	302.8	1.2
0°-30°	4389.9	18.1
0°-40°	7042.3	29.0
0°-60°	12001.3	49.5
0°-90°	14935.4	61.6
90°-120°	1532.9	6.3
90°-150°	6778.0	27.9
90°-180°	9326.0	38.4
0°-180°	24261.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5868	5868	5868	5868	5868	
5°	5868	5846	5784	5828	5818	557
15°	5586	5552	5479	5502	5473	1573
25°	5056	5011	4915	4926	4915	2326
35°	4362	4306	4215	4181	4153	2724
45°	3549	3510	3425	3363	3340	2739
55°	2686	2652	2584	2517	2489	2402
65°	1812	1777	1721	1670	1642	1791
75°	948	937	908	875	886	1012
85°	231	226	220	203	198	258
90°	2	28	46	58	62	22
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5868.0	5868.0	5868.0	5868.0	5868.0
2.5°	5902.1	5873.9	5811.7	5868.0	5857.1
5°	5868.0	5845.8	5783.5	5828.5	5817.7
7.5°	5828.5	5794.9	5732.6	5778.2	5766.8
10°	5766.8	5727.3	5659.7	5704.5	5687.8
12.5°	5681.8	5648.3	5580.6	5608.8	5597.4
15°	5586.0	5552.5	5478.8	5501.6	5473.4
17.5°	5467.5	5433.9	5360.3	5388.4	5360.3
20°	5337.5	5304.1	5225.0	5241.8	5219.6
22.5°	5208.3	5157.4	5083.7	5083.7	5072.4
25°	5055.6	5010.7	4914.9	4925.7	4914.9
27.5°	4886.1	4846.6	4773.6	4756.9	4728.7
30°	4717.3	4671.9	4587.4	4570.7	4548.0
32.5°	4536.6	4503.1	4412.6	4378.5	4355.8
35°	4361.8	4305.5	4215.0	4180.9	4152.8
37.5°	4164.2	4113.3	4023.0	3983.4	3955.3
40°	3961.2	3915.8	3825.4	3775.1	3752.4
42.5°	3763.8	3718.2	3628.4	3571.6	3538.0
45°	3549.4	3509.8	3424.9	3363.2	3340.5
47.5°	3340.5	3301.0	3210.6	3148.3	3114.8
50°	3120.2	3092.0	3013.0	2933.9	2905.9
52.5°	2905.9	2866.4	2793.3	2731.0	2691.5
55°	2686.2	2652.0	2584.4	2516.7	2488.6
57.5°	2465.9	2437.7	2364.1	2296.4	2273.7
60°	2245.5	2223.4	2144.4	2082.1	2065.3
62.5°	2031.2	1991.7	1935.4	1879.1	1856.4
65°	1811.5	1777.4	1721.1	1670.3	1642.1
67.5°	1585.8	1557.1	1506.8	1467.3	1444.5
70°	1376.9	1354.2	1303.3	1263.8	1241.6
72.5°	1162.5	1139.8	1111.7	1072.1	1055.5
75°	947.6	936.9	908.1	874.6	886.0
77.5°	756.1	733.4	722.0	705.2	688.4
80°	564.5	558.6	547.1	530.4	519.1
82.5°	383.7	383.7	378.3	355.6	355.6
85°	231.1	225.6	220.3	202.9	197.6
87.5°	101.8	90.4	79.0	62.3	56.3
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904241

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.20	14.18	14.06	15.05	16.15	12.76	13.74	13.61	14.61	15.71
	3H	14.88	15.75	15.74	16.64	17.76	14.39	15.26	15.25	16.15	17.27
	4H	15.47	16.30	16.35	17.19	18.32	14.98	15.81	15.86	16.70	17.83
	6H	15.88	16.65	16.77	17.54	18.69	15.38	16.15	16.27	17.04	18.19
	8H	15.99	16.72	16.89	17.63	18.78	15.49	16.22	16.39	17.13	18.28
	12H	16.05	16.74	16.95	17.65	18.82	15.54	16.23	16.44	17.14	18.31
4H	2H	13.68	14.51	14.56	15.40	16.53	13.33	14.15	14.21	15.04	16.17
	3H	15.56	16.25	16.46	17.17	18.32	15.15	15.84	16.05	16.77	17.91
	4H	16.28	16.91	17.19	17.83	19.00	15.86	16.49	16.77	17.41	18.58
	6H	16.81	17.35	17.73	18.29	19.47	16.38	16.92	17.30	17.86	19.04
	8H	16.96	17.47	17.89	18.41	19.60	16.53	17.04	17.45	17.97	19.16
	12H	17.04	17.50	17.99	18.46	19.65	16.60	17.05	17.54	18.01	19.20
8H	4H	16.49	17.00	17.41	17.93	19.12	16.11	16.62	17.04	17.56	18.75
	6H	17.13	17.55	18.08	18.53	19.72	16.75	17.17	17.70	18.14	19.33
	8H	17.36	17.73	18.32	18.69	19.90	16.96	17.34	17.92	18.30	19.51
	12H	17.50	17.82	18.46	18.78	20.04	17.08	17.41	18.05	18.37	19.63
12H	4H	16.48	16.94	17.42	17.89	19.09	16.11	16.57	17.06	17.52	18.72
	6H	17.16	17.53	18.12	18.50	19.71	16.79	17.16	17.75	18.13	19.34
	8H	17.41	17.74	18.38	18.70	19.95	17.03	17.36	18.00	18.32	19.57