

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906666

Luminaire Tested: DFN2DIP-SQ4F0-060D060US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906666
REPORT IS A COMBINATION OF REPORTS P900060 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D060US835-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10410.0 lumens
Efficiency: N/A
Efficacy: 109.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

Luminous Intensity Polar Plot

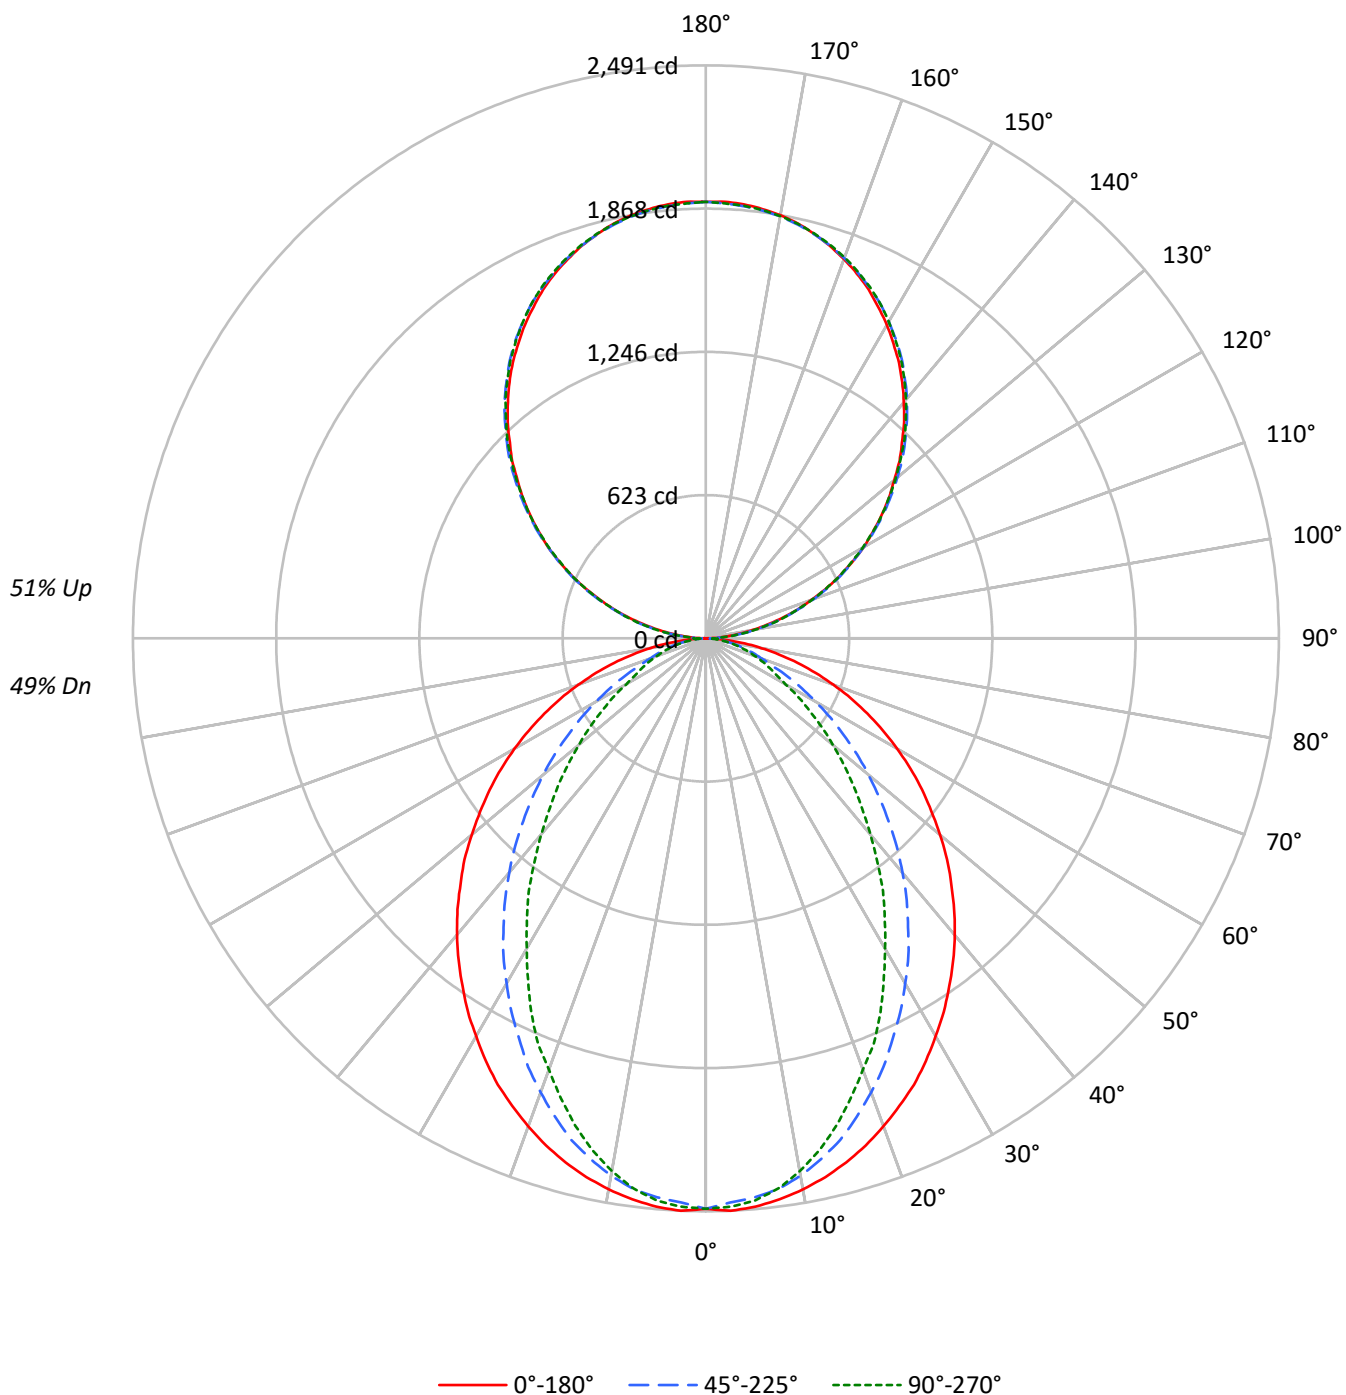

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1740	1740	1740
5°	1743	1713	1724
10°	1725	1680	1668
15°	1702	1624	1582
20°	1670	1548	1476
25°	1638	1463	1374
30°	1595	1375	1244
35°	1552	1281	1129
40°	1509	1183	998
45°	1459	1075	879
50°	1407	965	763
55°	1353	848	652
60°	1291	726	537
65°	1219	602	484
70°	1131	486	439
75°	1022	429	400
80°	863	361	349
85°	601	243	265

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1492 cd/sqm

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	2.2
10°-20°	638.0	6.1
20°-30°	895.7	8.6
30°-40°	976.4	9.4
40°-50°	897.4	8.6
50°-60°	704.8	6.8
60°-70°	458.8	4.4
70°-80°	236.1	2.3
80°-90°	65.7	0.6
90°-100°	117.4	1.1
100°-110°	373.1	3.6
110°-120°	638.5	6.1
120°-130°	839.7	8.1
130°-140°	942.5	9.1
140°-150°	924.2	8.9
150°-160°	775.3	7.4
160°-170°	514.2	4.9
170°-180°	179.7	1.7
0°-30°	1766.2	17.0
0°-40°	2742.6	26.3
0°-60°	4344.8	41.7
0°-90°	5105.4	49.0
90°-120°	1129.0	10.8
90°-150°	3835.4	36.8
90°-180°	5305.0	51.0
0°-180°	10410.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	2	21	56	53	54	10
95°	84	100	102	102	100	93
105°	344	349	352	355	355	363
115°	641	650	647	645	641	634
125°	932	946	942	936	935	833
135°	1205	1223	1226	1225	1220	932
145°	1463	1475	1484	1486	1479	914
155°	1673	1678	1683	1691	1686	770
165°	1820	1819	1819	1830	1822	514
175°	1894	1890	1886	1898	1888	180
180°	1898	1898	1898	1898	1898	

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	1.7	20.6	56.1	52.6	54.3
92.5°	35.5	48.1	49.8	51.5	51.5
95°	83.5	99.5	102.4	102.4	99.5
97.5°	139.0	153.9	160.2	160.2	160.2
100°	203.1	216.2	220.8	220.8	219.1
102.5°	270.6	280.3	286.6	288.3	286.6
105°	344.4	349.0	352.4	355.3	355.3
107.5°	417.6	424.5	424.5	425.6	417.6
110°	488.6	497.7	497.7	497.7	493.1

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	565.2	574.9	573.2	568.6	565.2
115°	640.7	649.9	647.0	645.3	640.7
117.5°	715.7	728.3	720.2	715.7	711.1
120°	791.2	803.8	791.2	791.2	786.0
122.5°	859.8	875.8	867.8	863.3	859.8
125°	931.9	946.2	941.6	936.5	934.8
127.5°	1002.3	1020.0	1013.7	1006.9	1002.3
130°	1068.1	1088.7	1085.8	1082.4	1076.1
132.5°	1141.9	1157.9	1159.0	1151.0	1146.4
135°	1205.4	1223.1	1226.5	1224.8	1220.2
137.5°	1276.3	1290.6	1293.5	1292.3	1285.5
140°	1338.7	1353.0	1361.0	1361.0	1354.7
142.5°	1402.7	1417.0	1421.6	1423.3	1417.0
145°	1463.4	1474.8	1484.0	1485.7	1479.4
147.5°	1517.7	1532.0	1538.9	1541.7	1535.4
150°	1573.8	1583.5	1589.8	1594.9	1589.8
152.5°	1623.5	1633.3	1641.3	1647.6	1641.3
155°	1673.3	1677.9	1683.0	1691.1	1685.9
157.5°	1716.2	1719.7	1722.5	1734.0	1726.0
160°	1754.6	1758.0	1759.7	1769.4	1762.6
162.5°	1790.0	1790.0	1791.7	1802.6	1794.6
165°	1820.3	1818.6	1818.6	1830.1	1822.1
167.5°	1847.8	1842.7	1842.7	1854.1	1846.1
170°	1868.4	1863.8	1862.1	1873.5	1863.8
172.5°	1882.7	1878.1	1876.4	1887.8	1878.1
175°	1894.1	1889.6	1886.1	1897.6	1887.8
177.5°	1900.4	1895.9	1892.4	1902.1	1892.4
180°	1897.6	1897.6	1897.6	1897.6	1897.6

TEST NUMBER: P906666

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US835-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.99	9.81	9.96	10.80	12.08	4.95	5.78	5.92	6.76	8.04
	3H	10.67	11.41	11.66	12.40	13.71	6.14	6.88	7.12	7.87	9.18
	4H	11.28	11.98	12.28	12.97	14.29	6.59	7.29	7.59	8.28	9.60
	6H	11.71	12.35	12.72	13.35	14.68	6.91	7.55	7.92	8.55	9.88
	8H	11.84	12.45	12.85	13.46	14.79	7.00	7.61	8.02	8.63	9.95
	12H	11.90	12.48	12.92	13.49	14.84	7.05	7.63	8.07	8.64	9.99
4H	2H	9.01	9.70	10.01	10.70	12.02	5.55	6.25	6.55	7.24	8.56
	3H	10.84	11.42	11.85	12.44	13.77	6.90	7.48	7.91	8.50	9.83
	4H	11.54	12.07	12.56	13.08	14.44	7.45	7.98	8.47	8.99	10.35
	6H	12.06	12.51	13.09	13.55	14.90	7.87	8.32	8.90	9.36	10.71
	8H	12.23	12.66	13.26	13.69	15.06	8.00	8.42	9.03	9.45	10.82
	12H	12.33	12.71	13.38	13.76	15.13	8.06	8.44	9.11	9.49	10.86
8H	4H	11.51	11.93	12.54	12.96	14.33	7.73	8.15	8.76	9.19	10.55
	6H	12.08	12.43	13.13	13.50	14.86	8.25	8.60	9.30	9.67	11.04
	8H	12.30	12.60	13.36	13.66	15.04	8.44	8.75	9.50	9.81	11.19
	12H	12.44	12.71	13.50	13.76	15.19	8.56	8.83	9.63	9.89	11.31
12H	4H	11.46	11.84	12.51	12.89	14.26	7.74	8.12	8.78	9.17	10.54
	6H	12.05	12.36	13.11	13.42	14.80	8.30	8.61	9.36	9.67	11.05
	8H	12.27	12.54	13.34	13.60	15.02	8.51	8.78	9.58	9.84	11.26

END OF REPORT