

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906672

Luminaire Tested: DFN2DIP-SQ4F0-060D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906672
REPORT IS A COMBINATION OF REPORTS P900095 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D080US835-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 13020.0 lumens
Efficiency: N/A
Efficacy: 118.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906672
CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

Luminous Intensity Polar Plot

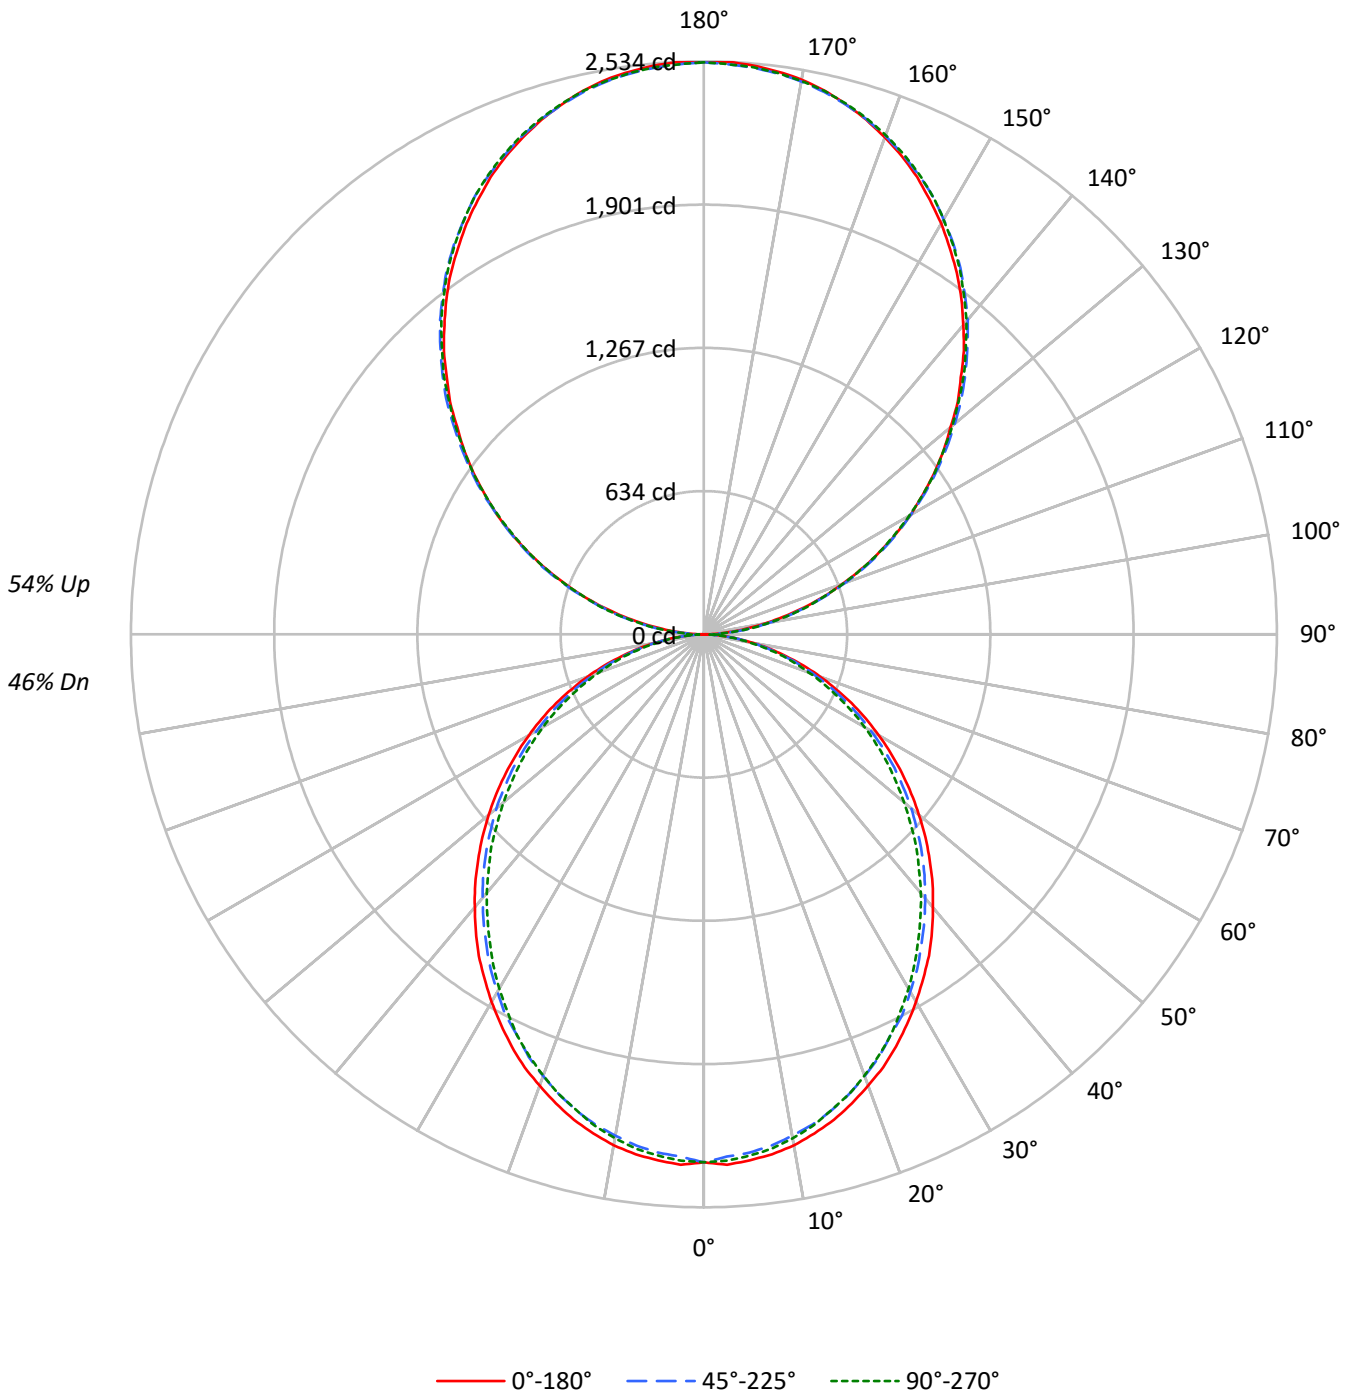



TEST NUMBER: P906672

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	46	46	46	46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1638	1638	1638
5°	1641	1616	1627
10°	1627	1594	1605
15°	1603	1568	1571
20°	1571	1532	1536
25°	1539	1489	1496
30°	1499	1449	1445
35°	1460	1401	1390
40°	1413	1353	1339
45°	1366	1305	1286
50°	1315	1255	1225
55°	1261	1196	1169
60°	1201	1127	1104
65°	1134	1055	1028
70°	1050	968	947
75°	933	863	873
80°	793	730	729
85°	573	499	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 1992 cd/sqm



TEST NUMBER: P906672

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.7
10°-20°	618.3	4.7
20°-30°	908.6	7.0
30°-40°	1055.3	8.1
40°-50°	1054.0	8.1
50°-60°	919.0	7.1
60°-70°	679.4	5.2
70°-80°	384.4	3.0
80°-90°	108.6	0.8
90°-100°	156.6	1.2
100°-110°	497.5	3.8
110°-120°	851.3	6.5
120°-130°	1119.6	8.6
130°-140°	1256.7	9.7
140°-150°	1232.3	9.5
150°-160°	1033.7	7.9
160°-170°	685.6	5.3
170°-180°	239.6	1.8
0°-30°	1746.6	13.4
0°-40°	2801.8	21.5
0°-60°	4774.8	36.7
0°-90°	5947.2	45.7
90°-120°	1505.3	11.6
90°-150°	5113.9	39.3
90°-180°	7073.0	54.3
0°-180°	13020.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	2	28	75	70	72	13
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	



TEST NUMBER: P906672

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5



TEST NUMBER: P906672

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1



TEST NUMBER: P906672
 CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.58	9.41	9.58	10.41	11.74	8.14	8.96	9.13	9.97	11.30
	3H	10.25	10.98	11.25	12.00	13.35	9.76	10.49	10.76	11.51	12.86
	4H	10.83	11.53	11.85	12.55	13.91	10.34	11.04	11.36	12.06	13.42
	6H	11.24	11.88	12.26	12.90	14.28	10.74	11.38	11.76	12.40	13.77
	8H	11.34	11.96	12.37	12.99	14.36	10.84	11.45	11.87	12.49	13.86
	12H	11.39	11.97	12.43	13.01	14.40	10.88	11.46	11.92	12.50	13.89
4H	2H	9.04	9.74	10.06	10.76	12.12	8.69	9.39	9.71	10.40	11.76
	3H	10.91	11.49	11.94	12.54	13.91	10.50	11.08	11.53	12.13	13.50
	4H	11.62	12.16	12.66	13.20	14.59	11.20	11.74	12.24	12.77	14.17
	6H	12.14	12.60	13.19	13.66	15.05	11.71	12.17	12.76	13.23	14.62
	8H	12.29	12.72	13.34	13.78	15.18	11.86	12.29	12.91	13.34	14.75
	12H	12.37	12.75	13.43	13.82	15.24	11.92	12.31	12.98	13.37	14.79
8H	4H	11.82	12.25	12.87	13.30	14.71	11.44	11.87	12.49	12.92	14.33
	6H	12.45	12.81	13.53	13.90	15.31	12.07	12.42	13.14	13.52	14.92
	8H	12.68	12.99	13.76	14.07	15.49	12.28	12.60	13.36	13.67	15.10
	12H	12.81	13.08	13.89	14.16	15.62	12.40	12.67	13.48	13.75	15.21
12H	4H	11.80	12.19	12.87	13.26	14.67	11.43	11.82	12.50	12.89	14.30
	6H	12.48	12.80	13.56	13.87	15.30	12.11	12.42	13.19	13.50	14.93
	8H	12.73	13.00	13.81	14.08	15.54	12.35	12.62	13.43	13.70	15.16