

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906676

Luminaire Tested: DFN2DIP-SQ4F0-060D090US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906676
REPORT IS A COMBINATION OF REPORTS P900113 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D090US835-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13905.0 lumens
Efficiency: N/A
Efficacy: 119.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 116.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFLL

Luminous Intensity Polar Plot

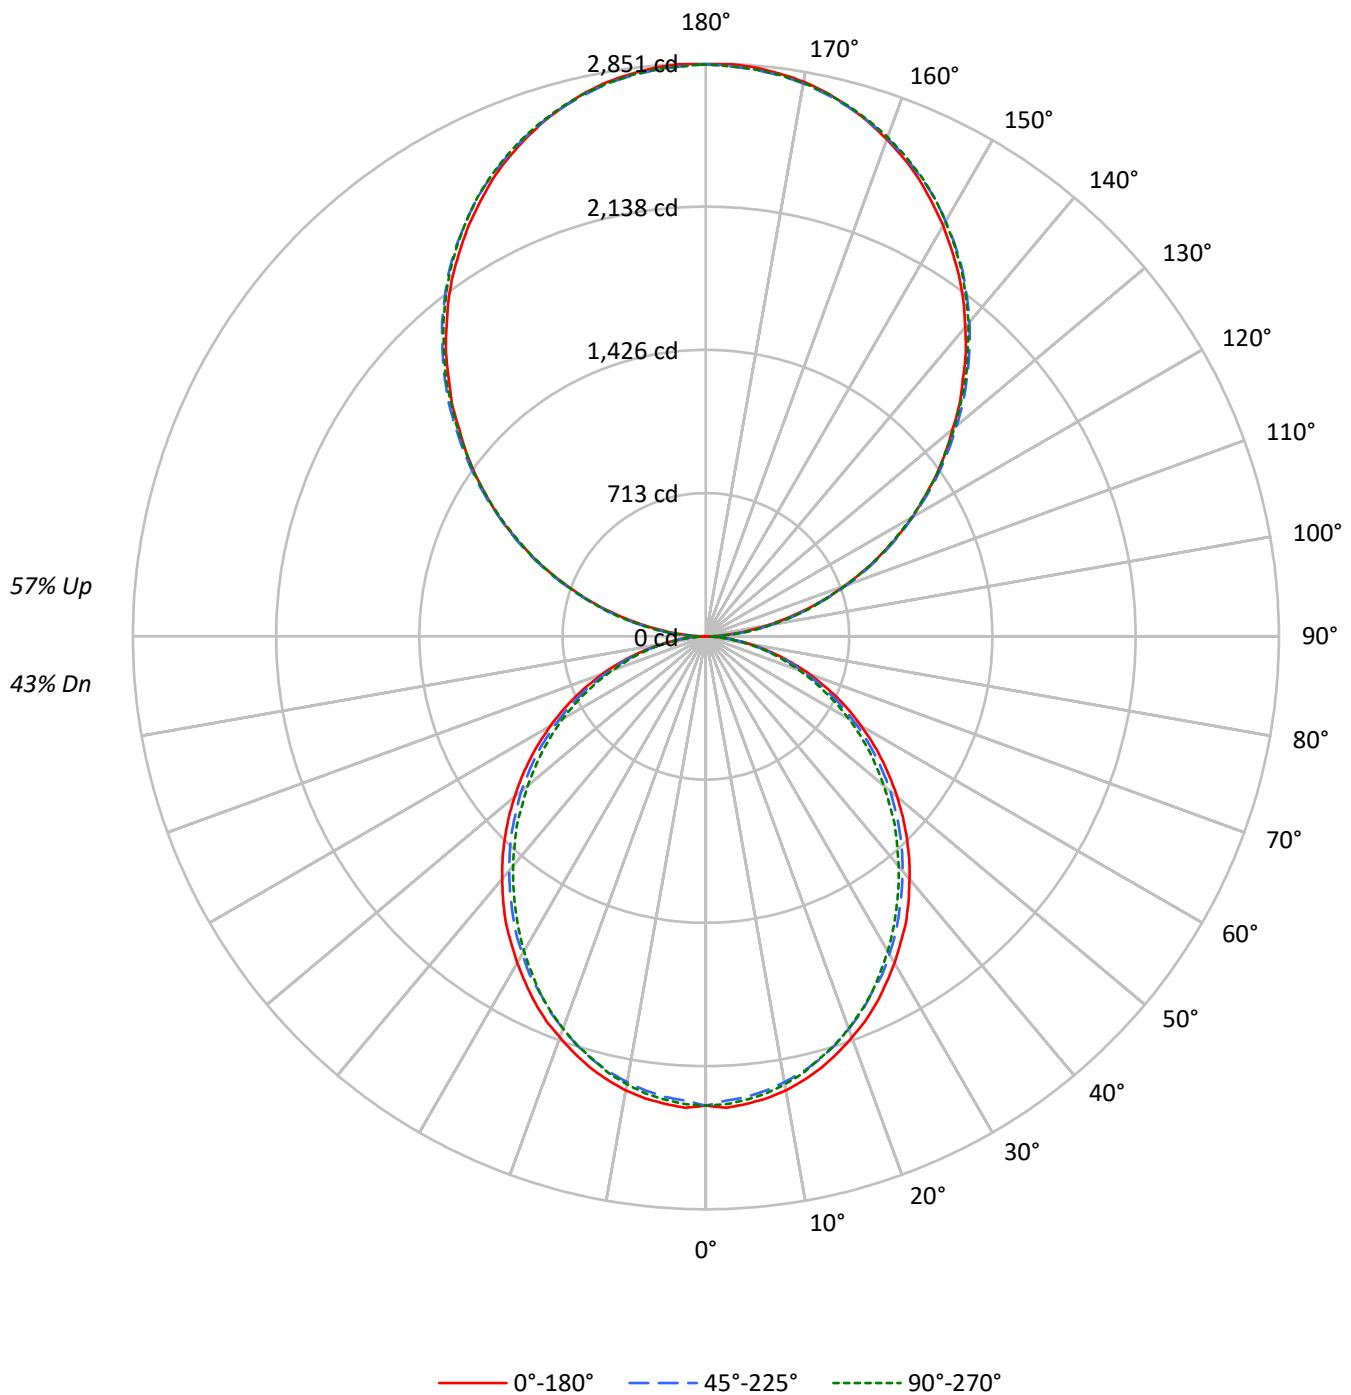

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1638	1638	1638
5°	1641	1616	1627
10°	1627	1594	1605
15°	1603	1568	1571
20°	1571	1532	1536
25°	1539	1489	1496
30°	1499	1449	1445
35°	1460	1401	1390
40°	1413	1353	1339
45°	1366	1305	1286
50°	1315	1255	1225
55°	1261	1196	1169
60°	1201	1127	1104
65°	1134	1055	1028
70°	1050	968	947
75°	933	863	873
80°	793	730	729
85°	573	499	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2240 cd/sqm

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.6
10°-20°	618.3	4.4
20°-30°	908.6	6.5
30°-40°	1055.3	7.6
40°-50°	1054.0	7.6
50°-60°	919.0	6.6
60°-70°	679.4	4.9
70°-80°	384.4	2.8
80°-90°	109.5	0.8
90°-100°	176.1	1.3
100°-110°	559.6	4.0
110°-120°	957.7	6.9
120°-130°	1259.5	9.1
130°-140°	1413.8	10.2
140°-150°	1386.4	10.0
150°-160°	1163.0	8.4
160°-170°	771.2	5.5
170°-180°	269.6	1.9
0°-30°	1746.6	12.6
0°-40°	2801.8	20.1
0°-60°	4774.8	34.3
0°-90°	5948.1	42.8
90°-120°	1693.5	12.2
90°-150°	5753.1	41.4
90°-180°	7957.0	57.2
0°-180°	13905.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	3	31	84	79	82	14
95°	125	149	154	154	149	139
105°	517	523	529	533	533	545
115°	961	975	970	968	961	951
125°	1398	1419	1412	1405	1402	1249
135°	1808	1835	1840	1837	1830	1398
145°	2195	2212	2226	2228	2219	1372
155°	2510	2517	2525	2537	2529	1155
165°	2730	2728	2728	2745	2733	770
175°	2841	2834	2829	2846	2832	270
180°	2846	2846	2846	2846	2846	

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	2.6	30.9	84.1	78.9	81.5
92.5°	53.2	72.1	74.7	77.2	77.2
95°	125.3	149.3	153.6	153.6	149.3
97.5°	208.5	230.8	240.3	240.3	240.3
100°	304.6	324.4	331.2	331.2	328.7
102.5°	405.9	420.5	429.9	432.5	429.9
105°	516.6	523.4	528.6	532.9	532.9
107.5°	626.4	636.7	636.7	638.4	626.4
110°	732.8	746.6	746.6	746.6	739.7

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	847.8	862.4	859.8	853.0	847.8
115°	961.1	974.8	970.5	968.0	961.1
117.5°	1073.5	1092.4	1080.4	1073.5	1066.6
120°	1186.8	1205.6	1186.8	1186.8	1179.0
122.5°	1289.7	1313.8	1301.8	1294.9	1289.7
125°	1397.9	1419.3	1412.5	1404.7	1402.2
127.5°	1503.4	1530.0	1520.6	1510.3	1503.4
130°	1602.1	1633.0	1628.7	1623.5	1614.1
132.5°	1712.8	1736.8	1738.5	1726.5	1719.7
135°	1808.0	1834.6	1839.8	1837.2	1830.4
137.5°	1914.4	1935.9	1940.2	1938.5	1928.2
140°	2008.0	2029.4	2041.4	2041.4	2032.0
142.5°	2104.1	2125.5	2132.4	2135.0	2125.5
145°	2195.1	2212.2	2225.9	2228.5	2219.1
147.5°	2276.6	2298.0	2308.3	2312.6	2303.2
150°	2360.7	2375.3	2384.7	2392.4	2384.7
152.5°	2435.3	2449.9	2461.9	2471.4	2461.9
155°	2510.0	2516.8	2524.6	2536.6	2528.9
157.5°	2574.3	2579.5	2583.8	2600.9	2588.9
160°	2631.8	2637.0	2639.6	2654.1	2643.8
162.5°	2685.0	2685.0	2687.6	2703.9	2691.9
165°	2730.5	2727.9	2727.9	2745.1	2733.1
167.5°	2771.7	2764.0	2764.0	2781.1	2769.1
170°	2802.6	2795.7	2793.2	2810.3	2795.7
172.5°	2824.0	2817.2	2814.6	2831.8	2817.2
175°	2841.2	2834.3	2829.2	2846.4	2831.8
177.5°	2850.6	2843.8	2838.6	2853.2	2838.6
180°	2846.4	2846.4	2846.4	2846.4	2846.4

TEST NUMBER: P906676

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.09	9.31	10.12	11.49	7.85	8.65	8.86	9.67	11.04
	3H	9.95	10.67	10.98	11.70	13.09	9.46	10.18	10.49	11.21	12.60
	4H	10.54	11.22	11.58	12.26	13.65	10.04	10.72	11.08	11.76	13.16
	6H	10.94	11.56	11.99	12.61	14.02	10.44	11.06	11.49	12.11	13.52
	8H	11.04	11.64	12.10	12.70	14.10	10.54	11.14	11.60	12.20	13.60
	12H	11.09	11.66	12.15	12.71	14.14	10.58	11.15	11.64	12.20	13.63
4H	2H	8.74	9.42	9.79	10.46	11.86	8.39	9.07	9.44	10.11	11.51
	3H	10.61	11.18	11.66	12.24	13.65	10.20	10.77	11.26	11.83	13.25
	4H	11.33	11.84	12.39	12.90	14.33	10.90	11.42	11.96	12.48	13.91
	6H	11.84	12.29	12.91	13.37	14.80	11.41	11.86	12.48	12.94	14.36
	8H	11.99	12.41	13.06	13.48	14.92	11.55	11.97	12.62	13.04	14.49
	12H	12.06	12.44	13.15	13.53	14.98	11.61	11.99	12.70	13.08	14.53
8H	4H	11.52	11.93	12.59	13.01	14.45	11.14	11.56	12.21	12.63	14.07
	6H	12.15	12.50	13.24	13.61	15.05	11.77	12.11	12.86	13.23	14.67
	8H	12.37	12.68	13.47	13.77	15.23	11.98	12.28	13.08	13.38	14.84
	12H	12.51	12.77	13.61	13.86	15.36	12.09	12.36	13.20	13.45	14.95
12H	4H	11.50	11.88	12.59	12.96	14.41	11.13	11.51	12.22	12.60	14.04
	6H	12.18	12.48	13.28	13.58	15.04	11.81	12.11	12.91	13.21	14.67
	8H	12.42	12.69	13.53	13.78	15.28	12.04	12.31	13.15	13.40	14.90

END OF REPORT