

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906746

Luminaire Tested: DFN2DIP-SQ4F0-080D080US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906746
REPORT IS A COMBINATION OF REPORTS P900100 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D080US835-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13880.0 lumens
Efficiency: N/A
Efficacy: 106.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLLFLL

Luminous Intensity Polar Plot

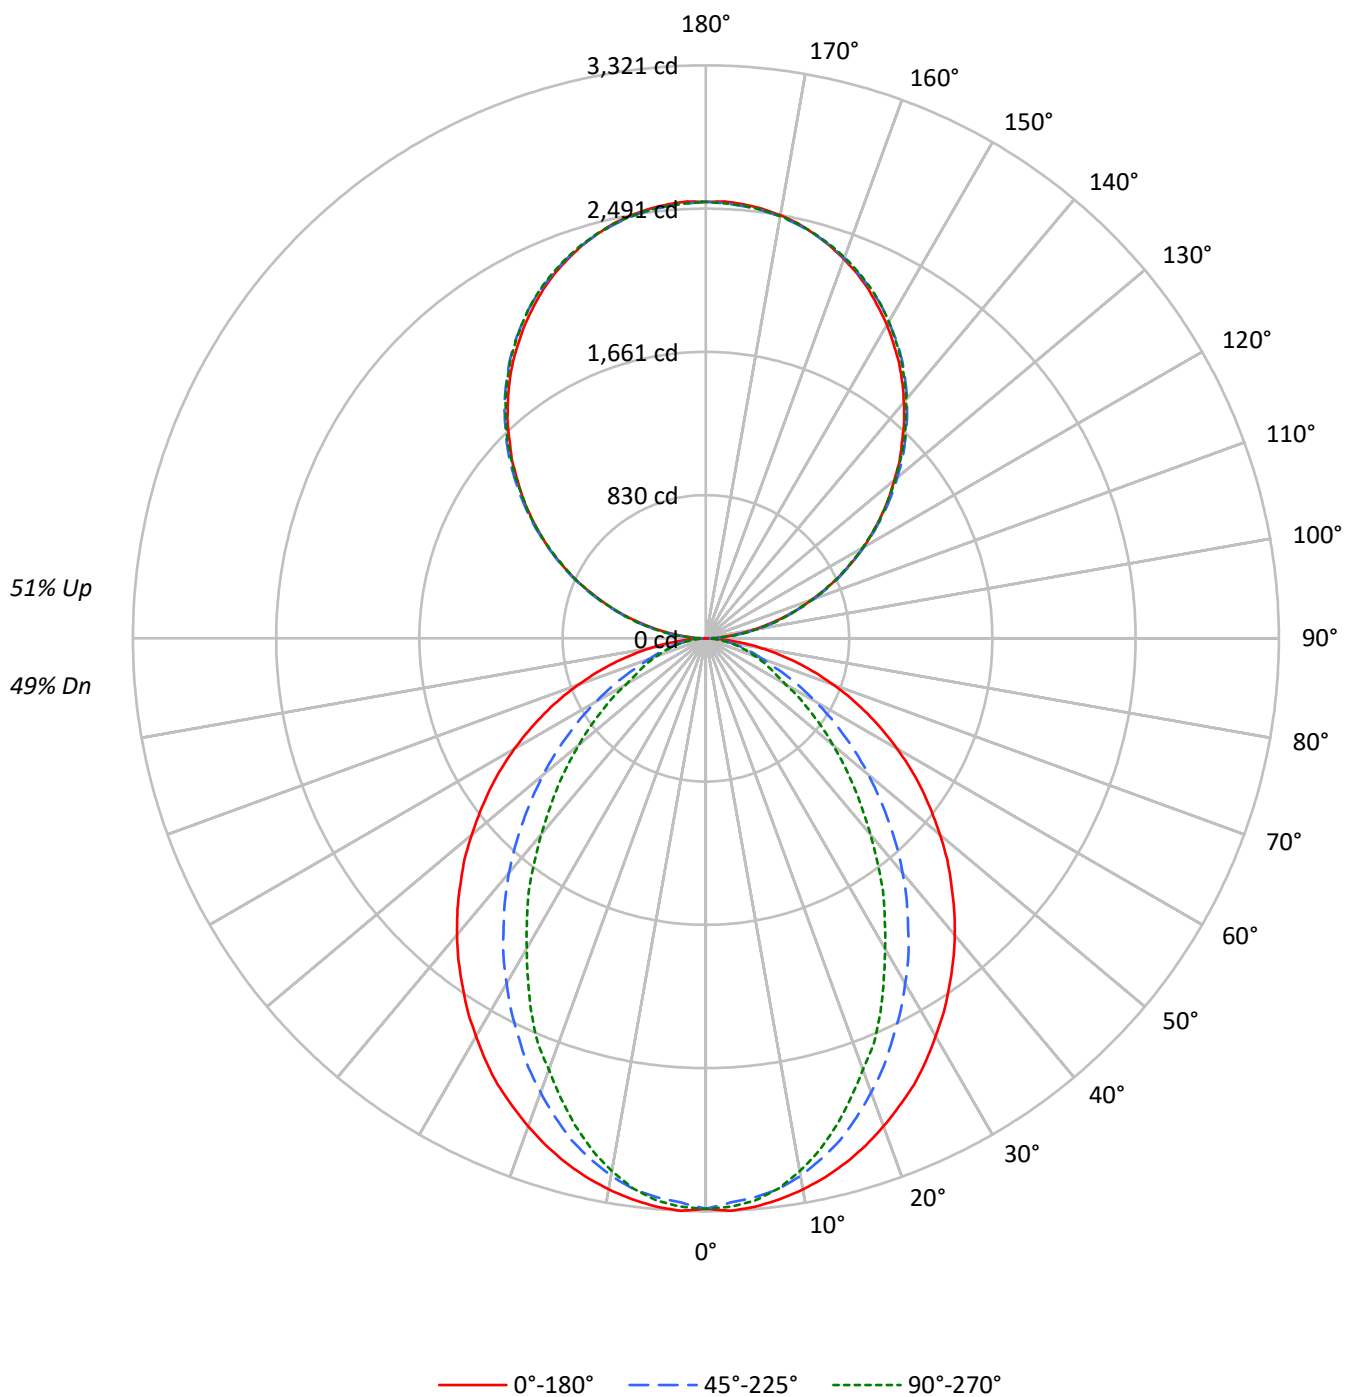

TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2320	2320	2320
5°	2324	2284	2298
10°	2301	2239	2224
15°	2269	2166	2109
20°	2227	2064	1968
25°	2184	1950	1831
30°	2126	1833	1658
35°	2070	1708	1506
40°	2013	1577	1331
45°	1946	1433	1173
50°	1877	1287	1018
55°	1805	1131	869
60°	1721	968	716
65°	1625	802	645
70°	1509	648	585
75°	1363	572	534
80°	1151	481	465
85°	801	324	354

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1992 cd/sqm

TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	309.9	2.2
10°-20°	850.7	6.1
20°-30°	1194.3	8.6
30°-40°	1301.9	9.4
40°-50°	1196.6	8.6
50°-60°	939.7	6.8
60°-70°	611.7	4.4
70°-80°	314.9	2.3
80°-90°	87.6	0.6
90°-100°	156.6	1.1
100°-110°	497.5	3.6
110°-120°	851.3	6.1
120°-130°	1119.6	8.1
130°-140°	1256.7	9.1
140°-150°	1232.3	8.9
150°-160°	1033.7	7.4
160°-170°	685.6	4.9
170°-180°	239.6	1.7
0°-30°	2354.9	17.0
0°-40°	3656.8	26.3
0°-60°	5793.1	41.7
0°-90°	6807.2	49.0
90°-120°	1505.3	10.8
90°-150°	5113.9	36.8
90°-180°	7073.0	51.0
0°-180°	13880.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3306	3306	3306	3306	3306	
5°	3306	3292	3252	3279	3270	314
15°	3145	3112	3010	2953	2924	886
25°	2855	2759	2561	2439	2394	1313
35°	2460	2307	2044	1855	1789	1540
45°	2011	1810	1496	1284	1212	1553
55°	1529	1296	972	793	736	1366
65°	1032	790	521	419	410	1024
75°	550	341	239	218	216	582
85°	129	66	57	57	57	148
90°	2	28	75	70	72	14
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3306.4	3306.4	3306.4	3306.4	3306.4
2.5°	3321.3	3306.4	3273.4	3303.5	3297.5
5°	3306.4	3291.5	3252.4	3279.4	3270.5
7.5°	3279.4	3261.6	3219.7	3231.5	3216.5
10°	3243.5	3222.6	3162.9	3153.7	3135.9
12.5°	3198.8	3171.8	3090.8	3073.0	3040.0
15°	3144.8	3111.8	3010.2	2953.4	2923.5
17.5°	3081.9	3034.0	2908.3	2842.6	2794.6
20°	3010.2	2950.2	2800.7	2726.1	2660.0
22.5°	2932.4	2863.5	2689.9	2588.3	2543.5
25°	2854.6	2758.8	2561.3	2438.8	2393.7
27.5°	2761.9	2660.0	2441.6	2301.0	2232.1
30°	2663.2	2549.2	2309.9	2157.5	2076.5
32.5°	2567.3	2429.6	2184.5	2004.8	1929.9
35°	2459.7	2307.0	2043.8	1855.3	1789.2
37.5°	2354.9	2190.2	1912.1	1705.4	1630.8
40°	2244.2	2064.8	1774.3	1561.9	1484.1
42.5°	2130.5	1939.1	1636.8	1415.3	1340.6
45°	2010.8	1810.2	1496.2	1283.5	1211.8
47.5°	1897.2	1684.8	1361.6	1148.9	1083.2
50°	1771.4	1559.1	1229.9	1023.2	960.6
52.5°	1648.6	1424.1	1104.1	906.7	849.9
55°	1528.9	1295.6	972.4	793.0	736.2
57.5°	1406.4	1167.0	855.9	688.3	640.3
60°	1280.6	1041.3	733.0	580.6	532.7
62.5°	1158.1	918.7	628.3	484.8	461.0
65°	1032.4	789.8	520.6	419.1	409.8
67.5°	912.7	670.2	419.1	367.9	359.1
70°	787.0	553.7	347.0	317.1	305.1
72.5°	667.3	445.7	290.2	266.4	260.3
75°	550.5	341.0	239.4	218.4	215.6
77.5°	434.0	242.2	188.6	176.5	170.5
80°	326.0	173.7	143.5	131.7	131.7
82.5°	227.3	116.8	98.7	92.7	92.7
85°	128.6	65.7	56.8	56.8	56.8
87.5°	47.9	23.8	23.8	21.0	21.0
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5



TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P906746

CATALOG NUMBER: DFN2DIP-SQ4F0-080D080US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.99	10.81	10.96	11.80	13.08	5.95	6.78	6.92	7.76	9.04
	3H	11.67	12.41	12.66	13.40	14.71	7.14	7.88	8.12	8.87	10.18
	4H	12.28	12.98	13.28	13.97	15.29	7.59	8.29	8.59	9.28	10.60
	6H	12.71	13.35	13.72	14.35	15.68	7.91	8.55	8.92	9.55	10.88
	8H	12.84	13.45	13.85	14.46	15.79	8.00	8.61	9.02	9.63	10.95
	12H	12.90	13.48	13.92	14.49	15.84	8.05	8.63	9.06	9.63	10.99
4H	2H	10.01	10.70	11.01	11.70	13.02	6.55	7.24	7.55	8.24	9.56
	3H	11.84	12.42	12.85	13.44	14.77	7.90	8.48	8.91	9.50	10.83
	4H	12.54	13.07	13.56	14.08	15.44	8.45	8.98	9.47	9.99	11.35
	6H	13.06	13.51	14.09	14.55	15.90	8.87	9.32	9.90	10.36	11.71
	8H	13.23	13.66	14.26	14.69	16.06	9.00	9.42	10.03	10.45	11.82
	12H	13.33	13.71	14.38	14.76	16.13	9.06	9.44	10.11	10.49	11.86
8H	4H	12.50	12.93	13.54	13.96	15.33	8.73	9.15	9.76	10.19	11.55
	6H	13.08	13.42	14.13	14.50	15.86	9.25	9.60	10.30	10.67	12.04
	8H	13.29	13.60	14.36	14.66	16.04	9.44	9.75	10.50	10.81	12.19
	12H	13.44	13.71	14.50	14.76	16.19	9.56	9.83	10.63	10.88	12.31
12H	4H	12.46	12.84	13.50	13.89	15.26	8.74	9.12	9.78	10.16	11.54
	6H	13.05	13.36	14.11	14.42	15.80	9.30	9.61	10.36	10.67	12.05
	8H	13.27	13.54	14.34	14.60	16.02	9.51	9.78	10.58	10.84	12.26

END OF REPORT