

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906824

Luminaire Tested: DFN2DIP-SQ4F0-100D100US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906824
REPORT IS A COMBINATION OF REPORTS P900139 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D100US835-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18750.0 lumens
Efficiency: N/A
Efficacy: 112.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFLL

Luminous Intensity Polar Plot

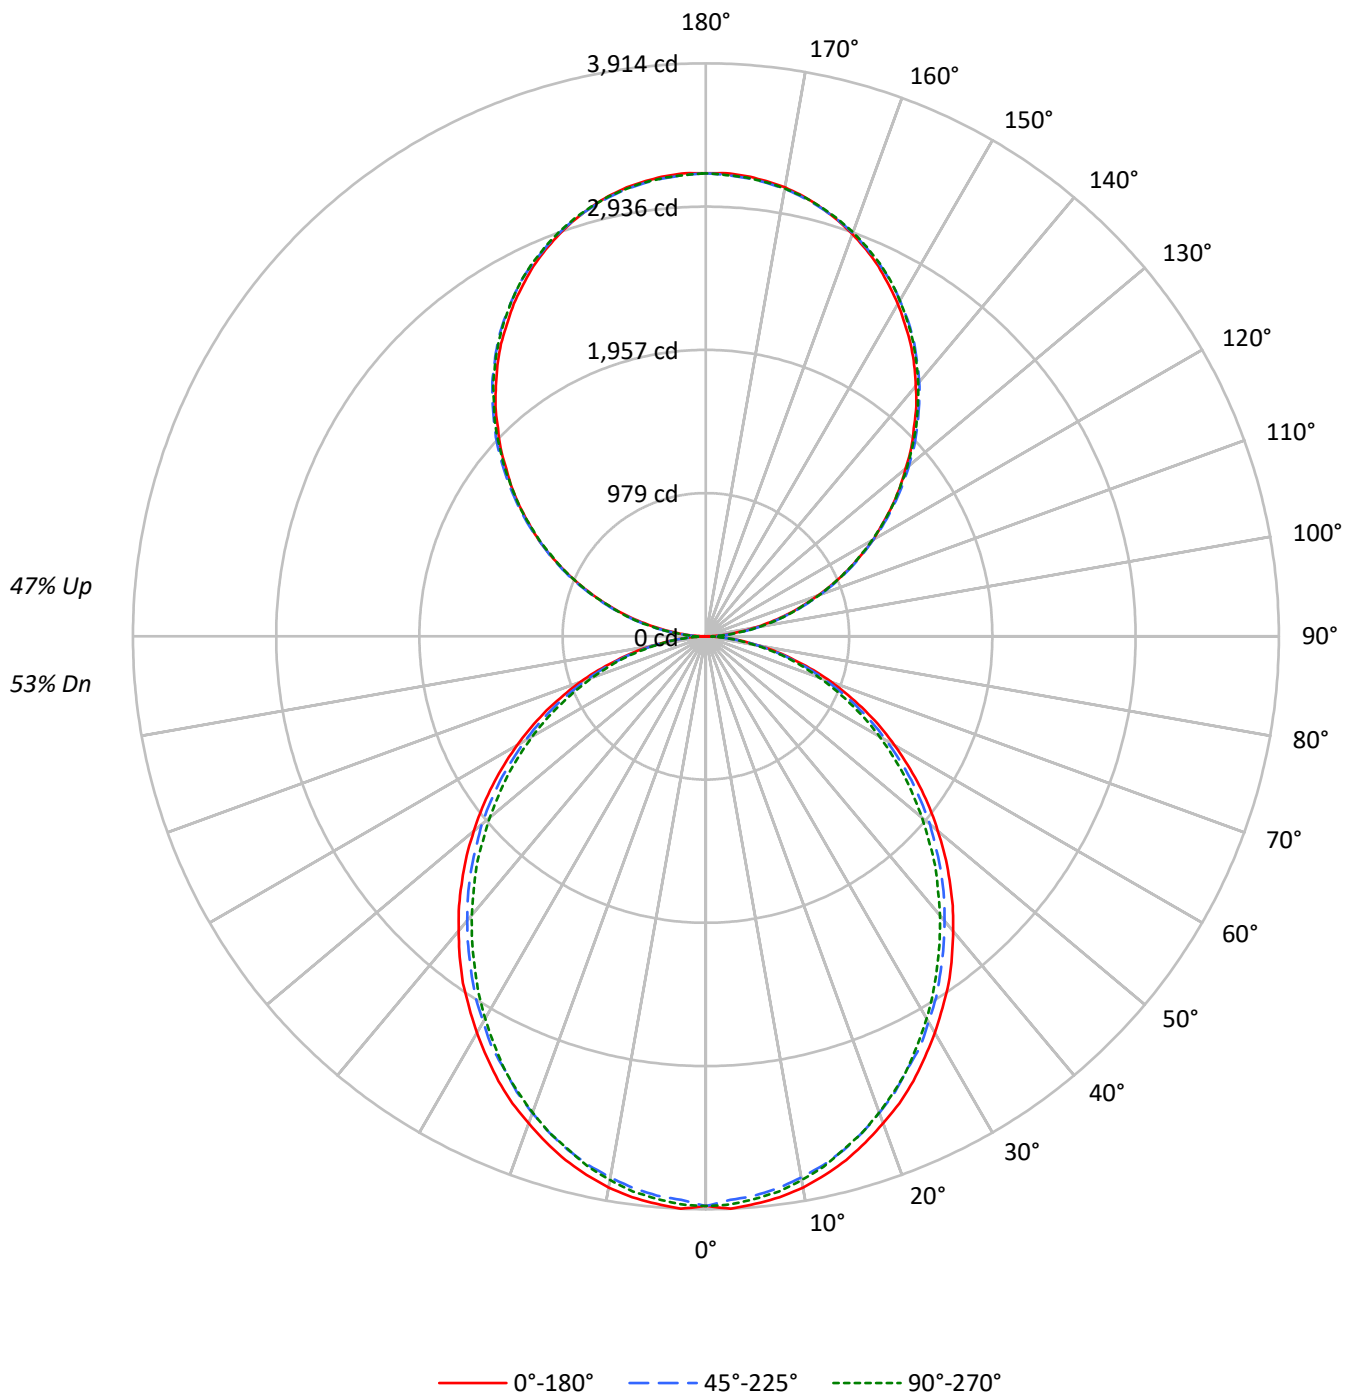

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2730	2730	2730
5°	2735	2693	2711
10°	2712	2657	2675
15°	2672	2614	2619
20°	2618	2554	2561
25°	2565	2481	2494
30°	2498	2414	2408
35°	2434	2335	2317
40°	2356	2255	2231
45°	2277	2175	2143
50°	2192	2091	2041
55°	2102	1994	1948
60°	2001	1878	1841
65°	1891	1759	1714
70°	1750	1613	1578
75°	1555	1439	1454
80°	1321	1217	1215
85°	955	833	816

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2490 cd/sqm

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.2	2.0
10°-20°	1030.4	5.5
20°-30°	1514.3	8.1
30°-40°	1758.8	9.4
40°-50°	1756.6	9.4
50°-60°	1531.7	8.2
60°-70°	1132.3	6.0
70°-80°	640.6	3.4
80°-90°	178.1	0.9
90°-100°	195.7	1.0
100°-110°	621.8	3.3
110°-120°	1064.1	5.7
120°-130°	1399.5	7.5
130°-140°	1570.9	8.4
140°-150°	1540.4	8.2
150°-160°	1292.2	6.9
160°-170°	856.9	4.6
170°-180°	299.5	1.6
0°-30°	2911.0	15.5
0°-40°	4669.7	24.9
0°-60°	7958.0	42.4
0°-90°	9909.0	52.8
90°-120°	1881.6	10.0
90°-150°	6392.4	34.1
90°-180°	8841.0	47.2
0°-180°	18750.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3891	3891	3891	3891	3891	
5°	3891	3876	3835	3865	3858	369
15°	3704	3682	3633	3648	3630	1043
25°	3352	3323	3259	3266	3259	1543
35°	2892	2855	2795	2772	2754	1806
45°	2354	2327	2271	2230	2215	1816
55°	1781	1759	1714	1669	1650	1592
65°	1201	1179	1141	1108	1089	1188
75°	628	621	602	580	588	671
85°	153	150	146	135	131	171
90°	3	34	93	88	91	18
95°	139	166	171	171	166	155
105°	574	582	587	592	592	606
115°	1068	1083	1078	1076	1068	1056
125°	1553	1577	1569	1561	1558	1388
135°	2009	2038	2044	2041	2034	1553
145°	2439	2458	2473	2476	2466	1524
155°	2789	2796	2805	2818	2810	1284
165°	3034	3031	3031	3050	3037	856
175°	3157	3149	3144	3163	3146	300
180°	3163	3163	3163	3163	3163	

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3891.1	3891.1	3891.1	3891.1	3891.1
2.5°	3913.7	3895.0	3853.7	3891.1	3883.9
5°	3891.1	3876.4	3835.1	3864.9	3857.7
7.5°	3864.9	3842.6	3801.3	3831.5	3824.0
10°	3824.0	3797.8	3752.9	3782.7	3771.6
12.5°	3767.6	3745.4	3700.5	3719.2	3711.6
15°	3704.1	3681.9	3633.0	3648.1	3629.5
17.5°	3625.5	3603.3	3554.4	3573.1	3554.4
20°	3539.3	3517.1	3464.7	3475.8	3461.1
22.5°	3453.6	3419.9	3371.0	3371.0	3363.5
25°	3352.4	3322.6	3259.1	3266.2	3259.1
27.5°	3240.0	3213.8	3165.4	3154.3	3135.6
30°	3128.1	3097.9	3041.9	3030.8	3015.7
32.5°	3008.2	2986.0	2926.0	2903.4	2888.3
35°	2892.3	2855.0	2795.0	2772.4	2753.7
37.5°	2761.3	2727.5	2667.6	2641.4	2622.7
40°	2626.7	2596.5	2536.6	2503.3	2488.2
42.5°	2495.7	2465.5	2406.0	2368.3	2346.1
45°	2353.6	2327.4	2271.0	2230.1	2215.1
47.5°	2215.1	2188.9	2128.9	2087.6	2065.4
50°	2069.0	2050.3	1997.9	1945.5	1926.9
52.5°	1926.9	1900.7	1852.2	1811.0	1784.8
55°	1781.2	1758.6	1713.7	1668.8	1650.2
57.5°	1635.1	1616.4	1567.6	1522.8	1507.7
60°	1489.0	1474.3	1421.9	1380.6	1369.5
62.5°	1346.9	1320.7	1283.4	1246.1	1231.0
65°	1201.2	1178.6	1141.3	1107.5	1088.9
67.5°	1051.6	1032.5	999.2	973.0	957.9
70°	913.0	897.9	864.2	838.0	823.3
72.5°	770.9	755.8	737.2	711.0	699.8
75°	628.4	621.3	602.2	580.0	587.5
77.5°	501.4	486.3	478.7	467.6	456.5
80°	374.3	370.4	362.8	351.7	344.2
82.5°	254.5	254.5	250.9	235.8	235.8
85°	153.2	149.7	146.1	134.6	131.0
87.5°	67.5	59.9	52.4	41.3	37.3
90°	2.9	34.3	93.4	87.7	90.6
92.5°	59.1	80.1	83.0	85.8	85.8
95°	139.2	165.9	170.7	170.7	165.9
97.5°	231.7	256.5	267.0	267.0	267.0
100°	338.5	360.4	368.0	368.0	365.2
102.5°	451.0	467.2	477.7	480.5	477.7
105°	574.0	581.6	587.3	592.1	592.1
107.5°	696.0	707.5	707.5	709.4	696.0
110°	814.3	829.5	829.5	829.5	821.9

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	942.0	958.2	955.4	947.7	942.0
115°	1067.9	1083.1	1078.4	1075.5	1067.9
117.5°	1192.8	1213.8	1200.4	1192.8	1185.1
120°	1318.6	1339.6	1318.6	1318.6	1310.1
122.5°	1433.0	1459.7	1446.4	1438.8	1433.0
125°	1553.2	1577.0	1569.4	1560.8	1558.0
127.5°	1670.5	1700.0	1689.5	1678.1	1670.5
130°	1780.1	1814.4	1809.7	1803.9	1793.5
132.5°	1903.1	1929.8	1931.7	1918.4	1910.7
135°	2008.9	2038.5	2044.2	2041.4	2033.7
137.5°	2127.2	2151.0	2155.8	2153.9	2142.4
140°	2231.1	2254.9	2268.3	2268.3	2257.8
142.5°	2337.9	2361.7	2369.3	2372.2	2361.7
145°	2438.9	2458.0	2473.3	2476.1	2465.6
147.5°	2529.5	2553.4	2564.8	2569.6	2559.1
150°	2623.0	2639.2	2649.7	2658.2	2649.7
152.5°	2705.9	2722.1	2735.5	2746.0	2735.5
155°	2788.9	2796.5	2805.1	2818.4	2809.8
157.5°	2860.4	2866.1	2870.9	2889.9	2876.6
160°	2924.3	2930.0	2932.8	2949.0	2937.6
162.5°	2983.4	2983.4	2986.2	3004.3	2991.0
165°	3033.9	3031.0	3031.0	3050.1	3036.8
167.5°	3079.7	3071.1	3071.1	3090.2	3076.8
170°	3114.0	3106.4	3103.5	3122.6	3106.4
172.5°	3137.8	3130.2	3127.3	3146.4	3130.2
175°	3156.9	3149.3	3143.6	3162.6	3146.4
177.5°	3167.4	3159.8	3154.0	3170.2	3154.0
180°	3162.6	3162.6	3162.6	3162.6	3162.6

TEST NUMBER: P906824

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.03	11.92	11.96	12.87	14.10	10.59	11.48	11.52	12.43	13.66
	3H	12.70	13.50	13.64	14.45	15.71	12.21	13.00	13.15	13.96	15.22
	4H	13.29	14.04	14.25	15.01	16.27	12.80	13.55	13.75	14.51	15.78
	6H	13.70	14.39	14.66	15.36	16.63	13.20	13.89	14.16	14.86	16.13
	8H	13.80	14.46	14.78	15.45	16.72	13.30	13.96	14.28	14.95	16.22
	12H	13.85	14.48	14.84	15.46	16.76	13.34	13.97	14.33	14.95	16.25
4H	2H	11.50	12.25	12.46	13.21	14.48	11.14	11.90	12.11	12.86	14.12
	3H	13.37	14.00	14.34	14.99	16.27	12.96	13.59	13.94	14.58	15.86
	4H	14.09	14.66	15.07	15.65	16.95	13.67	14.24	14.65	15.23	16.53
	6H	14.61	15.11	15.60	16.12	17.41	14.18	14.67	15.17	15.68	16.98
	8H	14.76	15.23	15.76	16.23	17.54	14.33	14.79	15.32	15.79	17.10
	12H	14.84	15.26	15.85	16.28	17.59	14.39	14.81	15.40	15.83	17.15
8H	4H	14.29	14.75	15.28	15.75	17.07	13.91	14.37	14.91	15.38	16.69
	6H	14.93	15.31	15.95	16.35	17.66	14.54	14.92	15.56	15.97	17.28
	8H	15.15	15.49	16.18	16.52	17.85	14.76	15.09	15.79	16.13	17.46
	12H	15.28	15.58	16.32	16.61	17.98	14.87	15.17	15.91	16.20	17.57
12H	4H	14.27	14.69	15.29	15.71	17.03	13.91	14.33	14.92	15.34	16.66
	6H	14.96	15.29	15.98	16.33	17.65	14.58	14.92	15.61	15.95	17.28
	8H	15.20	15.50	16.24	16.53	17.90	14.82	15.12	15.86	16.15	17.52

END OF REPORT