

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P906931

Luminaire Tested: DFN2DIP-SQ4F0-140D090US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P906931
REPORT IS A COMBINATION OF REPORTS P901648 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D090US835-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20810.0 lumens
Efficiency: N/A
Efficacy: 98.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 210.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLLONL

Luminous Intensity Polar Plot

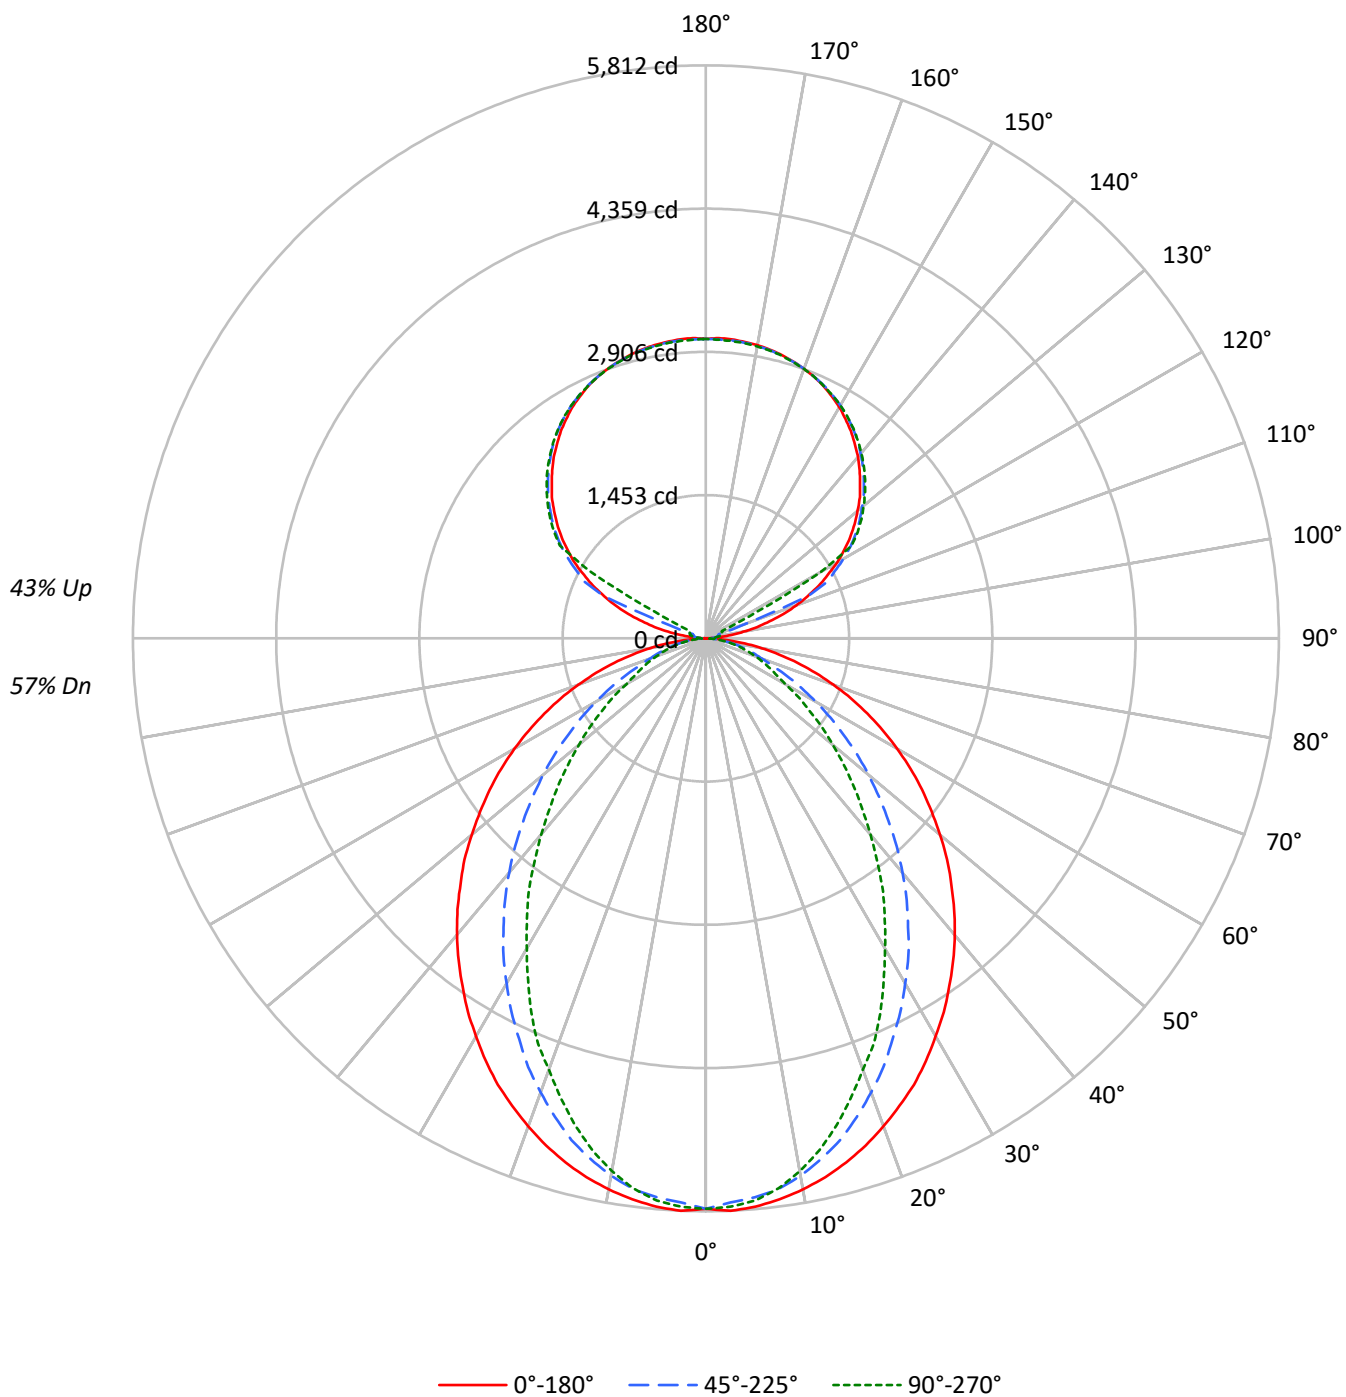

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		75	75	75		63	63	63
1	100	96	92	89		93	89	86	83		77	75	73		66	65	63		56	55	54
2	91	84	78	73		85	79	74	69		69	65	61		59	56	54		50	48	46
3	84	75	67	62		78	70	64	59		61	56	52		53	49	46		45	42	40
4	77	66	59	53		72	62	55	50		55	49	45		47	43	40		41	38	35
5	71	60	52	46		66	56	49	44		49	44	39		43	38	35		37	34	31
6	66	54	46	40		61	51	43	38		45	39	35		39	34	31		34	30	28
7	61	49	41	35		57	46	39	34		41	35	31		36	31	28		31	27	25
8	57	44	37	31		53	42	35	30		37	32	27		33	28	25		29	25	22
9	53	41	33	28		49	38	32	27		34	29	25		30	26	23		26	23	20
10	49	37	30	26		46	35	29	25		32	26	23		28	24	21		25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4060	4060	4060
5°	4066	3996	4022
10°	4026	3919	3893
15°	3971	3790	3691
20°	3897	3612	3444
25°	3822	3413	3205
30°	3721	3208	2902
35°	3622	2988	2635
40°	3522	2760	2329
45°	3405	2508	2052
50°	3284	2252	1781
55°	3158	1980	1521
60°	3012	1694	1253
65°	2844	1404	1129
70°	2640	1133	1024
75°	2384	1001	934
80°	2014	842	814
85°	1402	566	619

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3405 cd/sqm

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	542.3	2.6
10°-20°	1488.7	7.2
20°-30°	2090.1	10.0
30°-40°	2278.3	10.9
40°-50°	2094.0	10.1
50°-60°	1644.5	7.9
60°-70°	1070.4	5.1
70°-80°	551.0	2.6
80°-90°	146.0	0.7
90°-100°	100.2	0.5
100°-110°	373.4	1.8
110°-120°	990.2	4.8
120°-130°	1642.4	7.9
130°-140°	1744.6	8.4
140°-150°	1621.4	7.8
150°-160°	1303.5	6.3
160°-170°	840.0	4.0
170°-180°	289.1	1.4
0°-30°	4121.0	19.8
0°-40°	6399.4	30.8
0°-60°	10137.9	48.7
0°-90°	11905.3	57.2
90°-120°	1463.7	7.0
90°-150°	6472.0	31.1
90°-180°	8905.0	42.8
0°-180°	20810.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5786	5786	5786	5786	5786	
5°	5786	5760	5692	5739	5723	549
15°	5503	5446	5268	5168	5116	1551
25°	4996	4828	4482	4268	4189	2297
35°	4304	4037	3577	3247	3131	2694
45°	3519	3168	2618	2246	2121	2718
55°	2676	2267	1702	1388	1288	2391
65°	1807	1382	911	733	717	1791
75°	963	597	419	382	377	1019
85°	225	115	99	99	99	258
90°	2	26	44	55	59	20
95°	143	70	86	97	94	169
105°	668	734	134	158	167	714
115°	1264	1301	1356	338	180	1244
125°	1787	1815	1857	1873	1879	1594
135°	2211	2246	2266	2288	2284	1708
145°	2565	2563	2600	2615	2604	1604
155°	2824	2805	2831	2844	2826	1301
165°	2976	2963	2969	2985	2969	841
175°	3044	3028	3033	3048	3026	290
180°	3037	3037	3037	3037	3037	

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5786.2	5786.2	5786.2	5786.2	5786.2
2.5°	5812.3	5786.2	5728.4	5781.2	5770.6
5°	5786.2	5760.1	5691.7	5739.0	5723.4
7.5°	5739.0	5707.8	5634.5	5655.1	5629.0
10°	5676.2	5639.5	5535.1	5518.9	5487.8
12.5°	5597.8	5550.6	5408.9	5377.8	5320.1
15°	5503.4	5445.6	5267.8	5168.4	5116.2
17.5°	5393.4	5309.5	5089.5	4974.5	4890.6
20°	5267.8	5162.8	4901.2	4770.6	4655.1
22.5°	5131.7	5011.2	4707.3	4529.5	4451.2
25°	4995.6	4827.8	4482.3	4267.8	4188.9
27.5°	4833.4	4655.1	4272.8	4026.7	3906.2
30°	4660.6	4461.2	4042.3	3775.6	3633.9
32.5°	4492.8	4251.7	3822.8	3508.4	3377.3
35°	4304.5	4037.3	3576.7	3246.7	3131.1
37.5°	4121.2	3832.8	3346.1	2984.5	2853.9
40°	3927.3	3613.4	3105.0	2733.4	2597.3
42.5°	3728.4	3393.4	2864.5	2476.7	2346.1
45°	3518.9	3167.8	2618.4	2246.1	2120.6
47.5°	3320.0	2948.4	2382.8	2010.6	1895.6
50°	3100.0	2728.4	2152.2	1790.6	1681.1
52.5°	2885.0	2492.2	1932.2	1586.7	1487.2
55°	2675.6	2267.2	1701.7	1387.8	1288.3
57.5°	2461.1	2042.2	1497.8	1204.5	1120.6
60°	2241.1	1822.2	1282.8	1016.1	932.2
62.5°	2026.7	1607.8	1099.5	848.3	806.7
65°	1806.7	1382.2	911.1	733.3	717.2
67.5°	1597.2	1172.8	733.3	643.9	628.3
70°	1377.2	968.9	607.2	555.0	533.9
72.5°	1167.8	780.0	507.8	466.1	455.6
75°	963.3	596.7	418.9	382.2	377.2
77.5°	759.5	423.9	330.0	308.9	298.3
80°	570.6	303.9	251.1	230.6	230.6
82.5°	397.8	204.4	172.8	162.2	162.2
85°	225.0	115.0	99.4	99.4	99.4
87.5°	83.9	41.7	41.7	36.7	36.7
90°	2.1	26.4	43.8	55.1	59.2
92.5°	55.1	46.2	52.7	57.2	59.2
95°	142.8	70.2	85.6	96.8	94.5
97.5°	257.1	77.0	112.0	118.7	120.8
100°	389.1	88.0	125.3	142.8	147.2
102.5°	534.0	529.8	129.7	153.7	160.5
105°	668.1	734.2	134.1	158.2	167.0
107.5°	824.2	879.0	138.6	162.6	171.5
110°	973.7	1019.7	384.7	164.9	173.6

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1114.4	1153.8	1116.5	169.1	175.9
115°	1263.7	1301.0	1356.1	338.5	180.3
117.5°	1393.4	1437.3	1474.8	1160.4	584.6
120°	1538.5	1571.4	1611.1	1637.4	1340.7
122.5°	1661.5	1696.7	1740.8	1753.8	1756.2
125°	1786.7	1815.4	1857.2	1872.6	1879.1
127.5°	1901.0	1931.8	1965.0	1986.9	1989.0
130°	2008.8	2044.1	2068.1	2092.3	2090.3
132.5°	2118.7	2147.4	2171.4	2191.3	2189.2
135°	2211.1	2246.3	2265.9	2288.1	2283.7
137.5°	2307.7	2334.0	2356.2	2378.1	2371.6
140°	2402.1	2419.9	2443.9	2463.7	2452.8
142.5°	2481.5	2496.9	2525.3	2542.8	2531.9
145°	2565.0	2562.6	2600.0	2615.4	2604.4
147.5°	2637.3	2630.8	2668.1	2679.1	2670.4
150°	2707.8	2692.4	2727.6	2740.6	2729.7
152.5°	2767.0	2749.5	2782.4	2795.7	2780.3
155°	2824.2	2804.6	2830.9	2844.0	2826.5
157.5°	2870.4	2852.9	2872.7	2888.1	2870.4
160°	2910.0	2896.7	2910.0	2923.1	2907.7
162.5°	2945.0	2931.9	2942.9	2958.3	2938.5
165°	2975.8	2962.7	2969.3	2984.7	2969.3
167.5°	3000.1	2986.8	2993.5	3008.9	2989.1
170°	3019.9	3006.6	3011.0	3026.4	3006.6
172.5°	3033.0	3019.9	3024.3	3039.7	3019.9
175°	3043.9	3028.5	3033.0	3048.3	3026.4
177.5°	3048.3	3033.0	3035.3	3050.7	3030.9
180°	3037.4	3037.4	3037.4	3037.4	3037.4

TEST NUMBER: P906931

CATALOG NUMBER: DFN2DIP-SQ4F0-140D090US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.68	13.57	13.58	14.48	15.65	8.64	9.53	9.54	10.44	11.61
	3H	14.36	15.16	15.27	16.08	17.28	9.83	10.63	10.74	11.55	12.75
	4H	14.98	15.73	15.90	16.66	17.86	10.28	11.04	11.21	11.97	13.17
	6H	15.41	16.10	16.34	17.03	18.25	10.61	11.30	11.55	12.24	13.45
	8H	15.54	16.20	16.48	17.15	18.36	10.70	11.36	11.65	12.31	13.53
	12H	15.60	16.23	16.55	17.18	18.41	10.75	11.38	11.70	12.32	13.56
4H	2H	12.70	13.46	13.63	14.38	15.59	9.24	10.00	10.17	10.93	12.13
	3H	14.54	15.17	15.48	16.13	17.34	10.60	11.23	11.54	12.19	13.40
	4H	15.24	15.81	16.19	16.76	18.01	11.15	11.72	12.10	12.68	13.92
	6H	15.76	16.25	16.73	17.23	18.47	11.57	12.06	12.54	13.04	14.28
	8H	15.94	16.40	16.91	17.37	18.63	11.70	12.16	12.67	13.13	14.39
	12H	16.04	16.45	17.03	17.44	18.70	11.77	12.19	12.76	13.17	14.43
8H	4H	15.21	15.67	16.18	16.64	17.90	11.44	11.90	12.40	12.87	14.12
	6H	15.79	16.16	16.78	17.18	18.43	11.96	12.34	12.95	13.35	14.60
	8H	16.00	16.34	17.01	17.34	18.61	12.15	12.49	13.15	13.49	14.76
	12H	16.15	16.44	17.15	17.44	18.76	12.27	12.57	13.28	13.56	14.88
12H	4H	15.17	15.58	16.15	16.57	17.83	11.45	11.86	12.43	12.85	14.11
	6H	15.76	16.10	16.76	17.10	18.37	12.01	12.34	13.01	13.35	14.62
	8H	15.99	16.28	16.99	17.28	18.59	12.22	12.52	13.23	13.51	14.83

END OF REPORT