

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909393

Luminaire Tested: DFN2DIP-SQ4F0-060D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909393
REPORT IS A COMBINATION OF REPORTS P901579 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D060US840-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11997.2 lumens
Efficiency: N/A
Efficacy: 126.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLLONL

Luminous Intensity Polar Plot

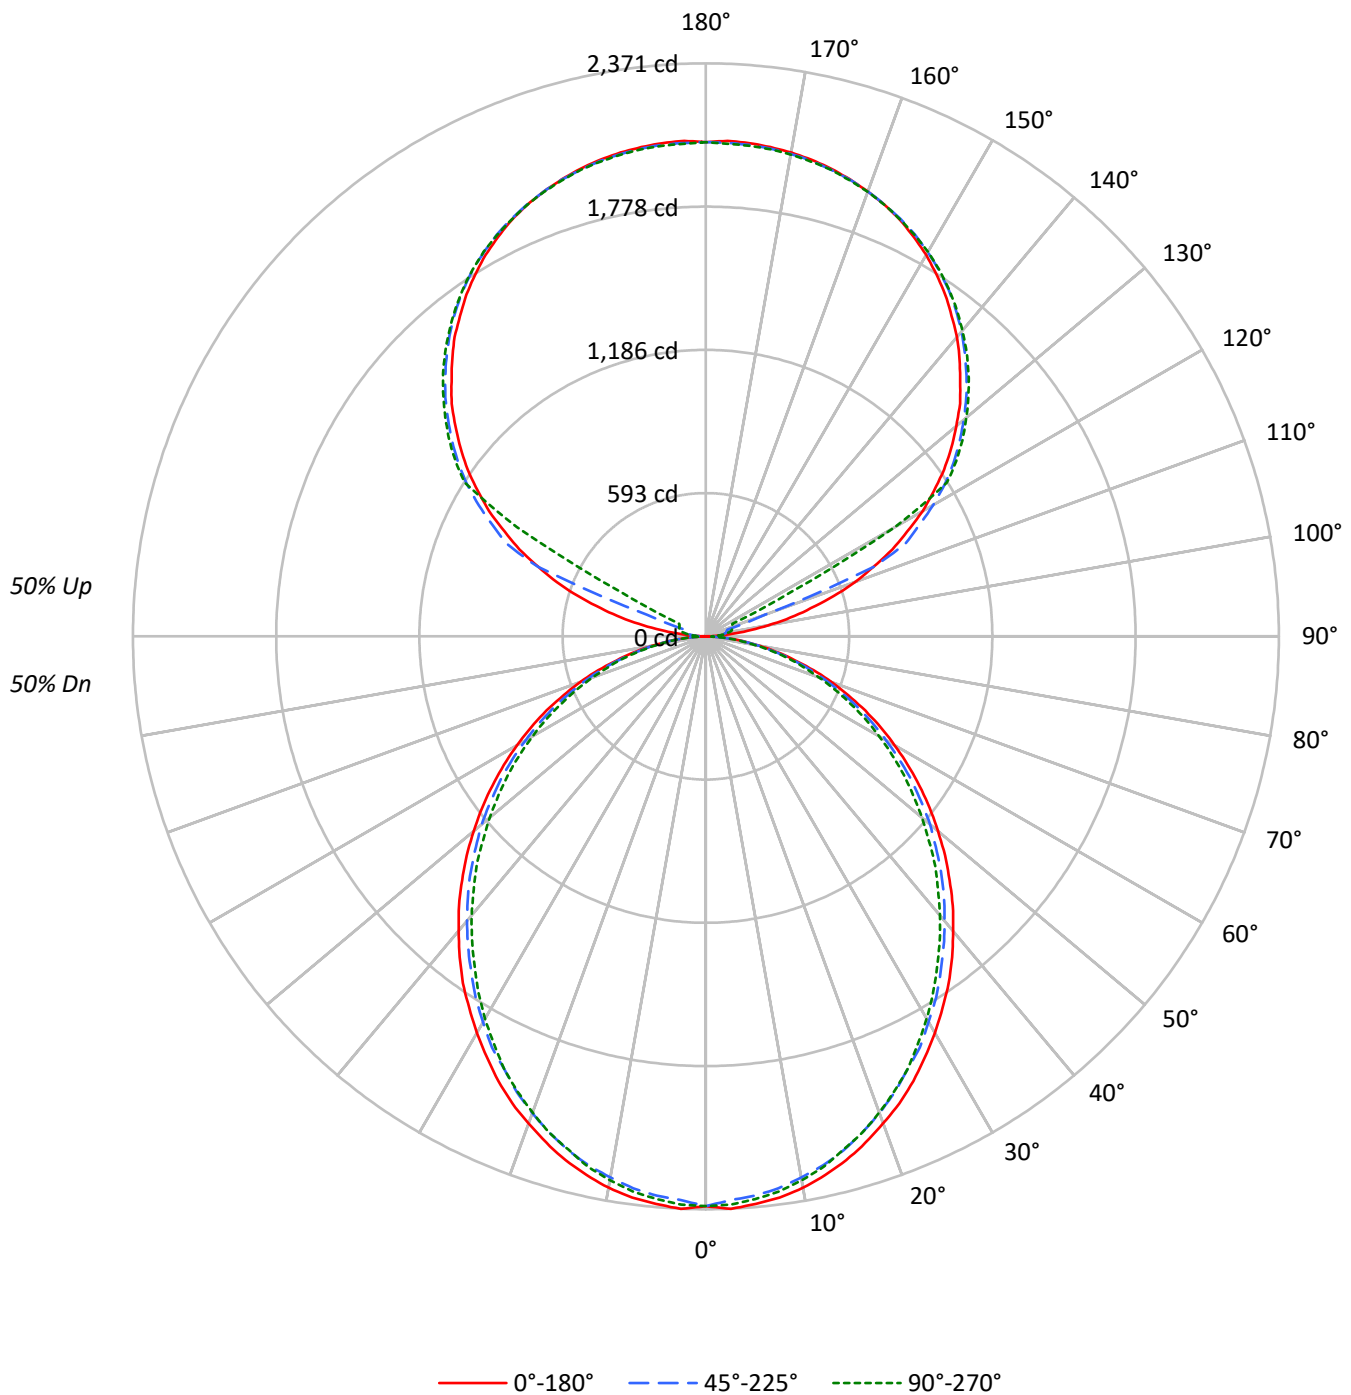

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1654	1654	1654
5°	1657	1632	1643
10°	1643	1610	1621
15°	1619	1584	1587
20°	1587	1547	1552
25°	1554	1504	1511
30°	1513	1463	1459
35°	1475	1415	1404
40°	1427	1366	1352
45°	1380	1318	1299
50°	1328	1267	1237
55°	1274	1208	1180
60°	1212	1138	1115
65°	1146	1066	1038
70°	1061	977	956
75°	942	872	881
80°	801	737	736
85°	578	504	495

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1380 cd/sqm

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.8
10°-20°	624.4	5.2
20°-30°	917.5	7.6
30°-40°	1065.7	8.9
40°-50°	1064.4	8.9
50°-60°	928.1	7.7
60°-70°	686.1	5.7
70°-80°	388.2	3.2
80°-90°	106.0	0.9
90°-100°	67.4	0.6
100°-110°	251.4	2.1
110°-120°	666.7	5.6
120°-130°	1105.7	9.2
130°-140°	1174.5	9.8
140°-150°	1091.6	9.1
150°-160°	877.6	7.3
160°-170°	565.5	4.7
170°-180°	194.6	1.6
0°-30°	1763.8	14.7
0°-40°	2829.5	23.6
0°-60°	4821.9	40.2
0°-90°	6002.2	50.0
90°-120°	985.5	8.2
90°-150°	4357.2	36.3
90°-180°	5995.0	50.0
0°-180°	11997.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	18	30	37	40	11
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909393

CATALOG NUMBER: DFN2DIP-SQ4F0-060D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.04	9.90	9.99	10.87	12.14	8.59	9.45	9.55	10.43	11.70
	3H	10.70	11.47	11.67	12.46	13.75	10.21	10.98	11.18	11.97	13.26
	4H	11.29	12.02	12.27	13.01	14.31	10.80	11.53	11.78	12.51	13.82
	6H	11.70	12.37	12.69	13.36	14.67	11.19	11.87	12.19	12.86	14.17
	8H	11.80	12.44	12.80	13.45	14.76	11.30	11.94	12.30	12.95	14.26
	12H	11.85	12.46	12.86	13.46	14.80	11.34	11.95	12.35	12.95	14.29
4H	2H	9.50	10.23	10.49	11.22	12.52	9.14	9.87	10.13	10.86	12.16
	3H	11.37	11.98	12.37	12.99	14.31	10.96	11.57	11.96	12.59	13.90
	4H	12.09	12.65	13.09	13.65	14.99	11.66	12.22	12.67	13.23	14.57
	6H	12.61	13.09	13.62	14.12	15.45	12.17	12.65	13.19	13.69	15.02
	8H	12.76	13.21	13.78	14.23	15.58	12.32	12.77	13.34	13.79	15.14
	12H	12.83	13.24	13.87	14.28	15.63	12.38	12.79	13.42	13.83	15.18
8H	4H	12.28	12.73	13.30	13.76	15.11	11.91	12.36	12.92	13.38	14.73
	6H	12.92	13.29	13.96	14.36	15.71	12.54	12.91	13.58	13.97	15.32
	8H	13.14	13.47	14.19	14.52	15.89	12.75	13.08	13.80	14.13	15.50
	12H	13.28	13.57	14.33	14.61	16.02	12.87	13.15	13.92	14.20	15.61
12H	4H	12.27	12.68	13.31	13.71	15.07	11.90	12.31	12.94	13.35	14.70
	6H	12.95	13.28	14.00	14.33	15.70	12.58	12.91	13.63	13.96	15.32
	8H	13.20	13.48	14.25	14.53	15.94	12.81	13.10	13.87	14.15	15.56

END OF REPORT