

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909401

Luminaire Tested: DFN2DIP-SQ4F0-060D080US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909401
REPORT IS A COMBINATION OF REPORTS P901615 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D080US840-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13996.7 lumens
Efficiency: N/A
Efficacy: 127.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLLONL

Luminous Intensity Polar Plot

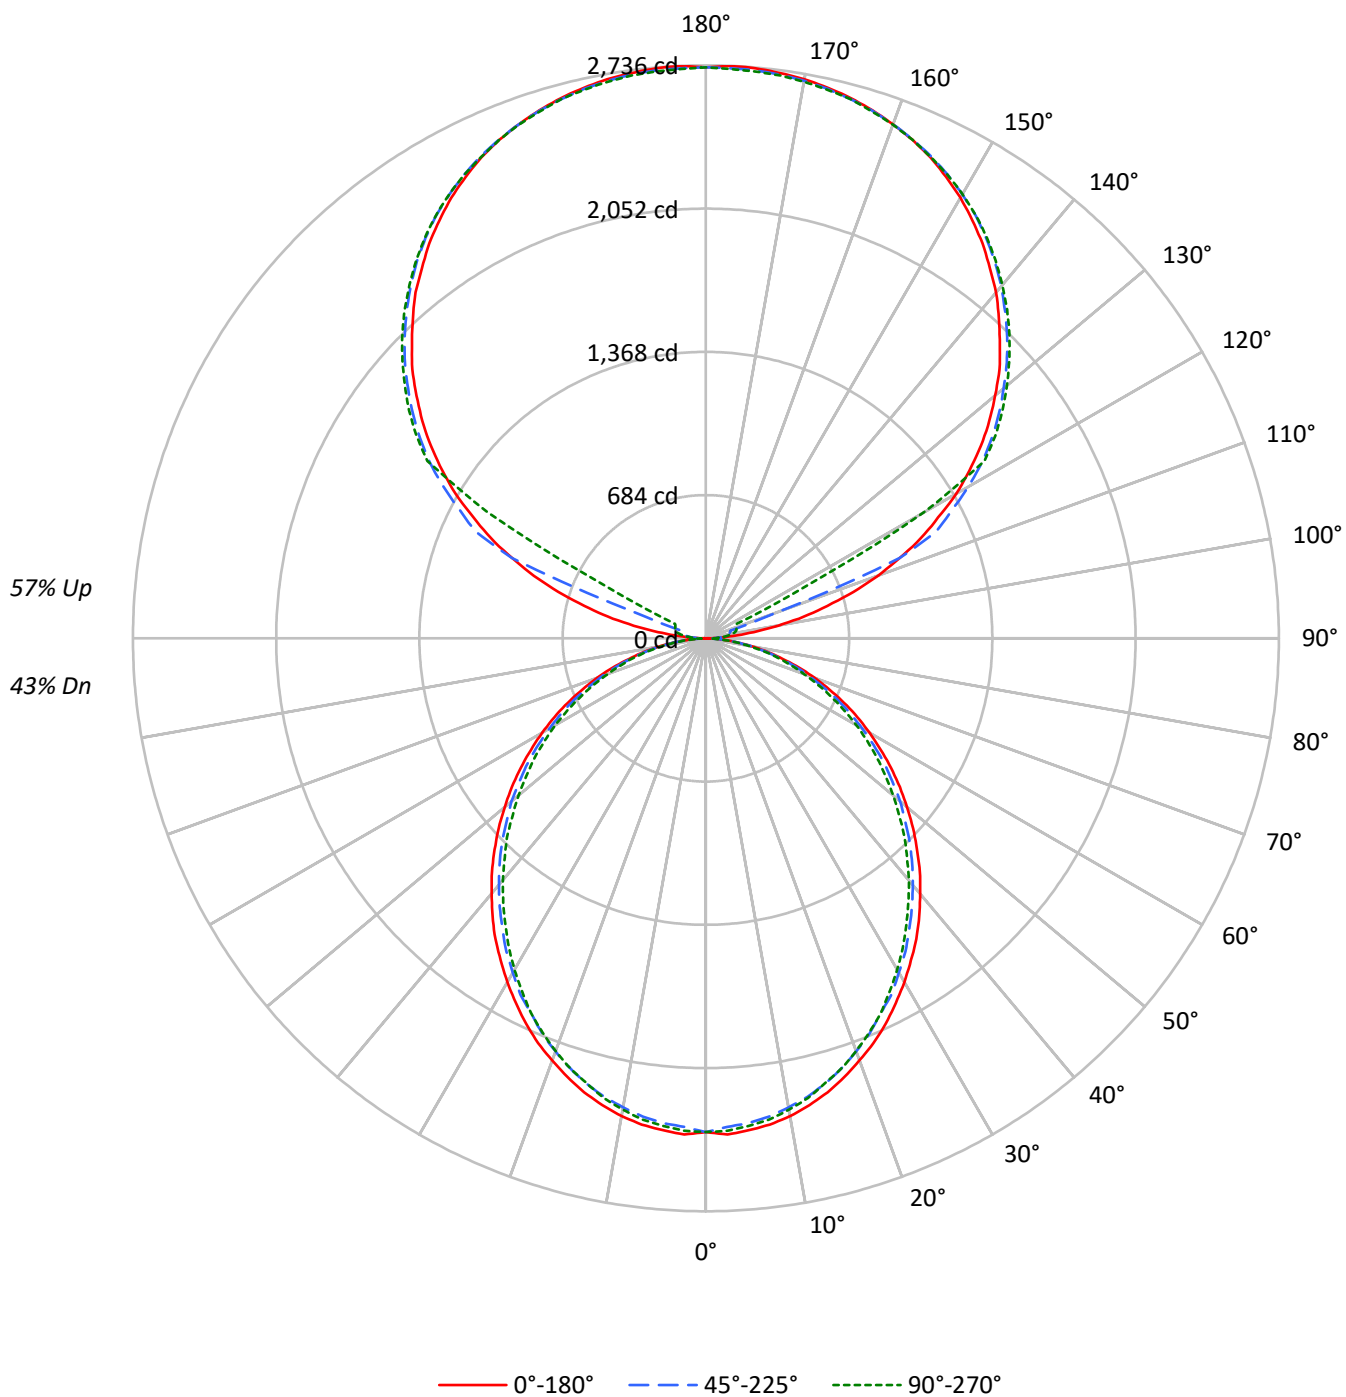

TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1654	1654	1654
5°	1657	1632	1643
10°	1643	1610	1621
15°	1619	1584	1587
20°	1587	1547	1552
25°	1554	1504	1511
30°	1513	1463	1459
35°	1475	1415	1404
40°	1427	1366	1352
45°	1380	1318	1299
50°	1328	1267	1237
55°	1274	1208	1180
60°	1212	1138	1115
65°	1146	1066	1038
70°	1061	977	956
75°	942	872	881
80°	801	737	736
85°	578	504	495

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1462 cd/sqm

TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.6
10°-20°	624.4	4.5
20°-30°	917.5	6.6
30°-40°	1065.7	7.6
40°-50°	1064.4	7.6
50°-60°	928.1	6.6
60°-70°	686.1	4.9
70°-80°	388.2	2.8
80°-90°	107.2	0.8
90°-100°	89.9	0.6
100°-110°	335.1	2.4
110°-120°	888.9	6.4
120°-130°	1474.3	10.5
130°-140°	1566.0	11.2
140°-150°	1455.4	10.4
150°-160°	1170.1	8.4
160°-170°	754.0	5.4
170°-180°	259.5	1.9
0°-30°	1763.8	12.6
0°-40°	2829.5	20.2
0°-60°	4821.9	34.5
0°-90°	6003.4	42.9
90°-120°	1314.0	9.4
90°-150°	5809.7	41.5
90°-180°	7993.0	57.1
0°-180°	13996.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	2	24	39	49	53	13
95°	128	63	77	87	85	152
105°	600	659	120	142	150	641
115°	1134	1168	1217	304	162	1117
125°	1604	1630	1667	1681	1687	1430
135°	1985	2016	2034	2054	2050	1533
145°	2302	2300	2334	2348	2338	1440
155°	2535	2518	2541	2553	2537	1168
165°	2671	2660	2665	2679	2665	755
175°	2732	2719	2723	2736	2717	260
180°	2726	2726	2726	2726	2726	

TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.9	23.6	39.4	49.4	53.2
92.5°	49.4	41.5	47.4	51.3	53.2
95°	128.2	63.0	76.9	86.9	84.8
97.5°	230.8	69.1	100.5	106.6	108.5
100°	349.3	79.0	112.5	128.2	132.1
102.5°	479.4	475.5	116.4	137.9	144.1
105°	599.8	659.0	120.4	142.0	150.0
107.5°	739.8	789.0	124.4	145.9	153.9
110°	874.1	915.3	345.4	148.0	155.8



TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1000.4	1035.7	1002.3	151.8	157.9
115°	1134.4	1167.9	1217.3	303.9	161.9
117.5°	1250.8	1290.2	1323.9	1041.6	524.8
120°	1381.1	1410.6	1446.2	1469.9	1203.5
122.5°	1491.4	1523.1	1562.7	1574.4	1576.5
125°	1603.9	1629.6	1667.1	1680.9	1686.8
127.5°	1706.5	1734.1	1763.9	1783.5	1785.4
130°	1803.2	1834.8	1856.4	1878.2	1876.3
132.5°	1901.9	1927.6	1949.2	1967.0	1965.1
135°	1984.8	2016.4	2034.0	2054.0	2049.9
137.5°	2071.5	2095.2	2115.1	2134.8	2128.9
140°	2156.3	2172.2	2193.8	2211.6	2201.7
142.5°	2227.6	2241.3	2266.8	2282.6	2272.7
145°	2302.5	2300.4	2333.9	2347.7	2337.8
147.5°	2367.4	2361.6	2395.0	2404.9	2397.1
150°	2430.6	2416.8	2448.4	2460.1	2450.3
152.5°	2483.9	2468.1	2497.6	2509.6	2495.8
155°	2535.2	2517.6	2541.2	2552.9	2537.3
157.5°	2576.6	2560.9	2578.7	2592.5	2576.6
160°	2612.2	2600.3	2612.2	2623.9	2610.1
162.5°	2643.6	2631.9	2641.7	2655.5	2637.8
165°	2671.3	2659.6	2665.4	2679.2	2665.4
167.5°	2693.0	2681.1	2687.2	2701.0	2683.2
170°	2710.9	2698.9	2702.9	2716.7	2698.9
172.5°	2722.6	2710.9	2714.8	2728.7	2710.9
175°	2732.4	2718.6	2722.6	2736.3	2716.7
177.5°	2736.3	2722.6	2724.6	2738.5	2720.7
180°	2726.5	2726.5	2726.5	2726.5	2726.5

TEST NUMBER: P909401

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.34	9.14	9.35	10.16	11.53	7.89	8.70	8.91	9.72	11.09
	3H	10.00	10.72	11.03	11.75	13.14	9.51	10.23	10.53	11.26	12.65
	4H	10.59	11.27	11.63	12.30	13.70	10.09	10.77	11.13	11.81	13.21
	6H	10.99	11.61	12.04	12.65	14.06	10.49	11.11	11.53	12.15	13.56
	8H	11.09	11.69	12.15	12.75	14.15	10.59	11.19	11.64	12.24	13.65
	12H	11.14	11.71	12.20	12.76	14.19	10.63	11.20	11.69	12.25	13.68
4H	2H	8.79	9.47	9.84	10.51	11.91	8.44	9.12	9.48	10.16	11.55
	3H	10.66	11.23	11.71	12.29	13.70	10.25	10.82	11.30	11.88	13.29
	4H	11.37	11.89	12.43	12.95	14.38	10.95	11.47	12.01	12.53	13.96
	6H	11.89	12.34	12.96	13.42	14.84	11.46	11.90	12.53	12.98	14.41
	8H	12.04	12.46	13.11	13.53	14.97	11.60	12.02	12.67	13.09	14.53
	12H	12.11	12.49	13.20	13.58	15.02	11.66	12.04	12.75	13.13	14.57
8H	4H	11.57	11.98	12.63	13.05	14.50	11.19	11.61	12.26	12.68	14.12
	6H	12.20	12.54	13.29	13.66	15.10	11.82	12.16	12.91	13.27	14.71
	8H	12.42	12.73	13.52	13.82	15.28	12.03	12.33	13.13	13.43	14.89
	12H	12.55	12.82	13.66	13.91	15.41	12.14	12.41	13.25	13.50	15.00
12H	4H	11.55	11.93	12.64	13.01	14.46	11.18	11.56	12.27	12.64	14.09
	6H	12.23	12.53	13.33	13.63	15.09	11.86	12.16	12.96	13.26	14.72
	8H	12.47	12.74	13.57	13.83	15.33	12.09	12.36	13.19	13.45	14.95

END OF REPORT