

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909412

Luminaire Tested: DFN2DIP-SQ4F0-060D110US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909412
REPORT IS A COMBINATION OF REPORTS P900149 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D110US840-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15829.6 lumens
Efficiency: N/A
Efficacy: 119.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 132.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFLL

Luminous Intensity Polar Plot

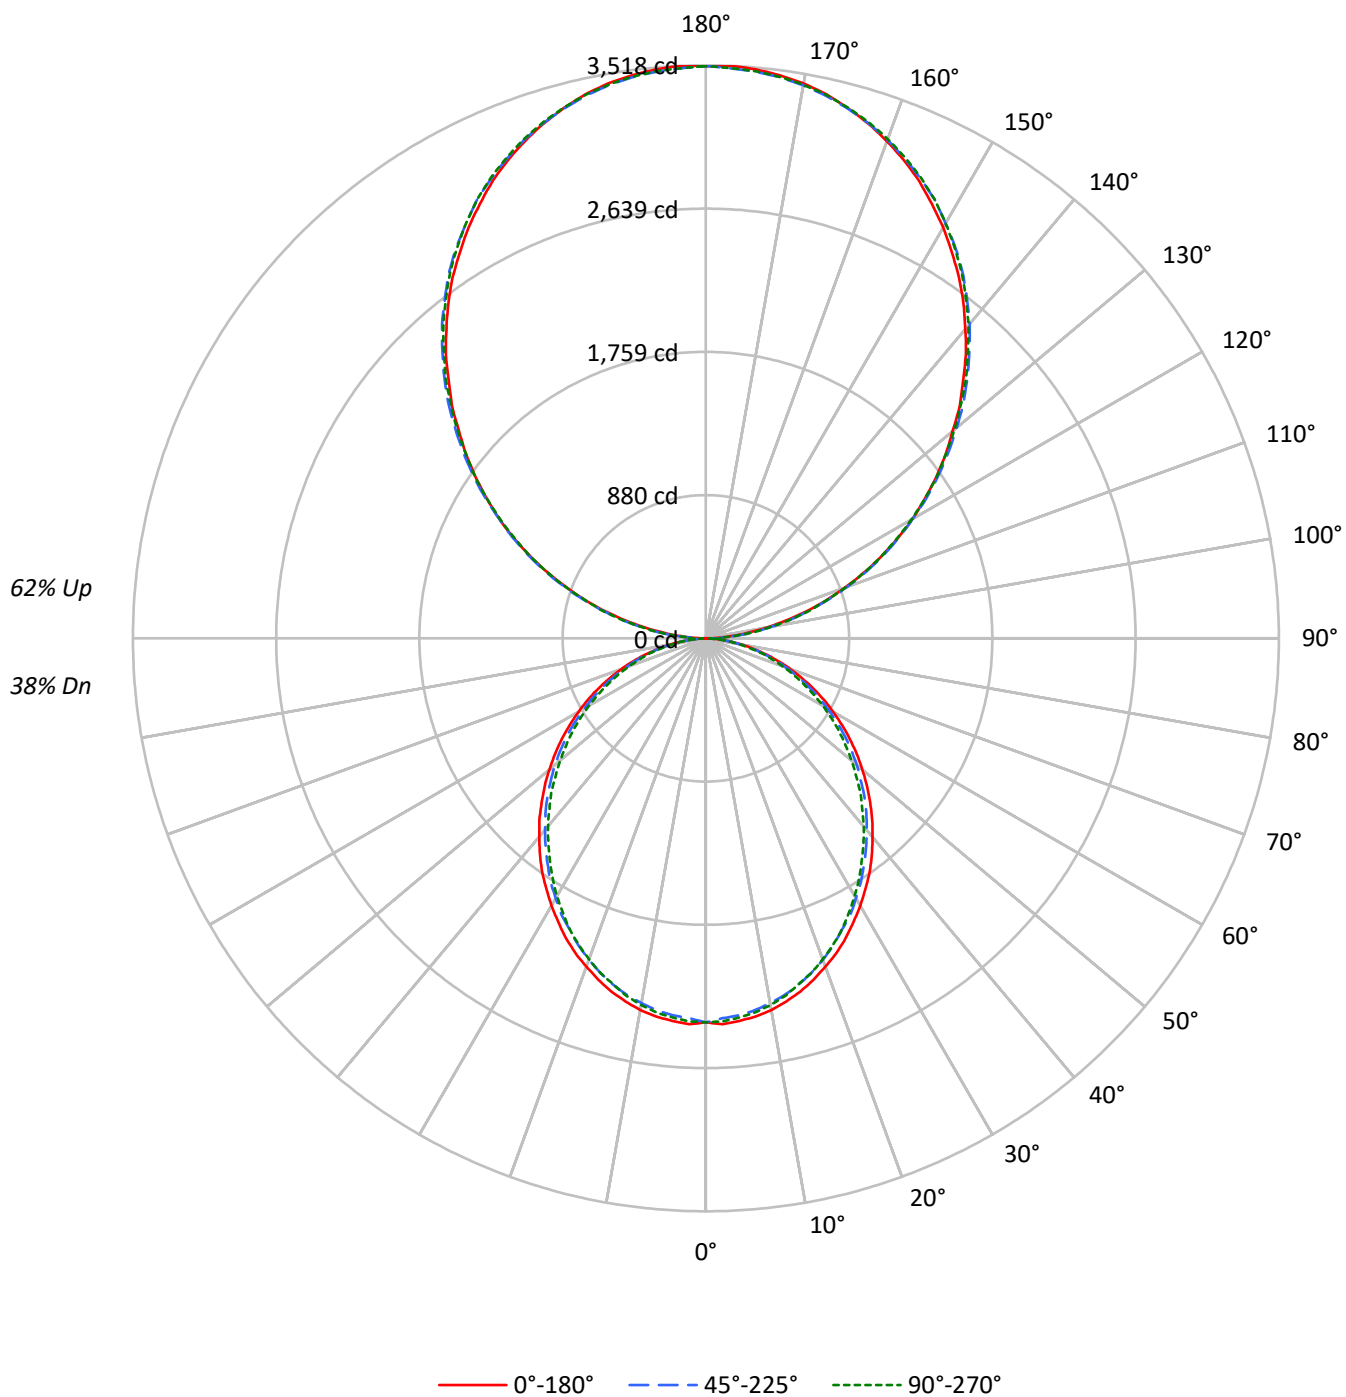

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	95	91	87	84	86	83	79	76	67	65	63	53	51	50	40	39	38
2	87	79	73	68	78	72	67	63	59	55	52	46	44	42	35	33	32
3	79	70	62	57	71	63	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	49	44	46	41	37	37	33	30	28	25	23
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	22	20
6	61	49	41	35	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	36	31	51	41	34	29	33	28	24	27	23	20	21	18	16
8	52	40	32	27	47	37	30	25	30	25	22	25	21	18	19	16	14
9	48	37	29	24	44	34	27	23	28	23	19	23	19	16	17	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	14	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1654	1654	1654
5°	1657	1632	1643
10°	1643	1610	1621
15°	1619	1584	1587
20°	1587	1547	1552
25°	1554	1504	1511
30°	1513	1463	1459
35°	1475	1415	1404
40°	1427	1366	1352
45°	1380	1318	1299
50°	1328	1267	1237
55°	1274	1208	1180
60°	1212	1138	1115
65°	1146	1066	1038
70°	1061	977	956
75°	942	872	881
80°	801	737	736
85°	578	504	495

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2765 cd/sqm

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.4
10°-20°	624.4	3.9
20°-30°	917.5	5.8
30°-40°	1065.7	6.7
40°-50°	1064.4	6.7
50°-60°	928.1	5.9
60°-70°	686.1	4.3
70°-80°	388.2	2.5
80°-90°	112.4	0.7
90°-100°	217.4	1.4
100°-110°	690.8	4.4
110°-120°	1182.1	7.5
120°-130°	1554.6	9.8
130°-140°	1745.0	11.0
140°-150°	1711.2	10.8
150°-160°	1435.4	9.1
160°-170°	951.9	6.0
170°-180°	332.7	2.1
0°-30°	1763.8	11.1
0°-40°	2829.5	17.9
0°-60°	4821.9	30.5
0°-90°	6008.6	38.0
90°-120°	2090.2	13.2
90°-150°	7101.0	44.9
90°-180°	9821.0	62.0
0°-180°	15829.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	38	104	98	101	15
95°	155	184	190	190	184	172
105°	638	646	652	658	658	673
115°	1186	1203	1198	1195	1186	1173
125°	1725	1752	1743	1734	1731	1542
135°	2232	2264	2271	2268	2259	1725
145°	2709	2730	2747	2751	2739	1693
155°	3098	3106	3116	3131	3121	1426
165°	3370	3367	3367	3388	3373	951
175°	3507	3498	3492	3513	3495	333
180°	3513	3513	3513	3513	3513	

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	3.1	38.2	103.8	97.5	100.6
92.5°	65.6	89.0	92.1	95.3	95.3
95°	154.6	184.3	189.6	189.6	184.3
97.5°	257.4	284.9	296.6	296.6	296.6
100°	376.0	400.3	408.8	408.8	405.7
102.5°	501.0	519.0	530.7	533.8	530.7
105°	637.6	646.1	652.5	657.7	657.7
107.5°	773.2	785.9	785.9	788.0	773.2
110°	904.5	921.5	921.5	921.5	913.0

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1046.4	1064.4	1061.3	1052.8	1046.4
115°	1186.3	1203.2	1197.9	1194.8	1186.3
117.5°	1325.0	1348.3	1333.4	1325.0	1316.6
120°	1464.8	1488.1	1464.8	1464.8	1455.3
122.5°	1592.0	1621.5	1606.7	1598.2	1592.0
125°	1725.4	1751.8	1743.3	1733.8	1730.6
127.5°	1855.6	1888.4	1876.8	1864.1	1855.6
130°	1977.4	2015.6	2010.2	2003.9	1992.3
132.5°	2114.1	2143.7	2145.9	2131.0	2122.5
135°	2231.6	2264.4	2270.8	2267.7	2259.2
137.5°	2363.0	2389.4	2394.7	2392.6	2380.0
140°	2478.4	2504.9	2519.7	2519.7	2508.1
142.5°	2597.1	2623.5	2632.0	2635.1	2623.5
145°	2709.3	2730.5	2747.4	2750.6	2739.0
147.5°	2810.0	2836.4	2849.1	2854.4	2842.8
150°	2913.8	2931.7	2943.4	2952.9	2943.4
152.5°	3005.9	3023.8	3038.7	3050.4	3038.7
155°	3098.1	3106.4	3116.0	3130.9	3121.3
157.5°	3177.4	3183.8	3189.1	3210.3	3195.4
160°	3248.4	3254.8	3257.9	3276.0	3263.3
162.5°	3314.1	3314.1	3317.3	3337.4	3322.6
165°	3370.2	3367.0	3367.0	3388.2	3373.4
167.5°	3421.0	3411.5	3411.5	3432.7	3417.9
170°	3459.2	3450.7	3447.6	3468.7	3450.7
172.5°	3485.7	3477.2	3474.0	3495.2	3477.2
175°	3506.9	3498.4	3492.0	3513.2	3495.2
177.5°	3518.5	3510.0	3503.6	3521.7	3503.6
180°	3513.2	3513.2	3513.2	3513.2	3513.2

TEST NUMBER: P909412

CATALOG NUMBER: DFN2DIP-SQ4F0-060D110US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.80	8.57	8.86	9.62	11.06	7.36	8.12	8.41	9.18	10.61
	3H	9.46	10.14	10.52	11.21	12.66	8.97	9.65	10.03	10.72	12.17
	4H	10.05	10.69	11.12	11.76	13.22	9.55	10.20	10.63	11.27	12.73
	6H	10.44	11.04	11.53	12.11	13.58	9.94	10.54	11.03	11.61	13.08
	8H	10.55	11.12	11.64	12.20	13.67	10.05	10.61	11.14	11.70	13.17
	12H	10.60	11.13	11.69	12.22	13.71	10.09	10.62	11.18	11.71	13.20
4H	2H	8.25	8.90	9.33	9.97	11.43	7.90	8.55	8.98	9.62	11.07
	3H	10.11	10.66	11.20	11.75	13.22	9.71	10.25	10.80	11.34	12.82
	4H	10.83	11.32	11.92	12.41	13.90	10.40	10.90	11.50	11.99	13.48
	6H	11.34	11.77	12.44	12.88	14.36	10.91	11.34	12.01	12.44	13.93
	8H	11.49	11.89	12.59	12.99	14.49	11.05	11.45	12.16	12.55	14.06
	12H	11.56	11.92	12.68	13.04	14.54	11.11	11.47	12.23	12.59	14.09
8H	4H	11.02	11.41	12.12	12.52	14.02	10.64	11.04	11.74	12.14	13.64
	6H	11.65	11.98	12.77	13.12	14.62	11.27	11.59	12.39	12.74	14.24
	8H	11.87	12.16	13.00	13.28	14.80	11.48	11.77	12.61	12.89	14.41
	12H	12.00	12.25	13.14	13.38	14.93	11.59	11.84	12.72	12.96	14.52
12H	4H	11.00	11.36	12.12	12.47	13.98	10.63	10.99	11.75	12.10	13.61
	6H	11.68	11.97	12.81	13.09	14.61	11.31	11.59	12.44	12.72	14.24
	8H	11.92	12.17	13.05	13.29	14.85	11.54	11.79	12.67	12.91	14.47