

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909421

Luminaire Tested: DFN2DIP-SQ4F0-060D140US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909421
REPORT IS A COMBINATION OF REPORTS P901705 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D140US840-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19995.3 lumens
Efficiency: N/A
Efficacy: 128.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 155.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLLONL

Luminous Intensity Polar Plot

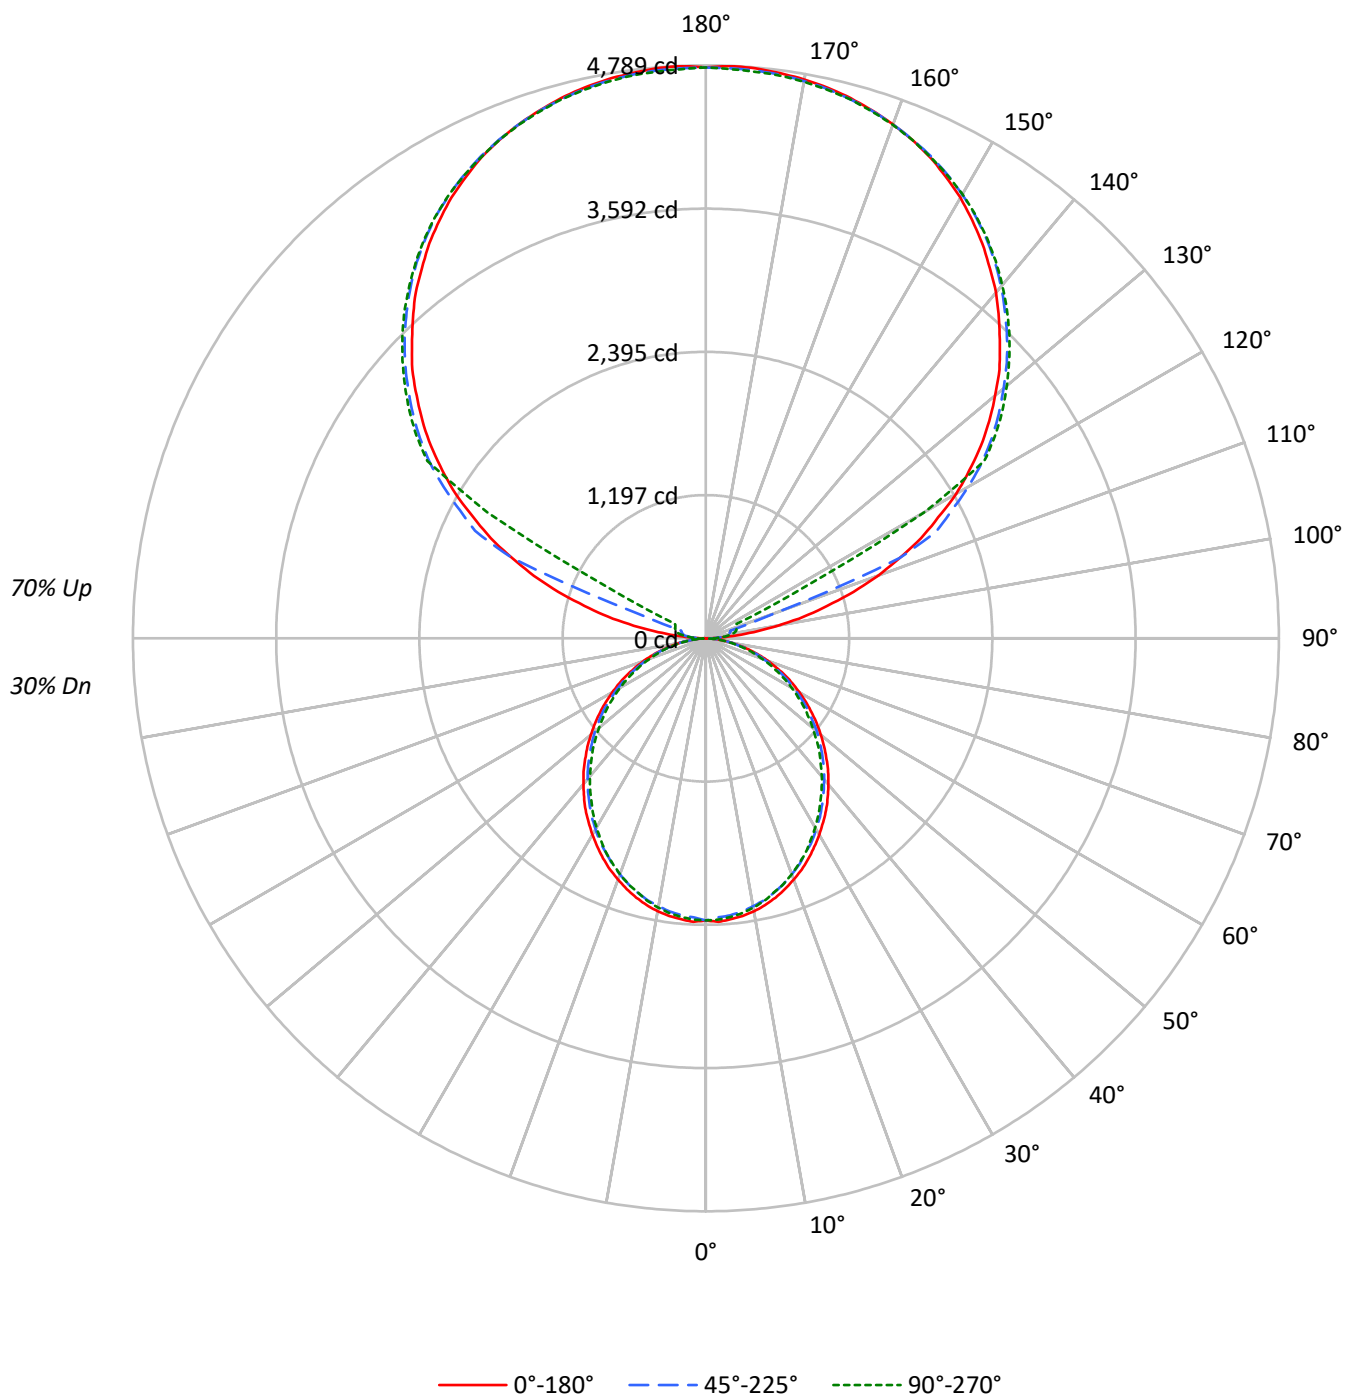

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	93	89	85	82	84	80	77	74	63	61	59	48	46	45	33	33	32
2	85	78	72	67	76	70	65	61	55	52	49	42	40	38	29	28	27
3	77	68	61	56	69	62	56	51	49	45	41	37	34	32	26	24	23
4	71	60	53	47	63	54	48	43	43	39	35	33	30	27	23	21	20
5	65	54	46	40	58	48	42	37	39	34	30	29	26	23	21	19	17
6	60	48	40	35	53	43	37	32	35	30	26	27	23	20	19	17	15
7	55	43	35	30	49	39	32	28	31	26	23	24	21	18	17	15	13
8	51	39	32	26	46	35	29	24	28	24	20	22	19	16	16	14	12
9	47	36	28	23	42	32	26	22	26	21	18	20	17	14	15	12	11
10	44	32	26	21	40	30	23	19	24	19	16	19	15	13	14	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1654	1654	1654
5°	1657	1632	1643
10°	1643	1610	1621
15°	1619	1584	1587
20°	1587	1547	1552
25°	1554	1504	1511
30°	1513	1463	1459
35°	1475	1415	1404
40°	1427	1366	1352
45°	1380	1318	1299
50°	1328	1267	1237
55°	1274	1208	1180
60°	1212	1138	1115
65°	1146	1066	1038
70°	1061	977	956
75°	942	872	881
80°	801	737	736
85°	578	504	495

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2559 cd/sqm

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.1
10°-20°	624.4	3.1
20°-30°	917.5	4.6
30°-40°	1065.7	5.3
40°-50°	1064.4	5.3
50°-60°	928.1	4.6
60°-70°	686.1	3.4
70°-80°	388.2	1.9
80°-90°	110.8	0.6
90°-100°	157.3	0.8
100°-110°	586.5	2.9
110°-120°	1555.5	7.8
120°-130°	2580.0	12.9
130°-140°	2740.5	13.7
140°-150°	2547.0	12.7
150°-160°	2047.7	10.2
160°-170°	1319.5	6.6
170°-180°	454.2	2.3
0°-30°	1763.8	8.8
0°-40°	2829.5	14.2
0°-60°	4821.9	24.1
0°-90°	6007.0	30.0
90°-120°	2299.4	11.5
90°-150°	10166.9	50.8
90°-180°	13988.0	70.0
0°-180°	19995.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	41	69	86	93	18
95°	224	110	134	152	148	266
105°	1050	1153	211	248	262	1121
115°	1985	2044	2130	532	283	1954
125°	2807	2852	2918	2942	2952	2503
135°	3473	3529	3560	3594	3587	2683
145°	4029	4026	4084	4108	4091	2520
155°	4436	4406	4447	4468	4440	2044
165°	4675	4654	4664	4689	4664	1321
175°	4782	4758	4764	4789	4754	455
180°	4771	4771	4771	4771	4771	

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	3.2	41.4	68.9	86.5	93.1
92.5°	86.5	72.6	82.8	89.8	93.1
95°	224.3	110.3	134.5	152.1	148.5
97.5°	403.8	121.0	175.9	186.5	189.9
100°	611.3	138.1	196.8	224.3	231.3
102.5°	838.8	832.2	203.8	241.5	252.2
105°	1049.6	1153.3	210.8	248.4	262.4
107.5°	1294.7	1380.8	217.7	255.4	269.3
110°	1529.6	1601.8	604.3	259.1	272.7

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1750.6	1812.5	1753.9	265.7	276.3
115°	1985.2	2043.8	2130.3	531.8	283.3
117.5°	2188.9	2257.8	2316.8	1822.8	918.4
120°	2416.9	2468.5	2530.8	2572.2	2106.1
122.5°	2610.0	2665.3	2734.6	2755.1	2758.9
125°	2806.8	2851.9	2917.5	2941.6	2951.9
127.5°	2986.4	3034.7	3086.8	3121.2	3124.5
130°	3155.6	3211.1	3248.7	3286.9	3283.6
132.5°	3328.3	3373.4	3411.1	3442.2	3439.0
135°	3473.4	3528.8	3559.5	3594.3	3587.3
137.5°	3625.1	3666.5	3701.4	3735.8	3725.6
140°	3773.6	3801.4	3839.1	3870.3	3853.0
142.5°	3898.2	3922.3	3967.1	3994.5	3977.3
145°	4029.4	4025.6	4084.3	4108.5	4091.3
147.5°	4143.0	4132.7	4191.3	4208.5	4195.0
150°	4253.7	4229.4	4284.8	4305.3	4288.1
152.5°	4346.7	4319.2	4370.9	4391.8	4367.6
155°	4436.4	4405.7	4447.1	4467.6	4440.2
157.5°	4509.0	4481.6	4512.8	4536.9	4509.0
160°	4571.4	4550.5	4571.4	4591.9	4567.7
162.5°	4626.3	4605.8	4623.1	4647.2	4616.1
165°	4674.7	4654.2	4664.5	4688.6	4664.5
167.5°	4712.8	4691.9	4702.5	4726.8	4695.6
170°	4743.9	4723.0	4730.0	4754.2	4723.0
172.5°	4764.4	4743.9	4750.9	4775.1	4743.9
175°	4781.7	4757.5	4764.4	4788.7	4754.2
177.5°	4788.7	4764.4	4768.2	4792.3	4761.2
180°	4771.4	4771.4	4771.4	4771.4	4771.4

TEST NUMBER: P909421

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.83	7.53	7.94	8.64	10.17	6.38	7.09	7.49	8.19	9.72
	3H	8.48	9.11	9.60	10.23	11.77	7.99	8.62	9.11	9.74	11.28
	4H	9.06	9.66	10.19	10.78	12.33	8.57	9.17	9.70	10.28	11.84
	6H	9.46	10.01	10.60	11.13	12.69	8.96	9.51	10.09	10.63	12.19
	8H	9.56	10.09	10.70	11.22	12.78	9.06	9.58	10.20	10.72	12.27
	12H	9.60	10.10	10.75	11.23	12.81	9.09	9.59	10.24	10.72	12.30
4H	2H	7.27	7.87	8.41	8.99	10.54	6.91	7.51	8.05	8.63	10.18
	3H	9.12	9.63	10.27	10.77	12.33	8.72	9.22	9.86	10.36	11.92
	4H	9.84	10.30	10.98	11.43	13.01	9.41	9.87	10.56	11.00	12.59
	6H	10.35	10.74	11.50	11.90	13.47	9.91	10.31	11.07	11.46	13.04
	8H	10.49	10.86	11.65	12.01	13.60	10.06	10.43	11.21	11.57	13.16
	12H	10.56	10.90	11.73	12.05	13.65	10.11	10.45	11.28	11.60	13.20
8H	4H	10.02	10.39	11.17	11.53	13.13	9.64	10.01	10.79	11.16	12.75
	6H	10.65	10.95	11.82	12.14	13.73	10.27	10.57	11.44	11.76	13.35
	8H	10.87	11.14	12.05	12.30	13.91	10.48	10.74	11.66	11.91	13.52
	12H	11.00	11.23	12.18	12.40	14.04	10.59	10.82	11.77	11.98	13.63
12H	4H	10.00	10.33	11.17	11.49	13.09	9.63	9.97	10.80	11.12	12.72
	6H	10.68	10.94	11.86	12.11	13.72	10.31	10.57	11.48	11.74	13.35
	8H	10.92	11.15	12.10	12.31	13.96	10.54	10.77	11.72	11.93	13.58